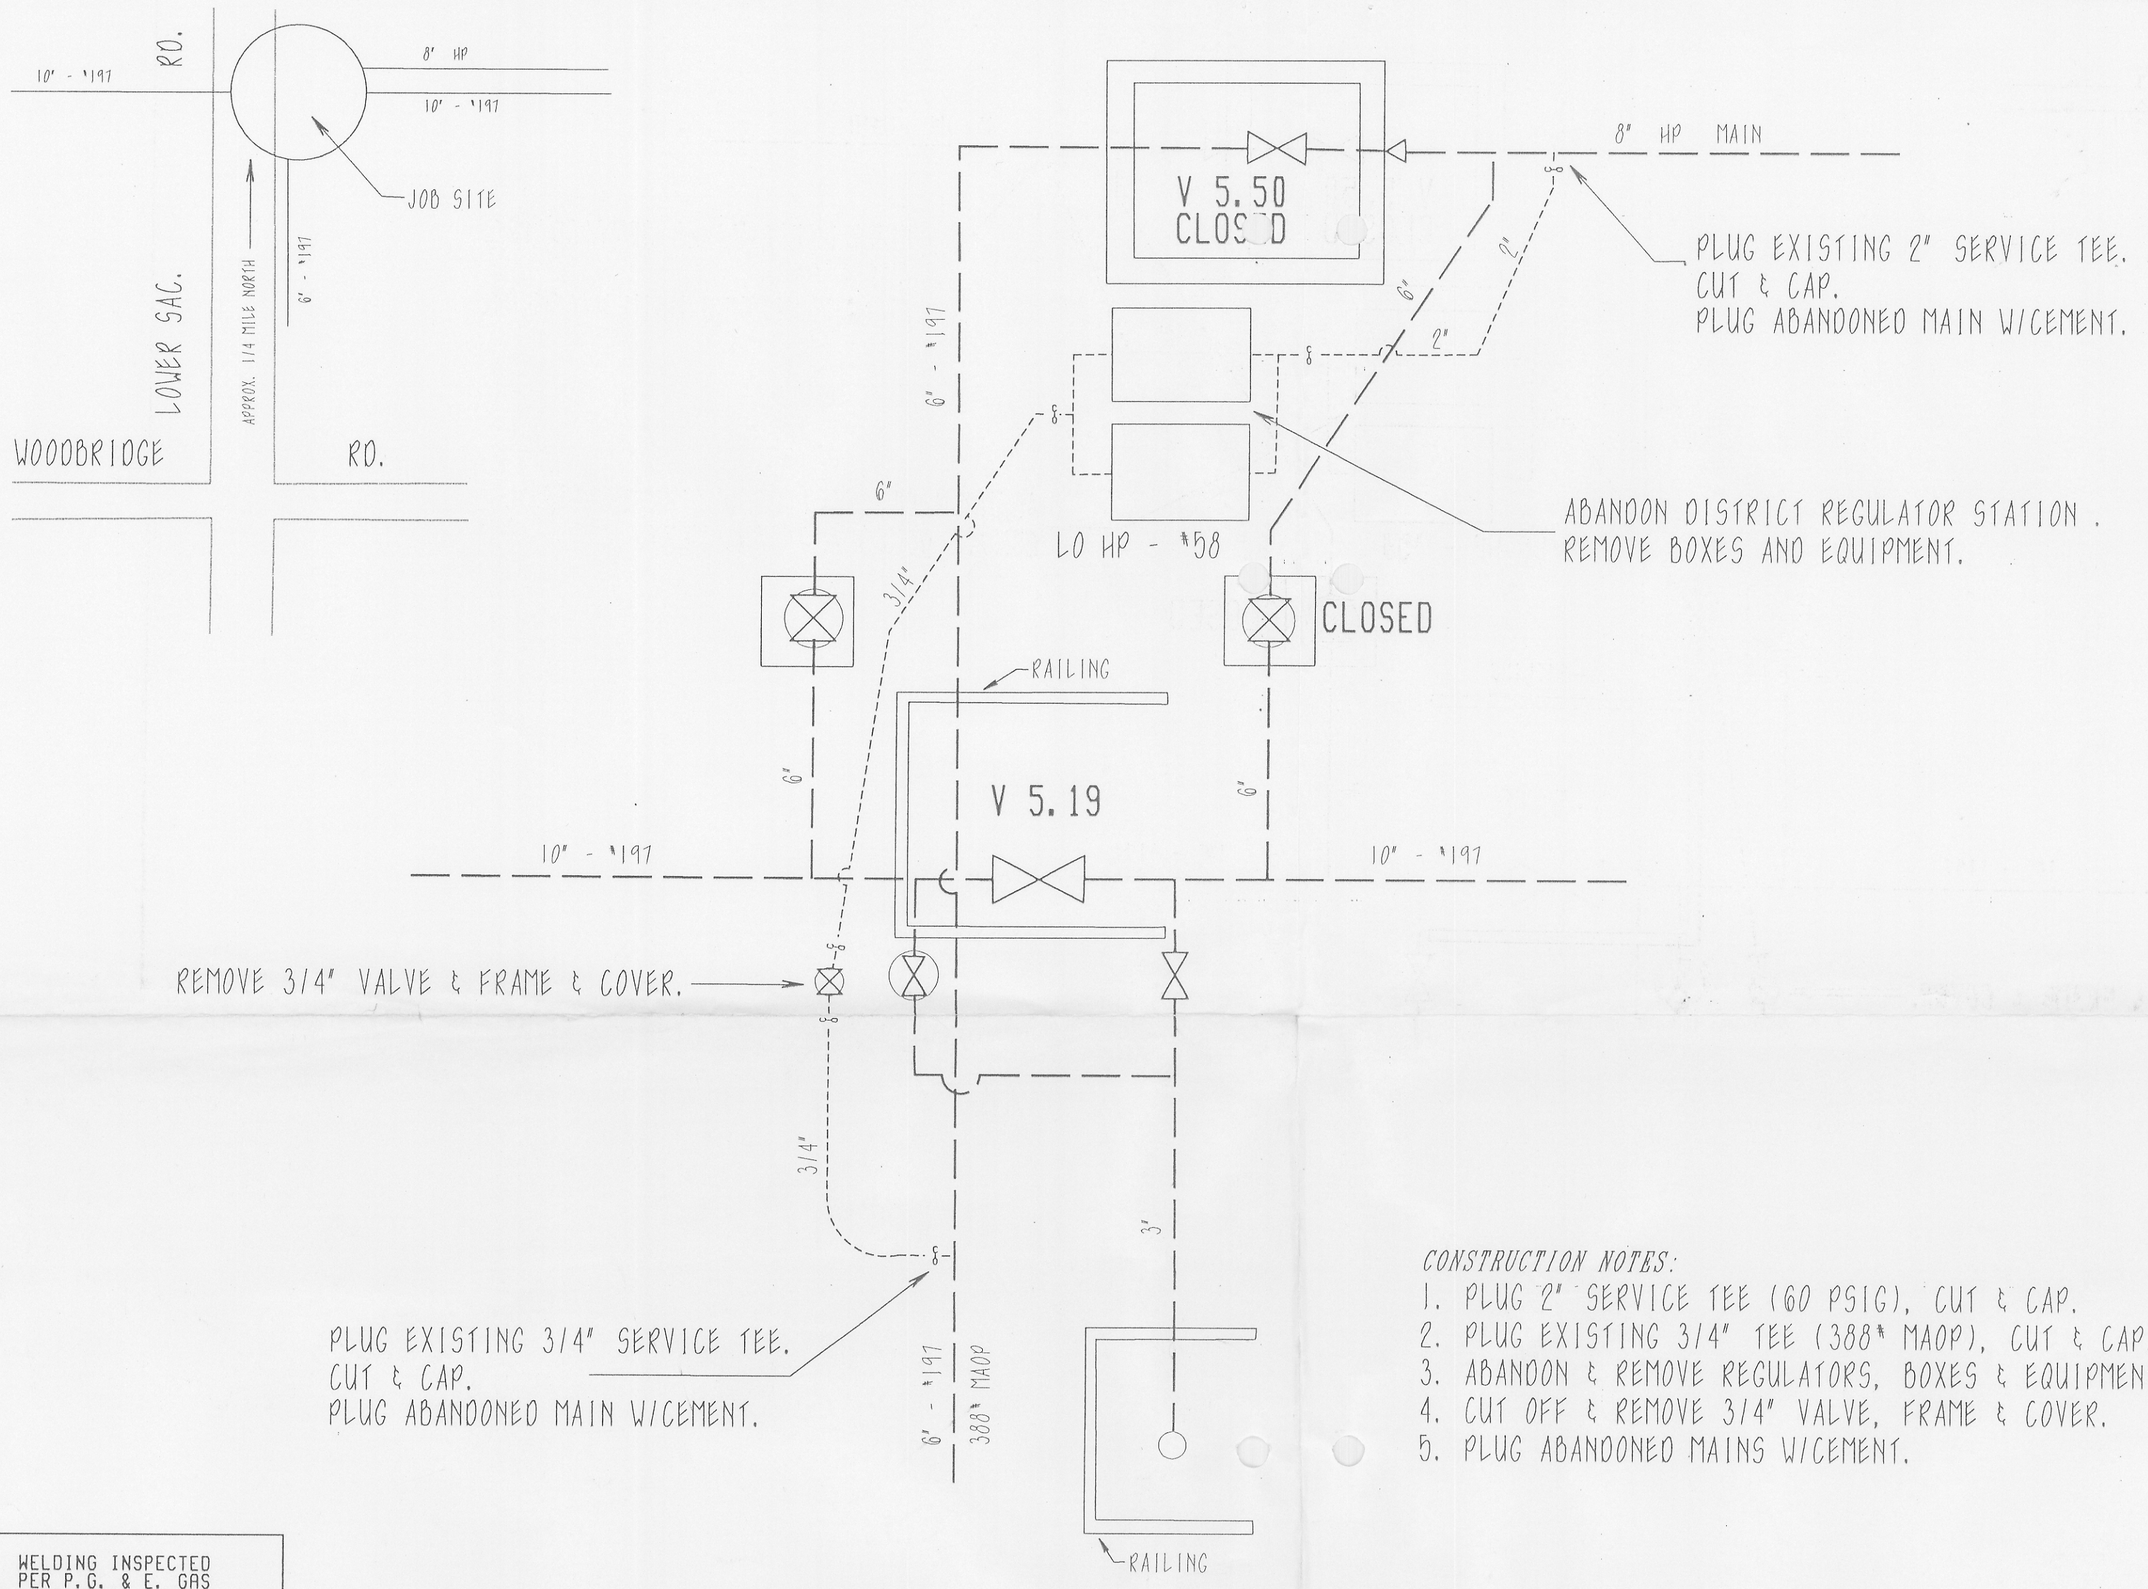

CONSTRUCTION NOTES:

1. PLUG 2" SERVICE TEE (60 PSIG), CUT & CAP.
2. PLUG EXISTING 3/4" TEE (388* MAOP), CUT & CAP.
3. ABANDON & REMOVE REGULATORS, BOXES & EQUIPMENT.
4. CUT OFF & REMOVE 3/4" VALVE, FRAME & COVER.
5. PLUG ABANDONED MAINS W/CEMENT.

RDG

WM 2869 - A8
WOODBRIDGE, UNINC.
CPA - #T197A0

WELDING INSPECTED
PER P.G. & E. GAS
STANDARD D-40

BY: _____
INSPECTOR

PLEASE CALL U.S.A. AT
LEAST 48 HOURS PRIOR TO
EXCAVATING IN THIS AREA
1-800-642-2444

NO.	DATE	DESCRIPTION	GM/SPEC	DWN.	CHKD.	SUPV.	APVD. BY

REVISIONS

APPROVED BY	
JN GM14931880	
SUPV. M.F.L.	
DSGN. R.D.G.	
DWN. R.D.G.	
CHKD. D.L.H.	
O.K. D.C.R.	
DATE 07/13/95	
SCALES NONE	

ABANDON LO HP-#58

ABANDON DISTRICT REGULATOR STATION
LOWER SACREMENTO RD. N/O WOODBRIDGE RD.
STOCKTON DIV. - WOODBRIDGE, UNINC.
PACIFIC GAS AND ELECTRIC COMPANY
SAN FRANCISCO, CALIFORNIA

BILL OF MATL	
DWG LIST LOSAC	
SUPSDS	
SUPSD BY	
SHEET NO. 8 / 8 SHEETS	
0731G912270	REV.