CONSTRUCTION NOTES:

1. INSTALL 2" X 2" PL BRANCHING SADDLE.
2. INSTALL 190' OF 2" PL HP MAIN
3. INSTALL 2" PL CAP, CLEAR DRIVEWAY.
4. INSTALL (1) 1" PL HP SERVICE.
5. INSTALL 1" PL VALVE IN F. & C.
6. MAKE ALL TIE INS AS SHOWN.
7. BOND LOCATING WIRES TOGETHER.

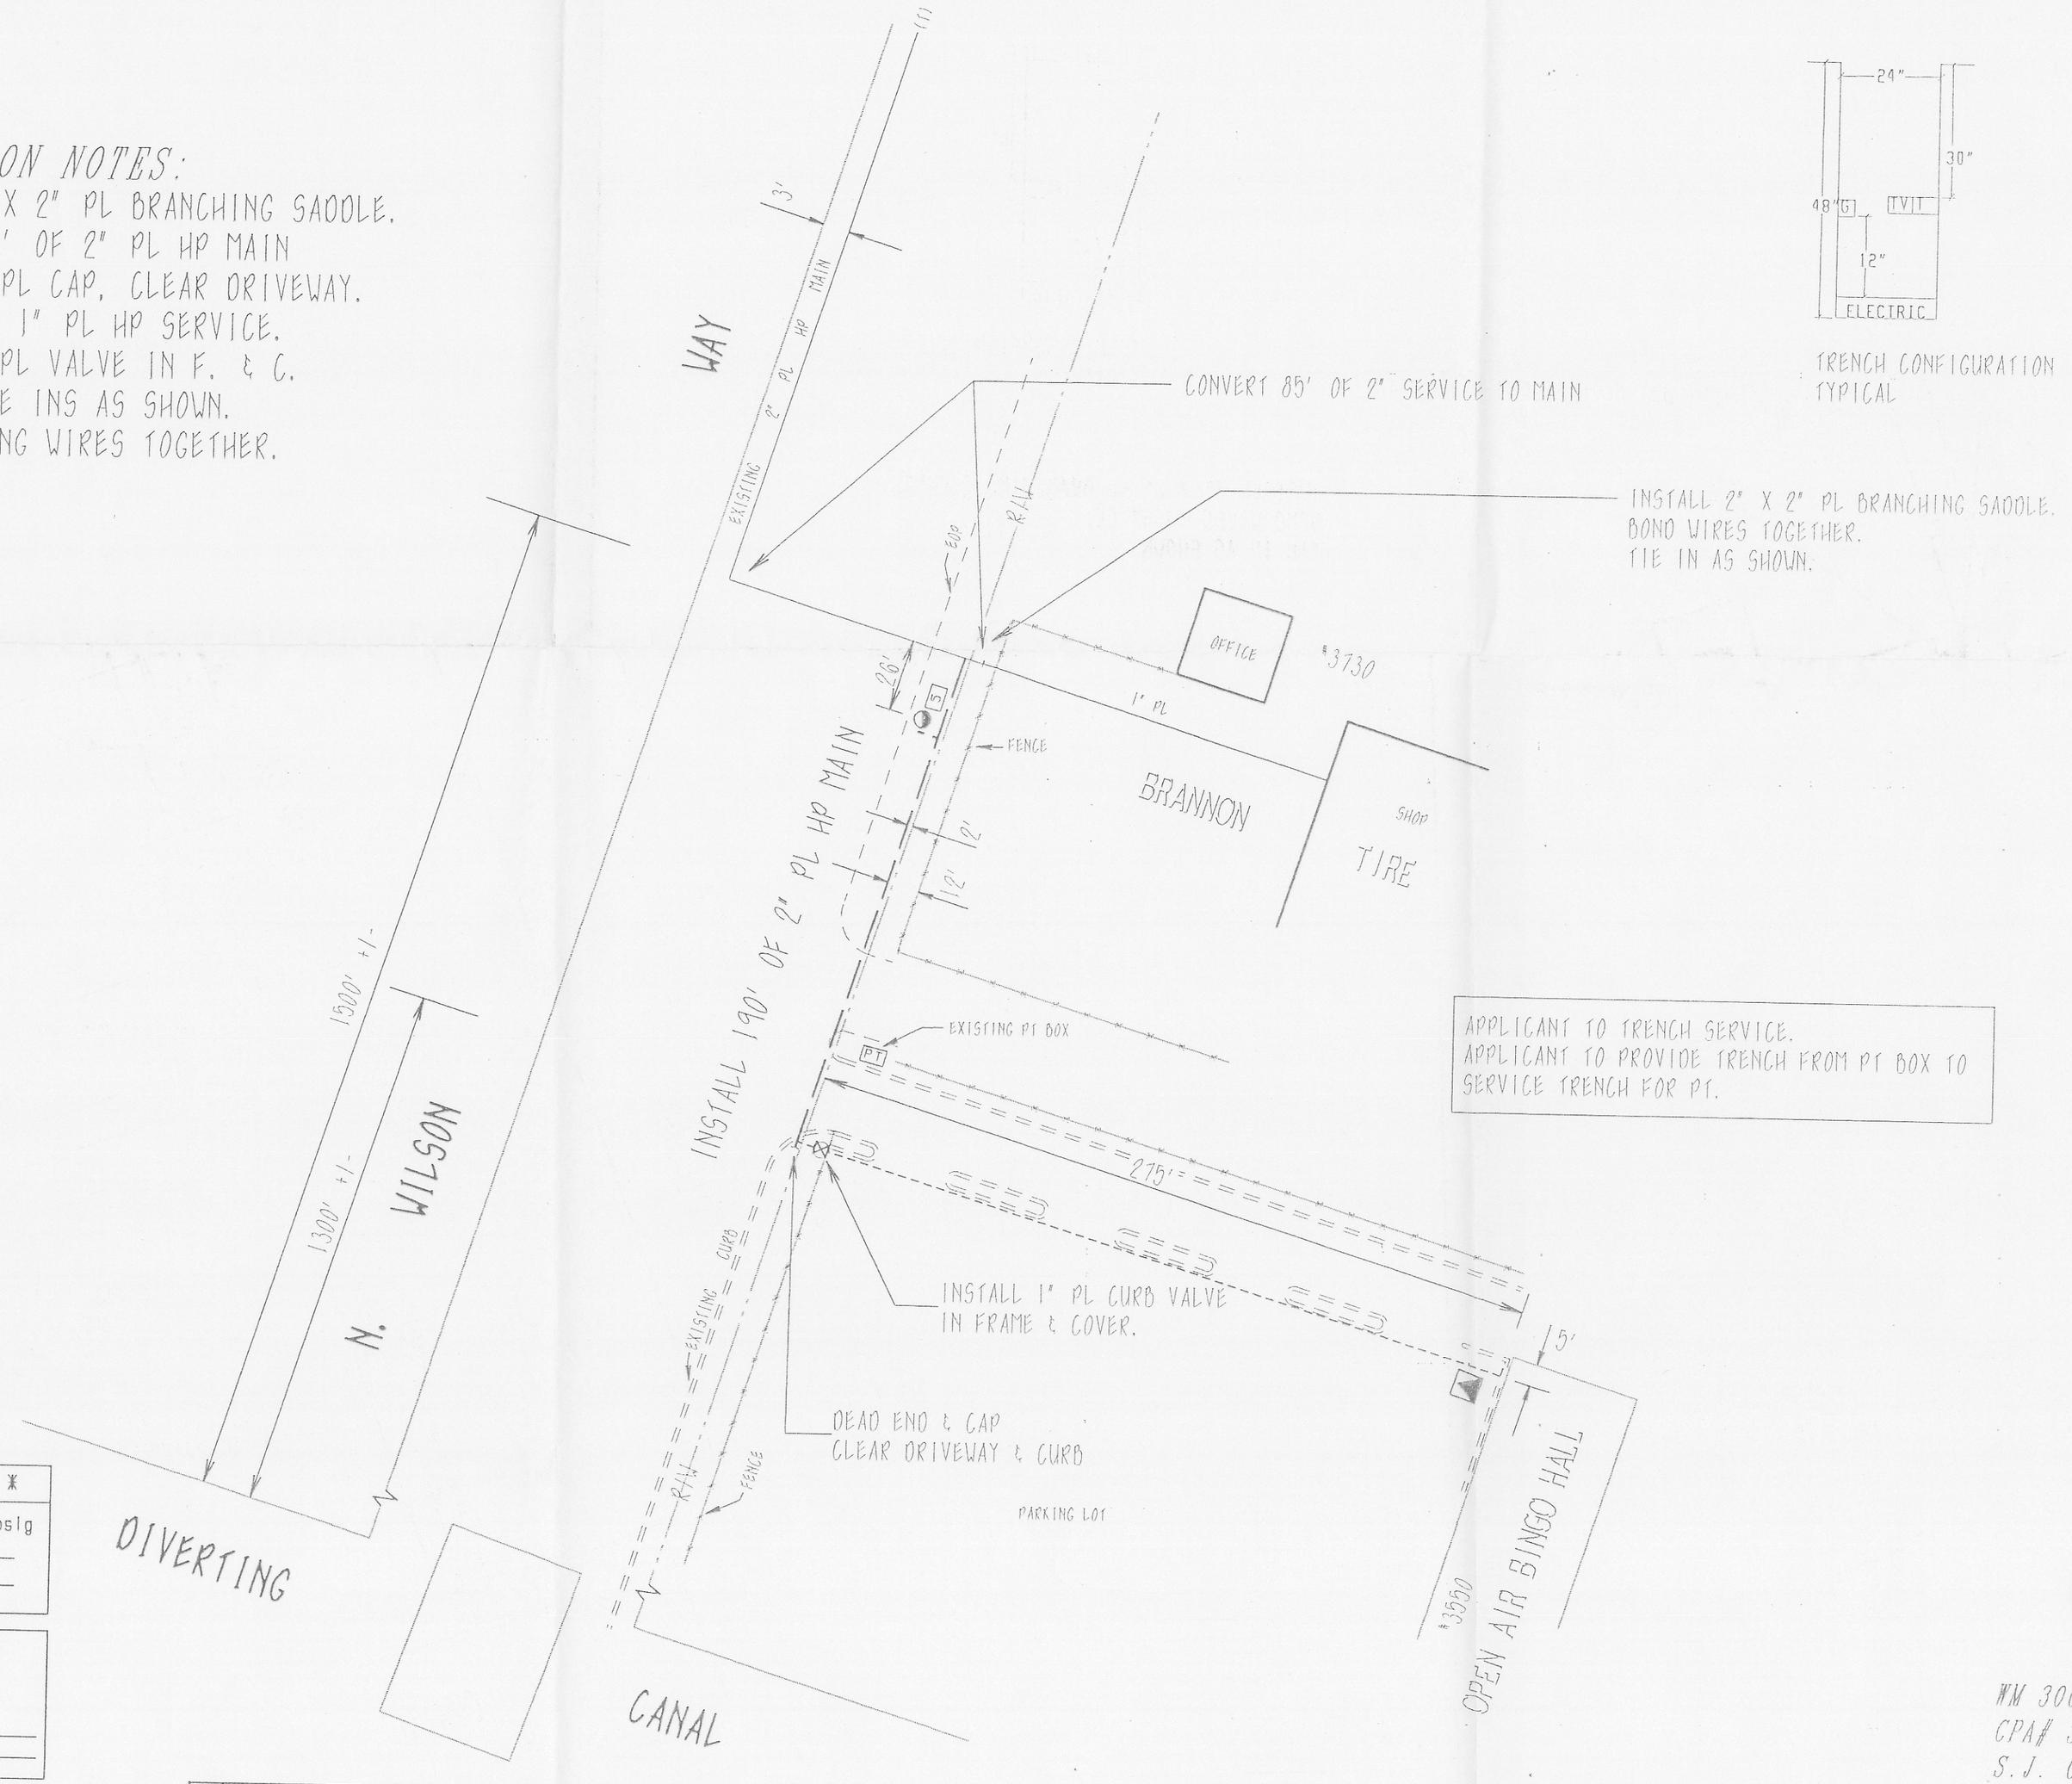

TRENCH CONFIGURATION
TYPICAL

APPLICANT TO TRENCH SERVICE.
APPLICANT TO PROVIDE TRENCH FROM PT BOX TO SERVICE TRENCH FOR PT.

* TEST DATA STAMP *
ACTUAL TEST PRESSURE _____ psig
DURATION OF TEST _____
DATE OF TEST _____

PLASTIC PIPE INSPECTION/DATA
PIPE MANUFACTURER _____
DATE MANUFACTURED _____

PLEASE CALL U.S.A. AT LEAST 48 HOURS PRIOR TO EXCAVATING IN THIS AREA
1-800-642-2444

NO.	DATE	DESCRIPTION	GM/SPEC	DWN.	CHKD.	SUPV.	APVD. BY

REVISIONS

APPROVED BY

JN GM14957380
SUPV. G.D.W.
DSGN. R.D.G.
DWN. R.D.G.
CHKD. D.L.H.
O.K. D.C.R.
DATE 07/27/95
SCALES 1" = 50'

GAS MAIN EXTENSION

INSTALL 190' OF 2" PL HP MAIN
3550 NORTH WILSON WAY
STOCKTON DIV. - SAN JOAQUIN COUNTY
PACIFIC GAS AND ELECTRIC COMPANY
SAN FRANCISCO, CALIFORNIA

BILL OF MATL
DWG LIST BINGO
SUPSDS
SUPSD BY
SHEET NO. 11/11 SHEETS
0731G017690
REV.

WM 3005 - A4
CPA# 30050C
S.J. COUNTY PERMIT