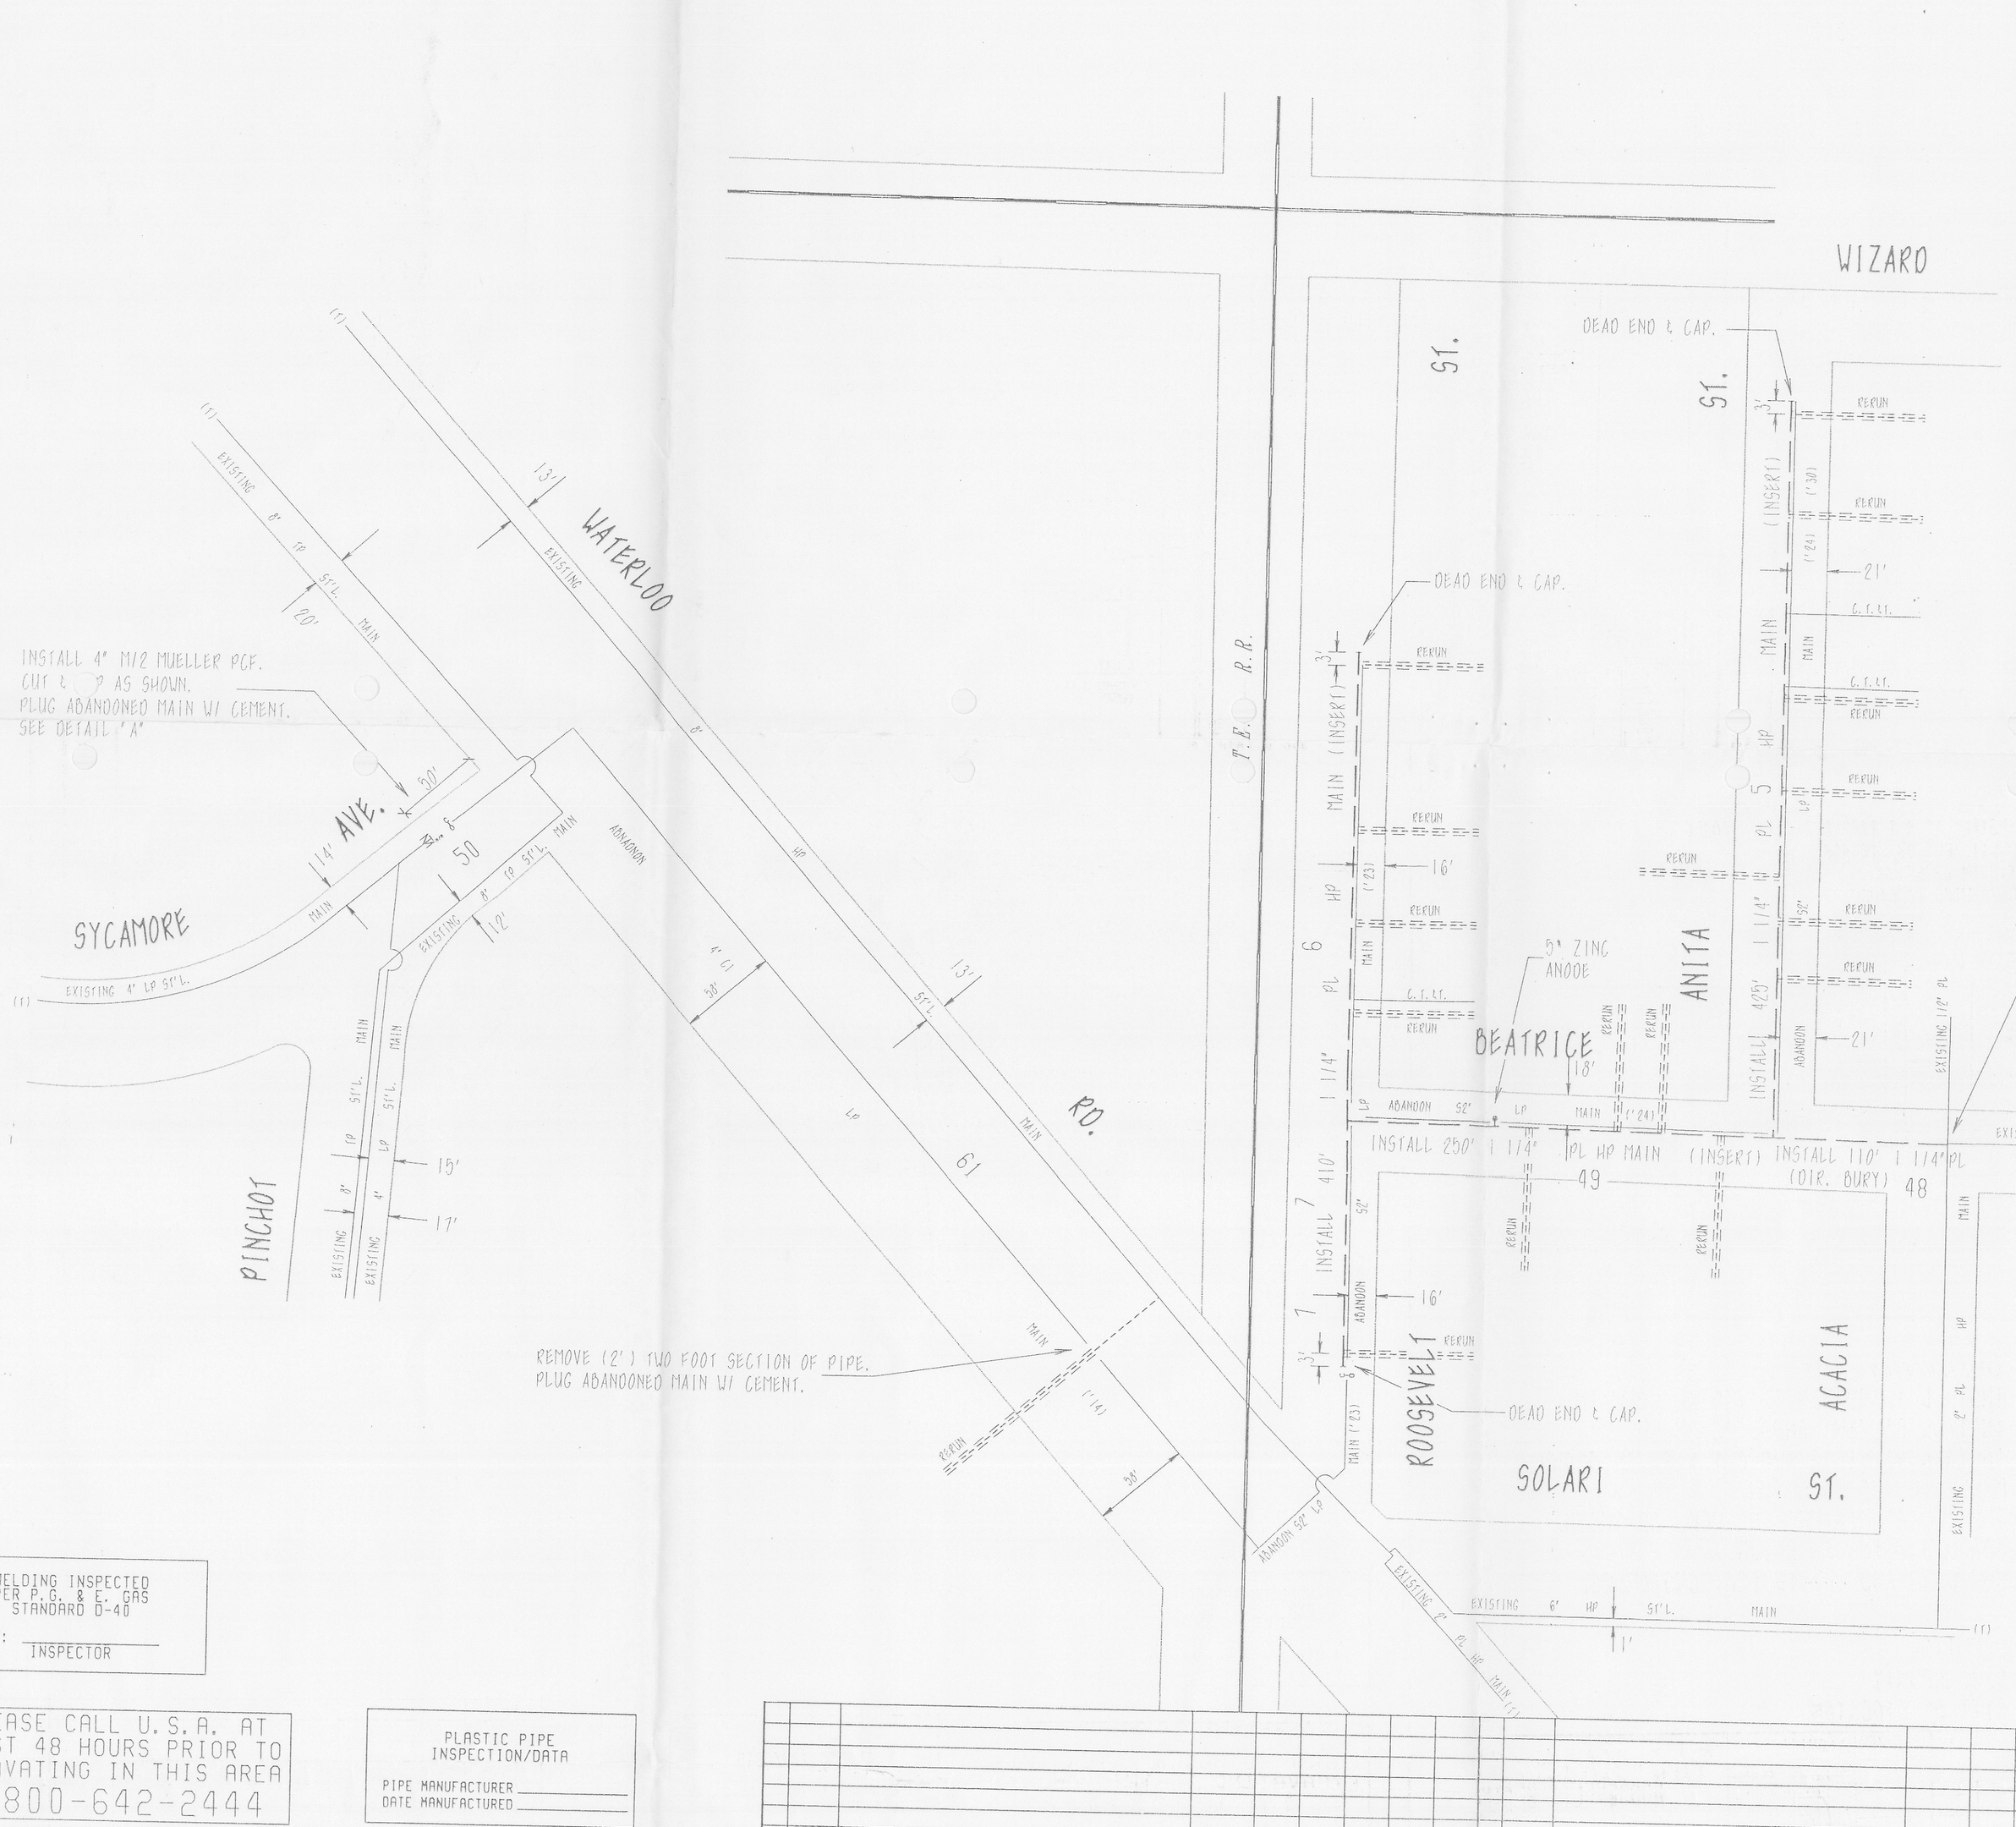

NOTE:
LEAK TEST THE MUELLER PCF AT 100 PSIG BEFORE TAPPING.

CONSTRUCTION NOTES:
INSTALL 1,195' OF 1 1/4" PL HP MAIN.
INSTALL 5" ZINC ANODE AS SHOWN.
INSTALL SERVICES AND C.T.&T. AS SHOWN.
MAKE TIE INS AS SHOWN.
INSTALL 4" M/2 MUELLER PCF, AS SHOWN.
ABANDON MAINS AS SHOWN.
SHUTDOWN AND RELITE (20) CUSTOMERS.

PERMITS:
S. J. COUNTY
CITY OF STOCKTON

WM 3005 - C3

WELDING INSPECTED PER P.G. & E. GAS STANDARD D-40
BY: _____ INSPECTOR

PLEASE CALL U.S.A. AT LEAST 48 HOURS PRIOR TO EXCAVATING IN THIS AREA
1-800-642-2444

PLASTIC PIPE INSPECTION/DATA
PIPE MANUFACTURER _____
DATE MANUFACTURED _____

NO.	DATE	DESCRIPTION	GM/SPEC	DWN.	CHKD.	SUPV.	APVD. BY
		REVISIONS					

NO.	DATE	DESCRIPTION	GM/SPEC	DWN.	CHKD.	SUPV.	APVD. BY
		REVISIONS					

APPROVED BY

JN GM14175420
SUPV. G.D.W.
DSGN. R.D.G.
DWN. R.D.G.
CHKD. R.M.D.
O.K. D.C.B.
DATE 05/30/95
SCALES 1" = 60'

GAS MAIN REPLACEMENT
ROOSEVELT, BEATRICE & ANITA ST.
STOCKTON, INC.
STOCKTON DIV. S.J. VALLEY REGION
PACIFIC GAS AND ELECTRIC COMPANY
SAN FRANCISCO, CALIFORNIA

BILL OF MATL.
DWG LIST: BEATRPRP
SUPSDS
SUPSD BY
SHEET NO. 12/12 SHEETS
REV.
0731G907780