JOINT TRENCH COMPOSITE

PLEASE CALL U.S.A. AT
LEAST 48 HOURS PRIOR TO
EXCAVATING IN THIS AREA
1-800-227-2600

NOTIFIED U.S.A.
DATE:
TICKET #
BY:

NOTE:
LAND DEPARTMENT TO SECURE ALL LAND RIGHTS & PROVIDE STAKING OF EXISTING ROAD R/W.

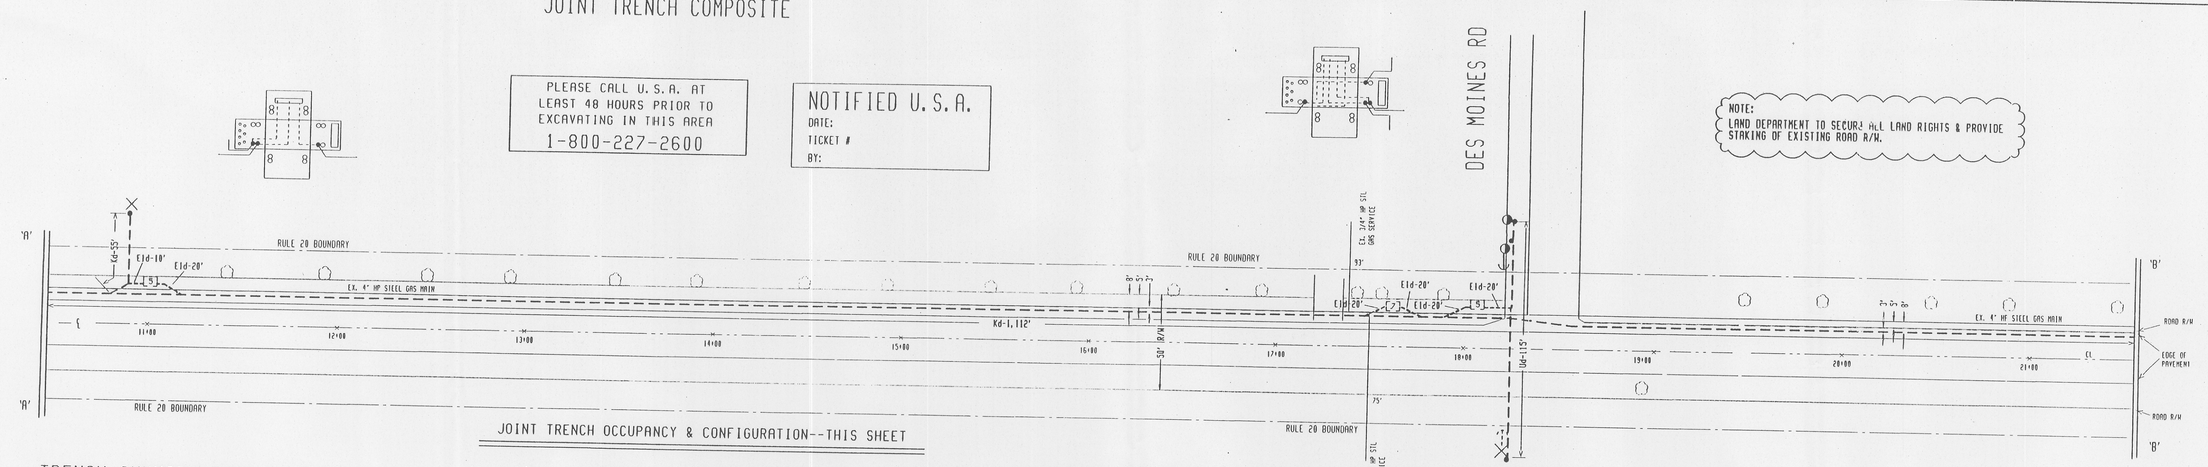

TRENCH SUMMARY-THIS SHEET

1,542' -- DISTRIBUTION TRENCH (24" x 60")

3 - [5] SPLICE BOX (36" x 60")
1 [7] SPLICE BOX (4'6" x 8'6")

JOINT TRENCH OCCUPANCY & CONFIGURATION--THIS SHEET

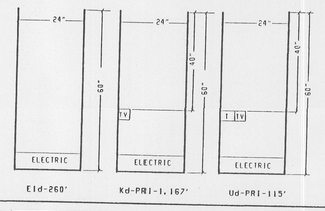

CAUTION:
EXISTING UG 4" HP STEEL GAS MAIN ON N/S OF ACAMPO RD.
EXISTING UG TELEPHONE ON SOUTH SIDE OF ACAMPO ROAD.

TELEPHONE & TV TO EXCAVATE FROM THEIR RESPECTIVE SUBSTRUCTURES & TRENCH TO THE JOINT TRENCH.





MAP P3-10

ELECTRIC UNDERGROUND CONDUIT DESIGN

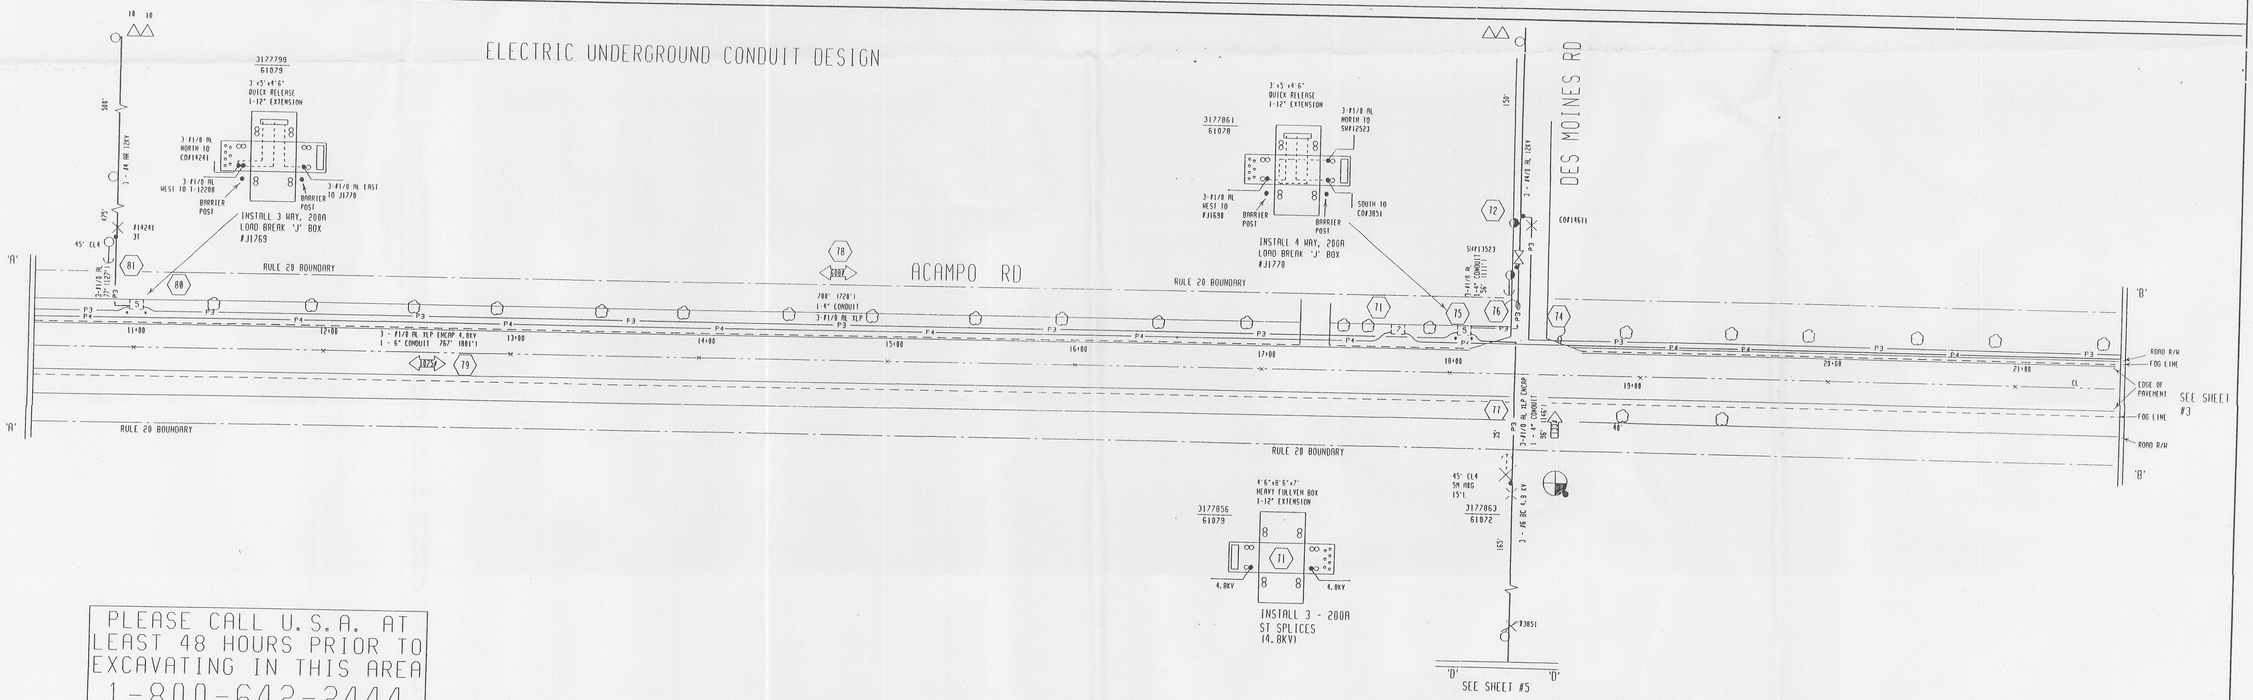

PLEASE CALL U.S.A. AT
LEAST 48 HOURS PRIOR TO
EXCAVATING IN THIS AREA
1-800-642-2444

APPROVED BY	
ORDER	7010109
SUPV.	AMD
USGN.	
DRN.	KAS
CHKD.	MFL
O.K.	BMT
DATE	
SCALES	1" =40'

ACAMPO RD RULE 20A

ACAMPO RD FROM HWY#99 WEST
JOINT TRENCH COMPOSITE
ACAMPO UNINC
PACIFIC GAS AND ELECTRIC COMPANY
SAN FRANCISCO, CALIFORNIA

BILL OF MATL	
DWG LIST	
SUPSDS	
SUPSD BY	
SHEET NO.	2a/4a SHEETS
0731E75988	REV.

R-96-266