T. 1N., R. 5E. M.D.B.M.
SECTION 09

NOTE:
THIS WORK TO BE DONE
IN CONJUCTION WITH
ORDER #7001711 & 7011345.

CONSTRUCTION NOTES:
INSTALL 2605' OF 4" HP STEEL MAIN
0.156" W.T., GR. B, ERW.
INSTALL 8" X 4" STEEL REDUCER.
INSTALL 4" 90 DEGREE ELBOW.
ABANDON MAIN PER STD. PRACTICE 463-2.
TIE IN AS SHOWN.

GENERAL NOTES:

1. ALL EXISTING UTILITIES SHOWN ON THE PLANS HAVE BEEN TAKEN FROM THE BEST AVAILABLE RECORDS, ACTUAL LOCATIONS MUST BE VERIFIED IN THE FIELD BY THE CONTRACTOR THE CONTRACTOR SHALL PHYSICALLY LOCATE ALL LINES AND SERVICES AND PROTECT THEM FROM DAMAGE DURING CONSTRUCTION. THE COST TO REPAIR OR REPLACE EXISTING UTILITY LINES AND SERVICES DAMAGED BY THE CON-TRACTORS CONSTRUCTION OPERATION SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONTACTING ALL UTILITY AGENCIES TO MARK THEIR FACILITIES IN THE FIELD BEFORE ANY EXCAVATION. THE CONTRACTOR SHALL NOTIFY AND CO-ORDINATE ALL WORK WITH ANY AGENCY REQUIRING REMOVAL OR RELOCATION OF THEIR FACILITIES
3. FINAL TRENCH ALIGNMENT AND PIPE PLACE-MENT (VERTICAL CLEARANCES), WILL BE DETERMINED WHEN EXISTING UTILITIES ARE LOCATED AND OR EXPOSED.

NOTE:
PLEASE CONTACT DON MESSMAN, LAND PROJECTS,
AT COMPANY PHONE 720-7004 PRIOR TO CONSTRUCTION,
TO STAKE THE FENCE AREA AND LOT.

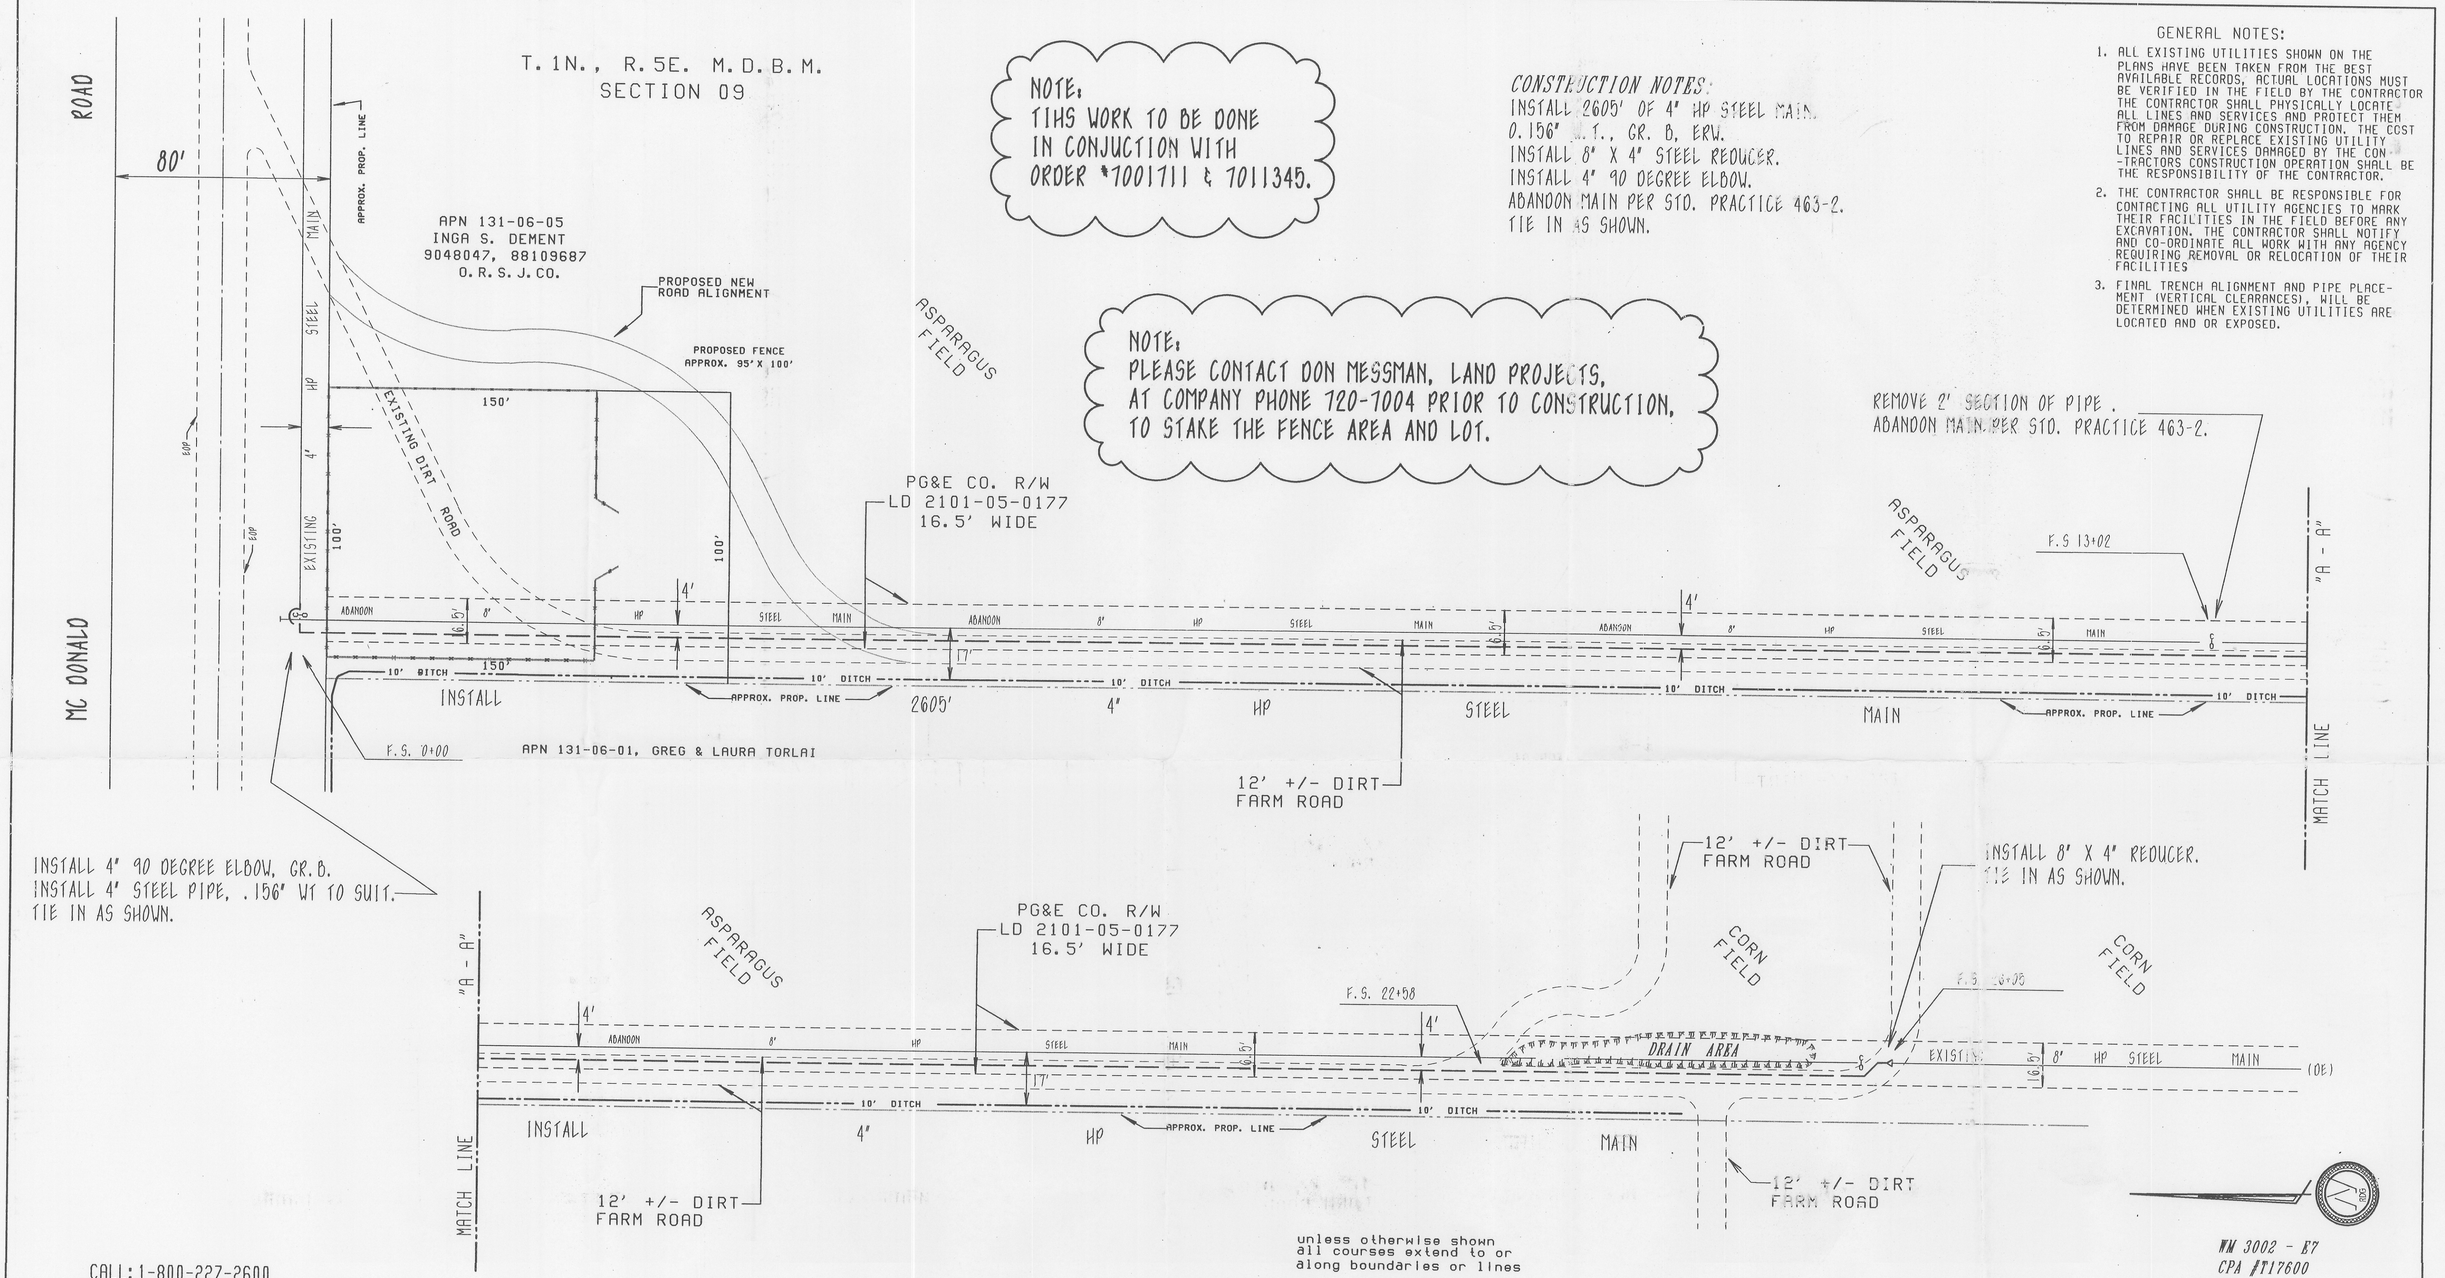

unless otherwise shown
all courses extend to or
along boundaries or lines

WM 3002 - E7
CPA #T17600
HOLT
S.J. COUNTY

CALL: 1-800-227-2600

CALL BEFORE YOU DIG
USA
UNDERGROUND SERVICE ALERT

WELDING INSPECTION
PER PG&E GAS STD D-40

BY: _____
INSPECTOR

* TEST DATA STAMP *

ACTUAL TEST PRESSURE _____ psig
DURATION OF TEST _____
DATE OF TEST _____

DESIGN PRESSURE 60 PSIG

APPROVED BY	JN 6013160
	SUPV. A.M.D.
	DSGN. R.D.G.
	DWN. R.D.G.
	CHKD. D.L.H.

LOWER GAS MAIN
INSTALL 2605' OF 4" HP MAIN
OLD LINE 176 S/O MCDONALD ISLAND RD.

BILL OF MATL
DWG LIST LOWER176
SUPSDS
SUPSD BY

FD-98-2105