PLEASE CALL U.S.A. AT
LEAST 48 HOURS PRIOR TO
EXCAVATING IN THIS AREA
1-800-227-2600

NOTIFIED U.S.A.
DATE:
TICKET #
BY:

JOINT TRENCH COMPOSITE

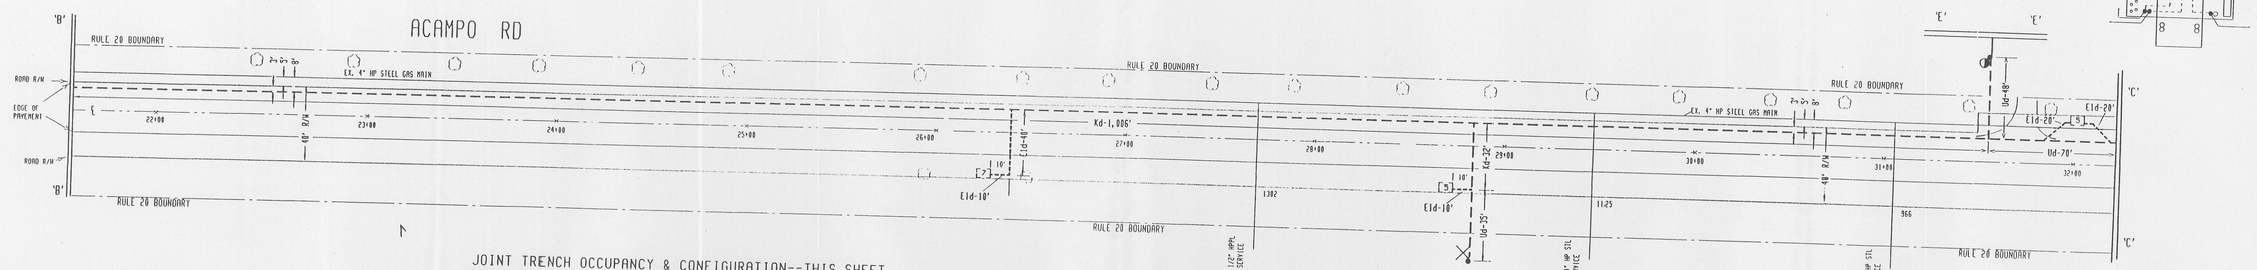

TRENCH SUMMARY-THIS SHEET

1,398' -- DISTRIBUTION TRENCH (24" x 60")

2 - [5] SPLICE BOX (36" x 60")
1 [7] SPLICE BOX (4'6" x 8'6")

JOINT TRENCH OCCUPANCY & CONFIGURATION--THIS SHEET

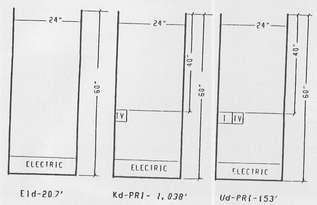







NOTE:
LAND DEPARTMENT TO SECURE ALL LAND RIGHTS & PROVIDE STAKING OF EXISTING ROAD R/W.

CAUTION:
EXISTING UG 4" HP STEEL GAS MAIN ON N/S OF ACAMPO RD.
EXISTING UG TELEPHONE ON SOUTH SIDE OF ACAMPO ROAD.

TELEPHONE & TV TO EXCAVATE FROM THEIR RESPECTIVE SUBSTRUCTURES & TRENCH TO THE JOINT TRENCH.

MAP -N- P3-10

ELECTRIC UNDERGROUND CONDUIT DESIGN

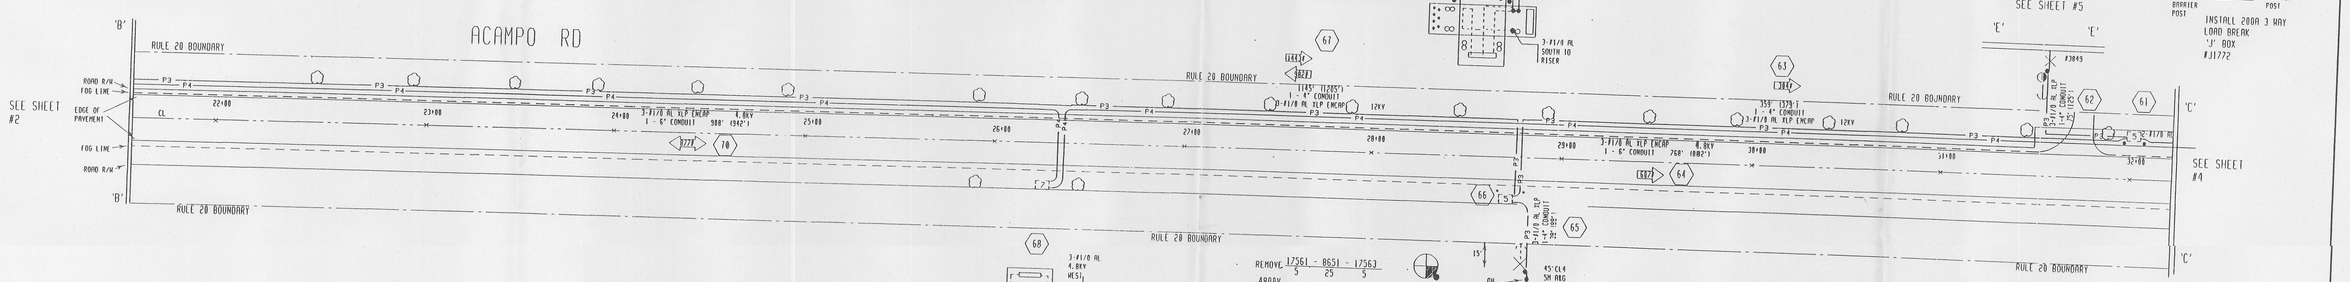

PLEASE CALL U.S.A. AT
LEAST 48 HOURS PRIOR TO
EXCAVATING IN THIS AREA
1-800-642-2444

APPROVED BY	ORDER 7010109	ACAMPO RD RULE 20A ACAMPO RD FROM HWY#99 WEST JOINT TRENCH COMPOSITE ACAMPO UNINC PACIFIC GAS AND ELECTRIC COMPANY SAN FRANCISCO, CALIFORNIA	BILL OF MATL
	SUPV. AMD		DWG LIST
	DSGN.		SUPSDS
	DRN. KBS		SUPSD BY
	CHKD. MFL		SHEET NO. 3a/4a SHEETS
	O.K. BMT		
	DATE		
	SCALES 1" =40'		0731E75988 REV. 1

EP-98-268 (4-4)