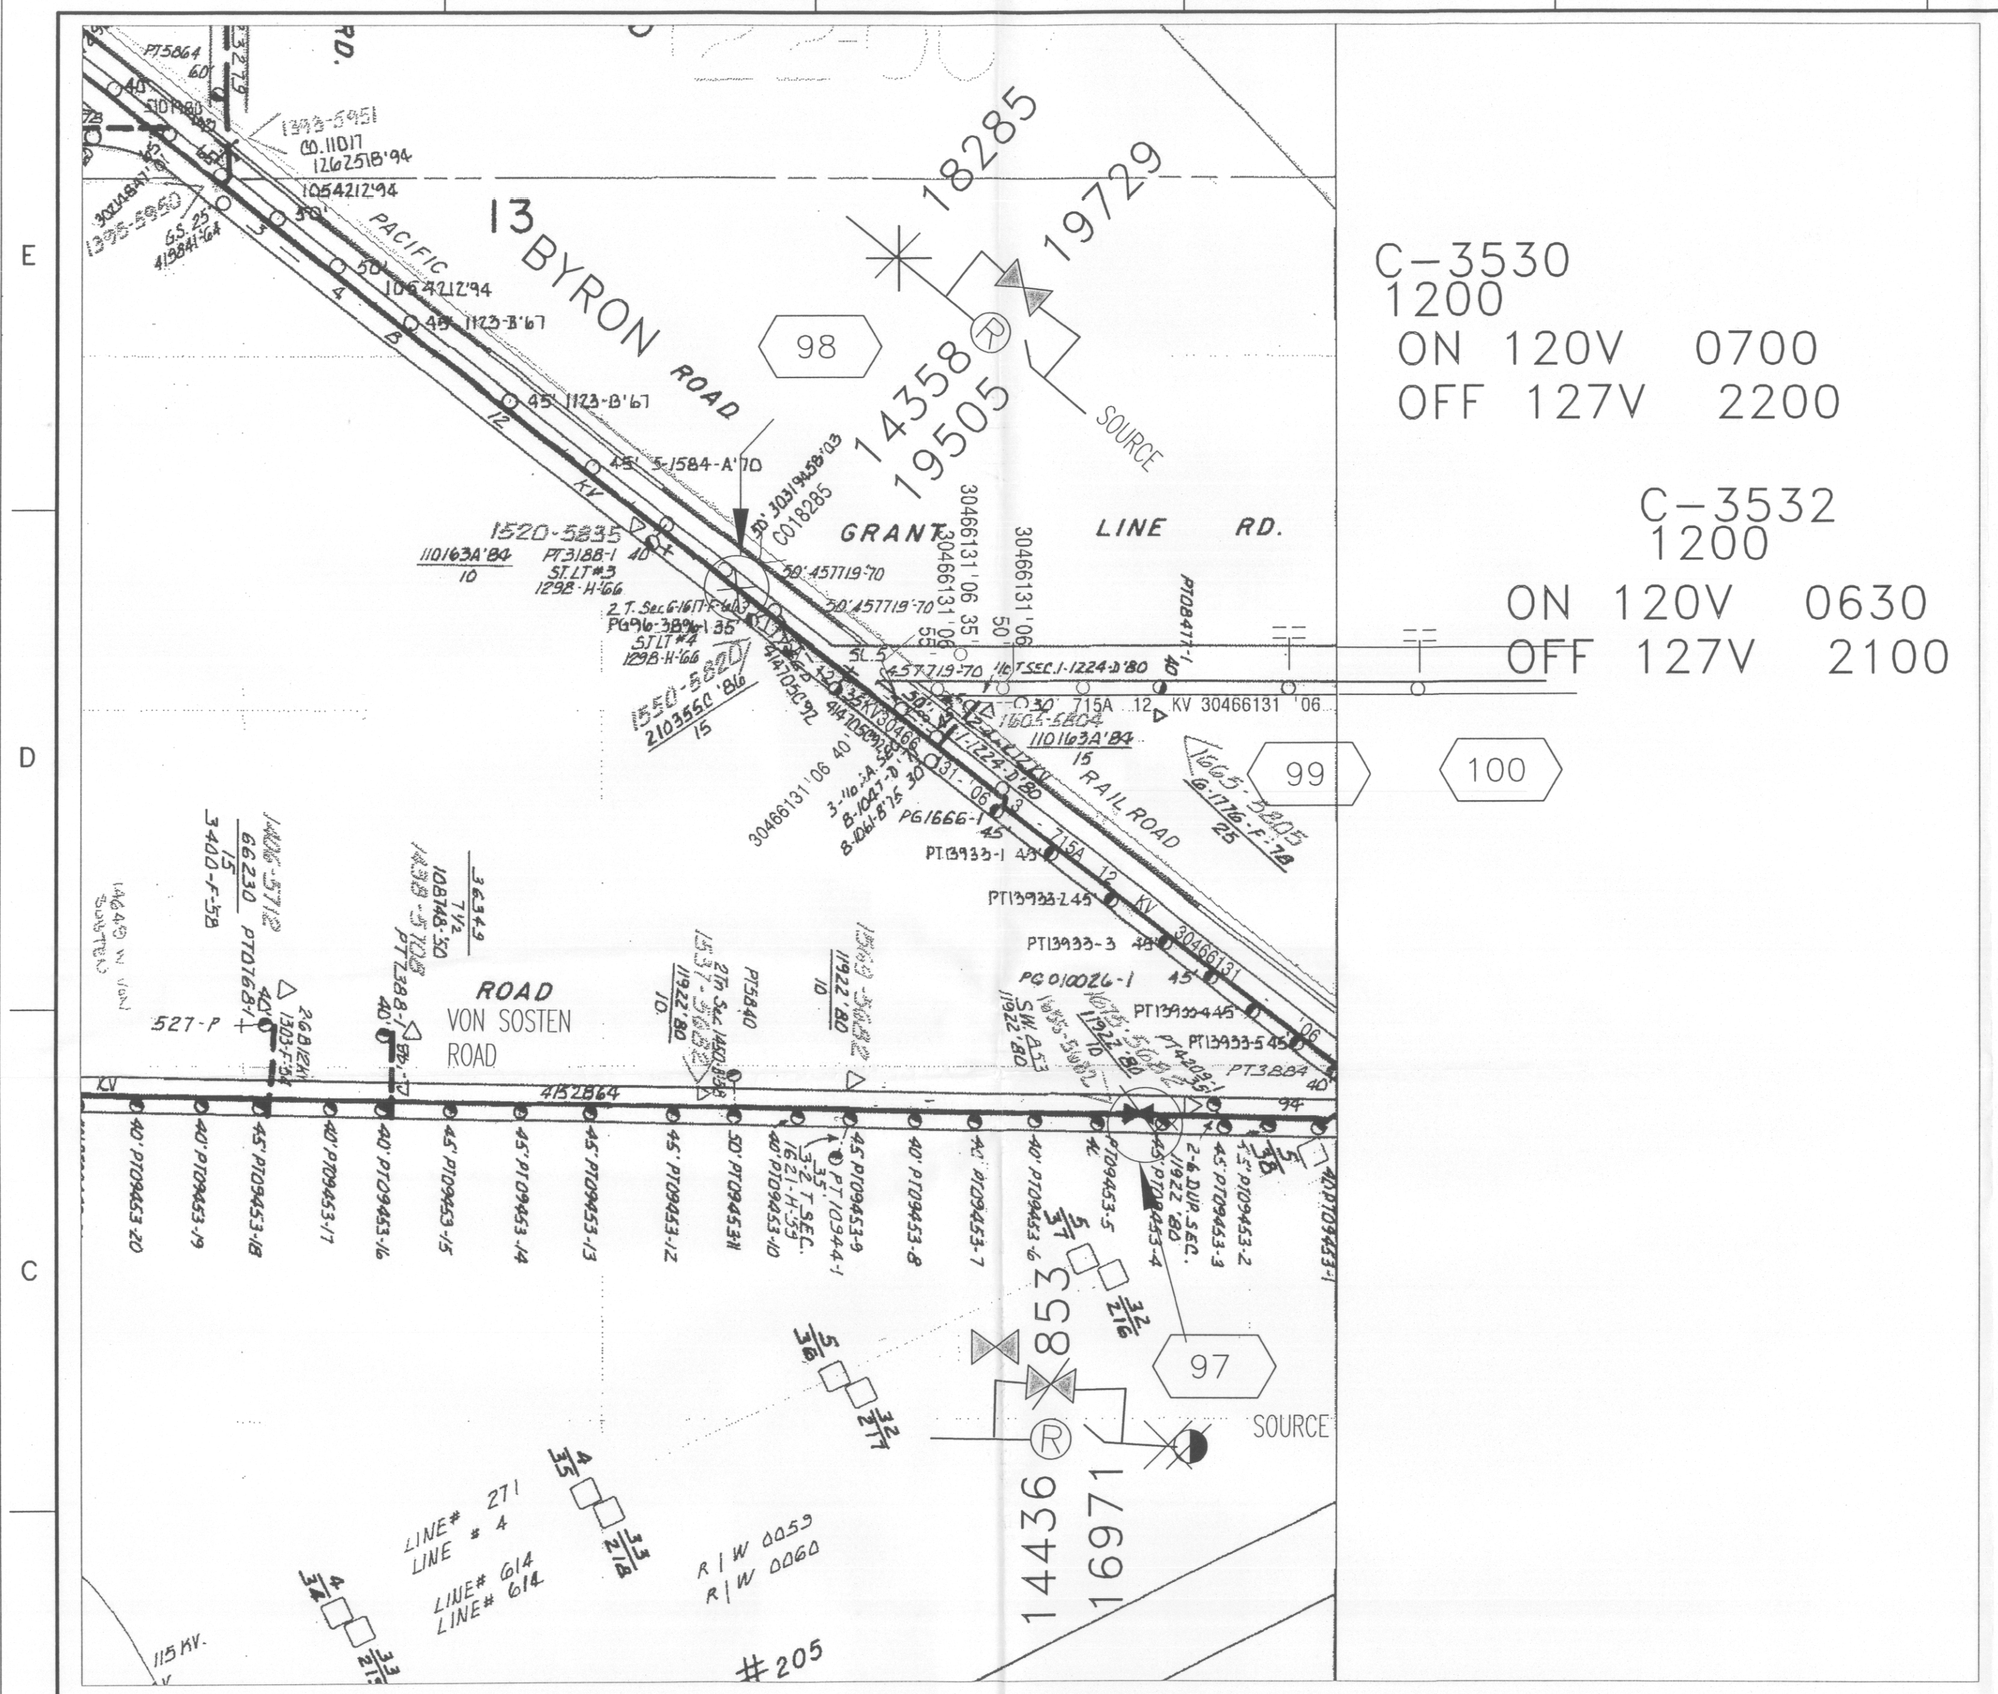

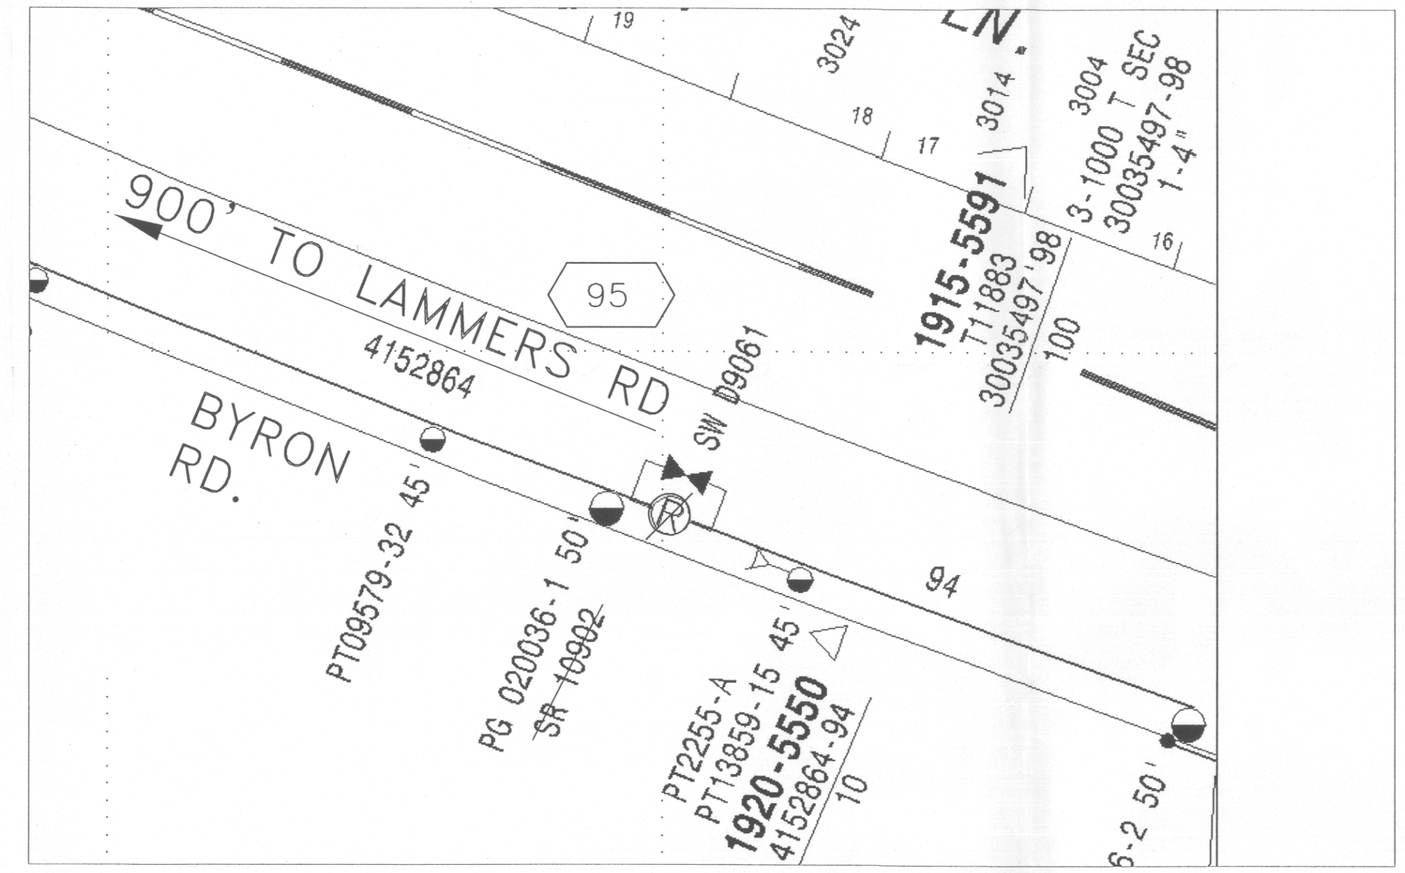

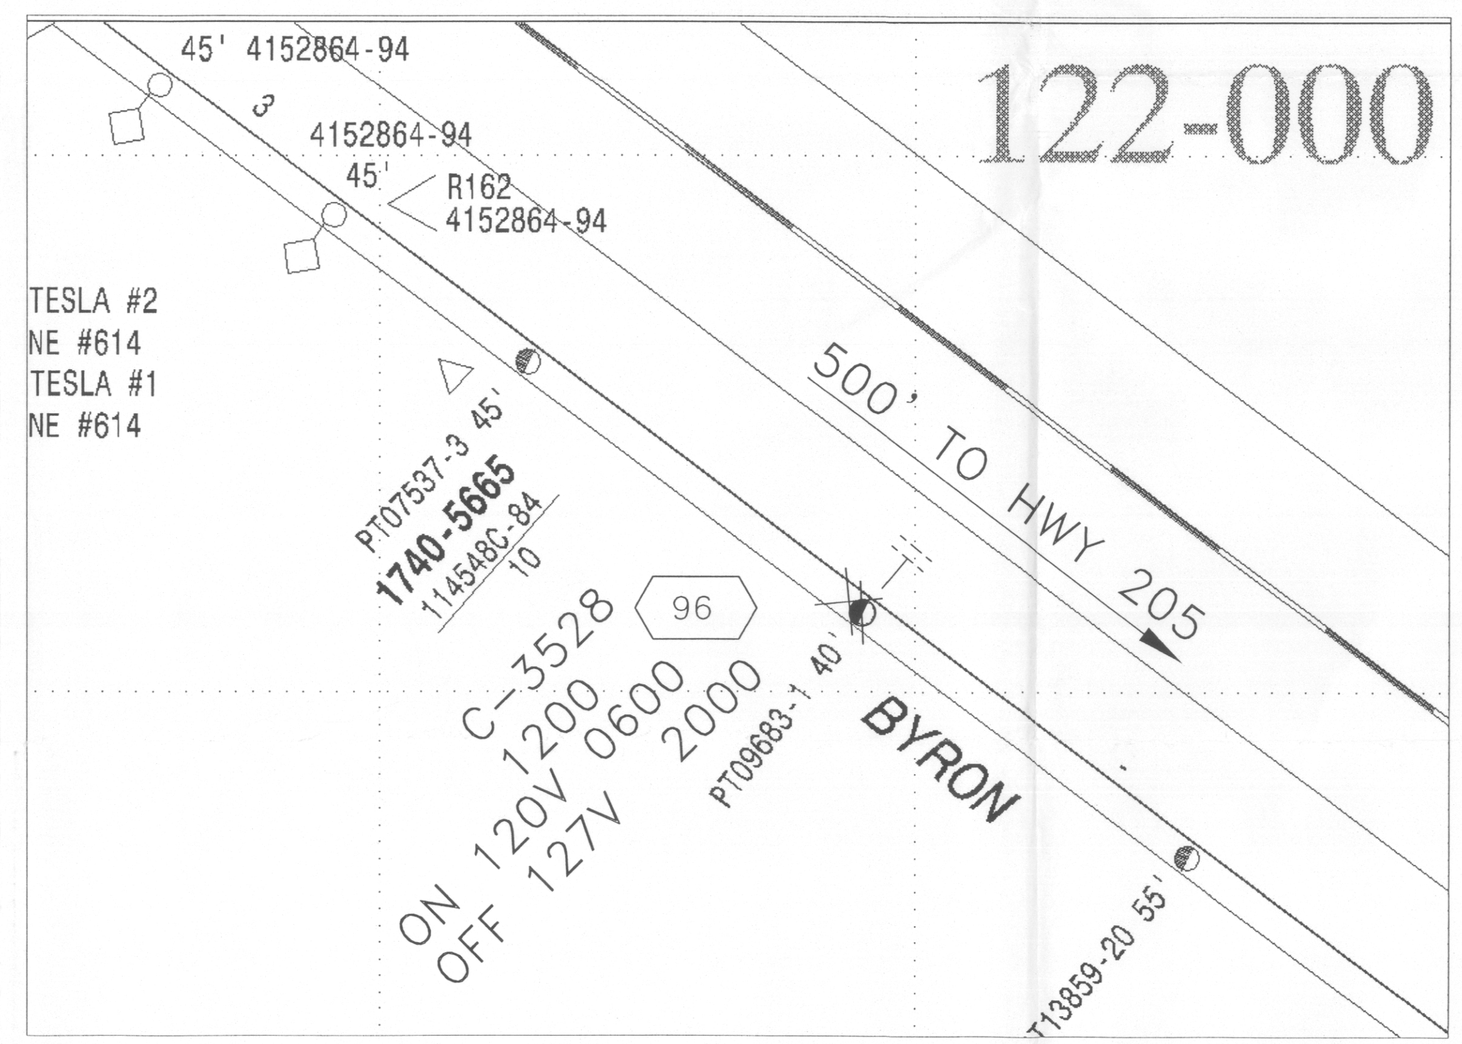

Z-5
Z-6-6
12KV

PROPOSED WORK

- INSTALL JOINT POLE.
- INSTALL 900A OH AIR SWITCH.
- INSTALL BYPASS DISCONNECTS.
- INSTALL 1200KVAR SWITCHED CAP BANK.
- INSTALL 12KV RECLOSER.
- REMOVE EXISTING OH AIR SWITCH.

NOTE: SET ALL NEW POLES 8' DEEP.

CO:	
SD:	
NOTIF.: 101884344	
Other:	
SHT: 7 of 7	SHEETS
PM: 30476912	REV.

ENGINEERING AND PLANNING DEPT.
850 STILLWATER RD.
W. SACRAMENTO, CA 95605
PHONE #:916-760-9868 FAX #:916-760-1983
PACIFIC GAS AND ELECTRIC COMPANY

EST: DAN PINGHAM
ADE: STEVEN DETRICK
SUPV: ARAM HADJIAN
REP: TOM WRAY
PLNR: DAN THOMAS
SCALE: 1"=100' DATE: 11-08-06

NO.	DATE	DESCRIPTION	ORDER #	DWN	CHKD	SUPV	APVD	BY
		REVISIONS						

INSTALL LAMMERS 1105 & 1107

LAMMERS SUBSTATION
TRACY

INCH 0 1

EP.07.32-7