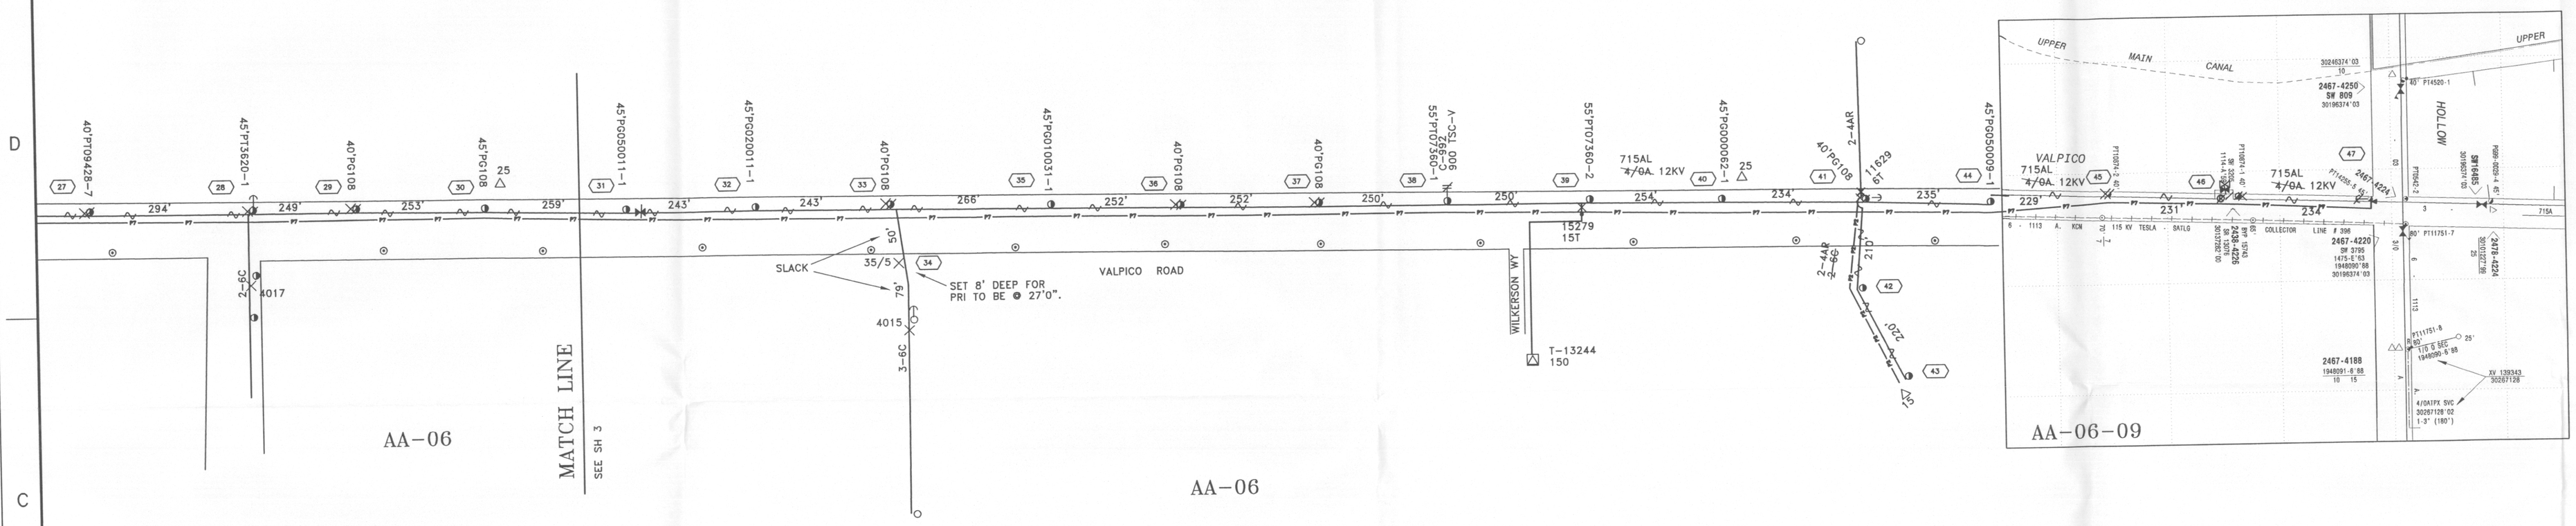

PROPOSED WORK

- INSTALL 1-6" PRIMARY SPARE CONDUIT.
- INSTALL 3-1100AL EPR-CONC-ENCAP 25KV CABLES IN 1-6" PRIMARY DUCT.
- INSTALL 2-4AR OH CONDUCTORS.
- INSTALL 3-1100AL EPR-CONC-ENCAP 25KV CABLES IN 1-6" EXISTING PRIMARY DUCT.
- INSTALL 3-715AL OH CONDUCTORS.
- INSTALL 1/0 ACSR TPX OH CONDUCTOR.
- INSTALL POLE, SEE LOCATION FOR TYPE.
- INSTALL 900A OH AIR SWITCH.
- INSTALL 4'6"X8'6"X6'D FVT SPLICE BOX.
- INSTALL PG ONLY DOWN GUY AND ANCHOR..
- INSTALL 25KVA 12KV OH TRANSFORMER.
- INSTALL 600A 3-WAY 3-WAYS SWITCHED SS SWITCH.
- INSTALL FUSED CUTOUTS.
- REMOVE EXISTING OH AIR SWITCH.
- REMOVE EXISTING OH RECLOSER.
- REMOVE EXISTING OH CAP BANK.
- REMOVE EXISTING OH TRANSFORMER.
- REMOVE EXISTING , ALLL SIZES, OH CONDUCTORS.
- TOP AND OR REMOVE ABANDON EXISTING JOINT POLE TO AT&T.

NOTE: SET ALL NEW POLES 8' DEEP.

CO:
SD:
NOTIF.: 10188344
Other:
SHT: 3 of 7 SHEETS
PM: 30476912 REV.

ENGINEERING AND PLANNING DEPT.
850 STILLWATER RD.
W. SACRAMENTO, CA 95605
PHONE #:916-760-1983 FAX #:916-760-9868
PG&E PACIFIC GAS AND ELECTRIC COMPANY

EST: DAN PINKHAM
ADE: STEVEN DETMCK
SUPV: ARAM HADJIAN
REP: TOM WRAY
PLNR: DAN THOMAS
SCALE: 1"=100' DATE: 11-08-06

NO.	DATE	DESCRIPTION	ORDER #	DWN	CHKD	SUPV	APVD BY

REVISIONS

INSTALL LAMMERS 1105 & 1107
LAMMERS SUBSTATION
TRACY

FP.07.32-3