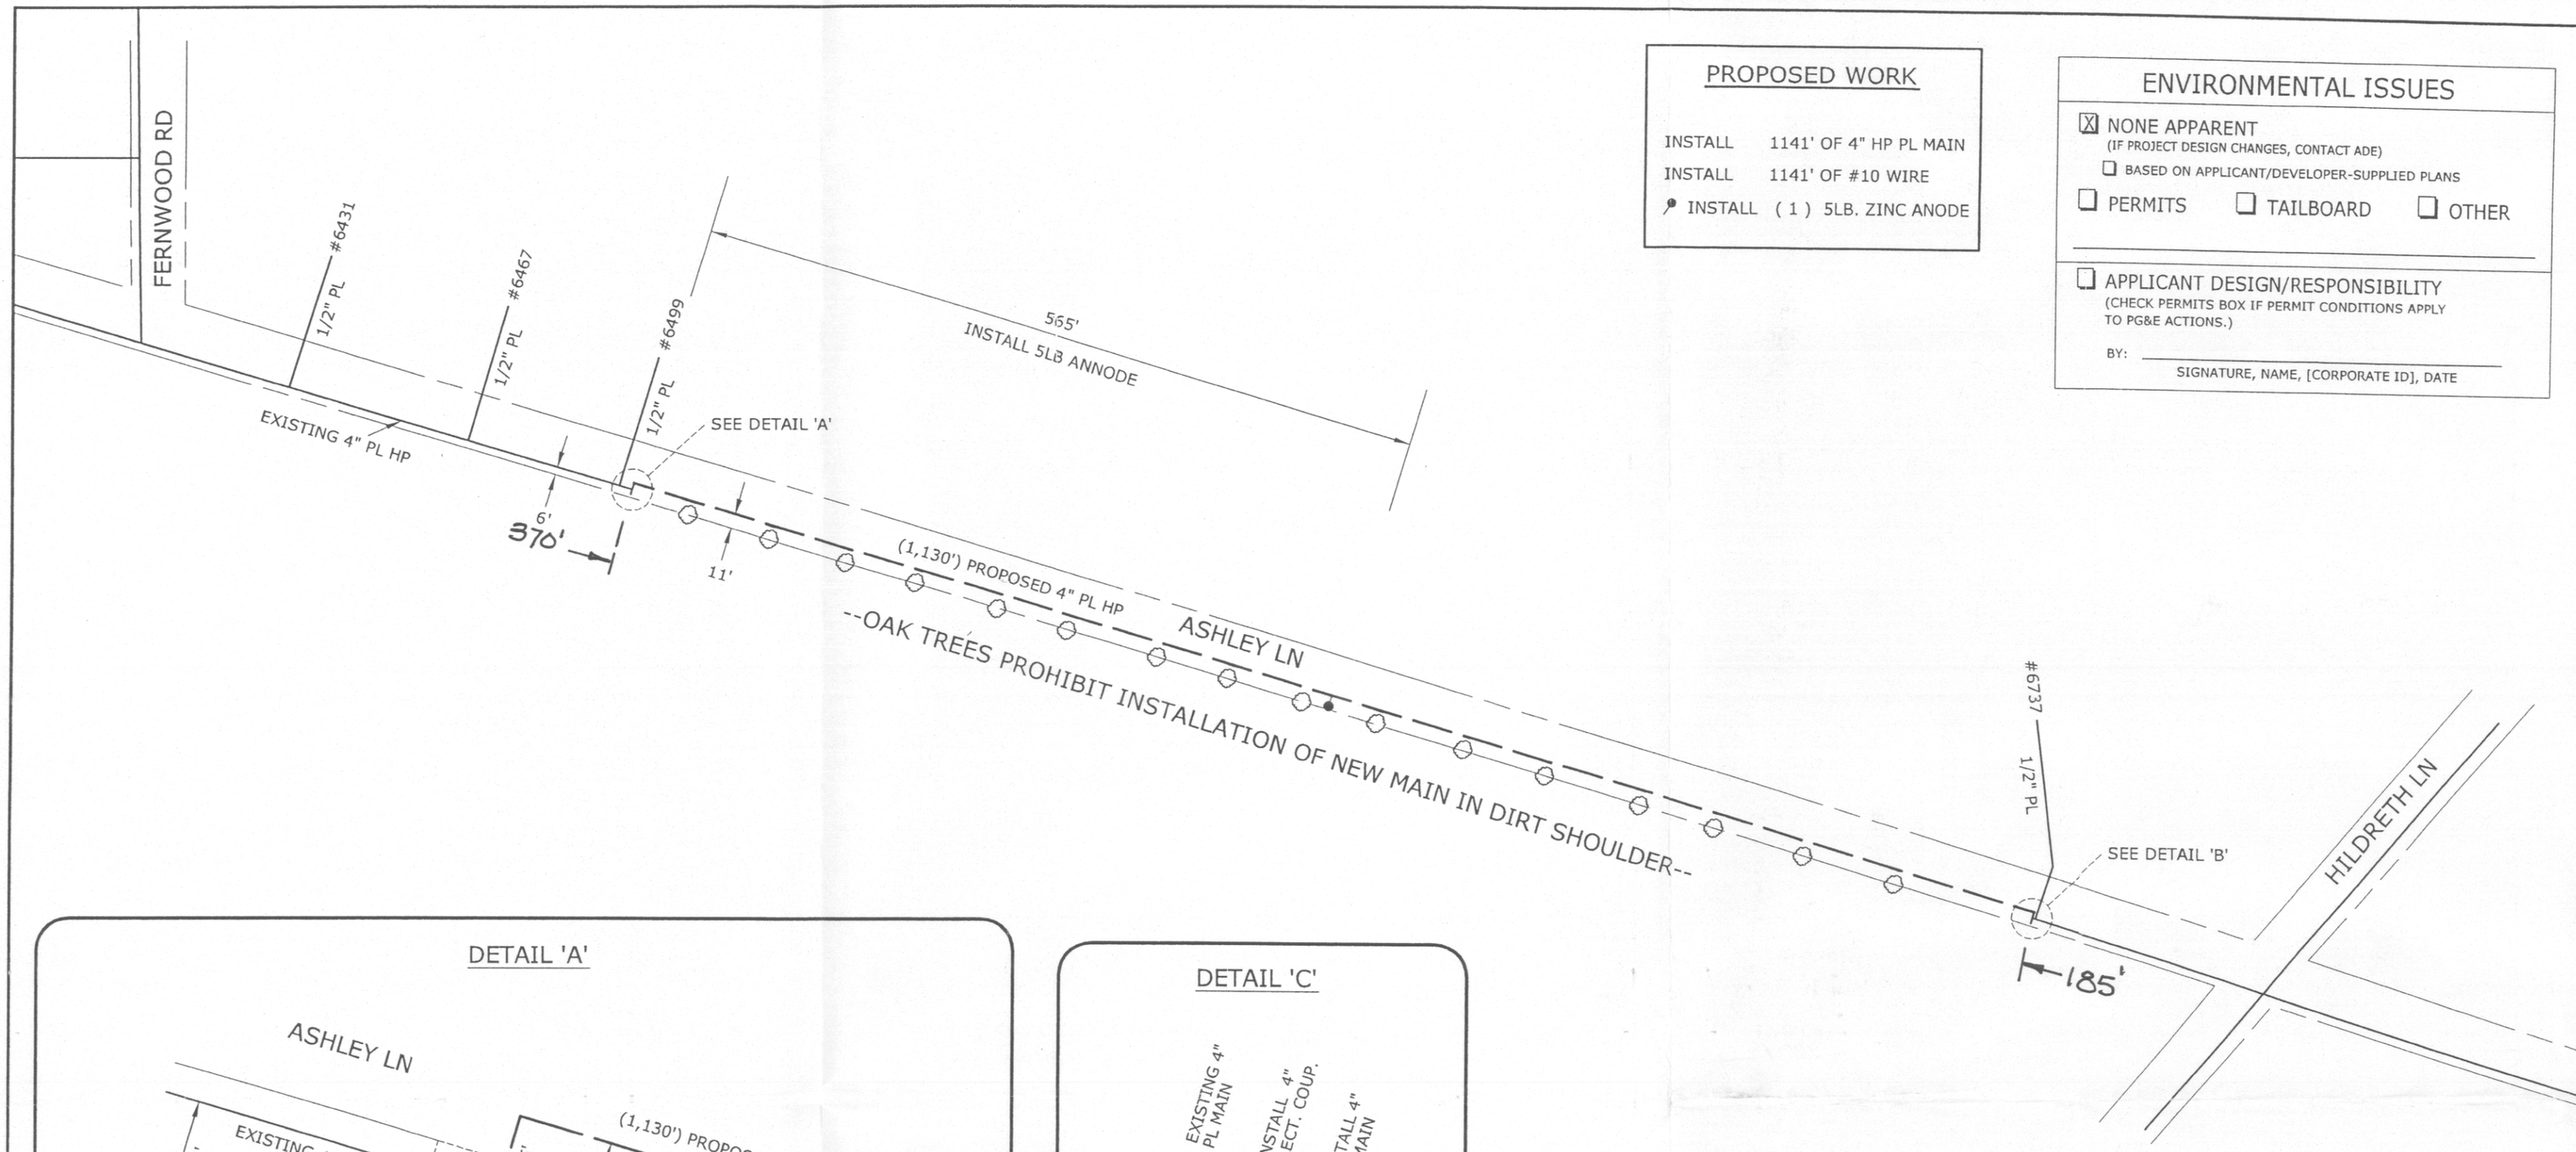

PROPOSED WORK

INSTALL 1141' OF 4" HP PL MAIN
INSTALL 1141' OF #10 WIRE
INSTALL (1) 5LB. ZINC ANODE

ENVIRONMENTAL ISSUES

☒ NONE APPARENT
(IF PROJECT DESIGN CHANGES, CONTACT ADE)
☐ BASED ON APPLICANT/DEVELOPER-SUPPLIED PLANS
☐ PERMITS ☐ TAILBOARD ☐ OTHER

☐ APPLICANT DESIGN/RESPONSIBILITY
(CHECK PERMITS BOX IF PERMIT CONDITIONS APPLY TO PG&E ACTIONS.)
BY: _____
SIGNATURE, NAME, [CORPORATE ID], DATE

DETAIL 'A'

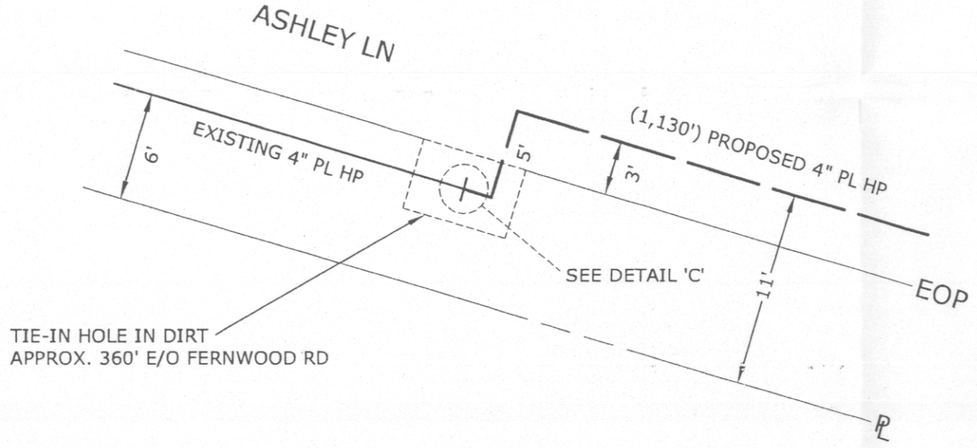

DETAIL 'C'

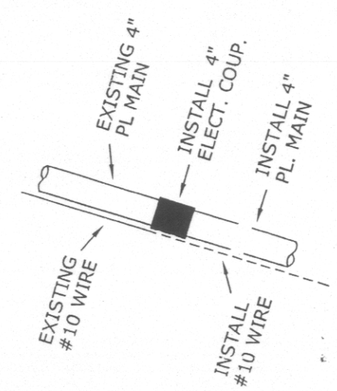

DETAIL 'B'

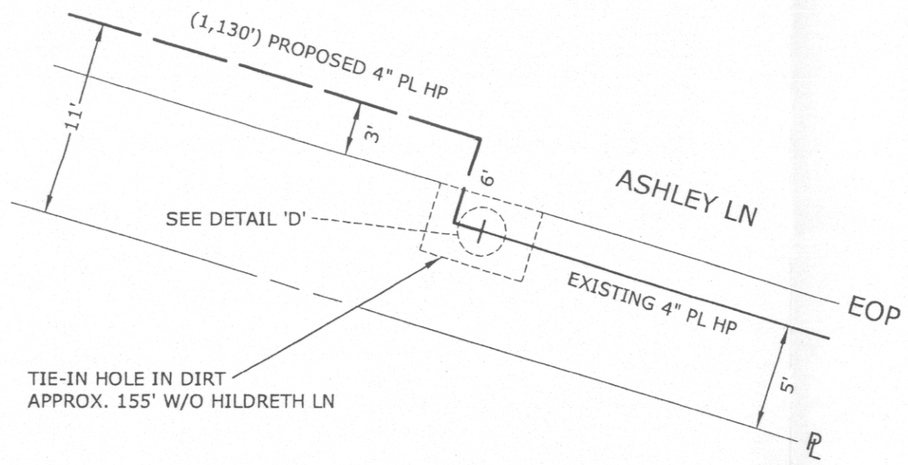

DETAIL 'D'

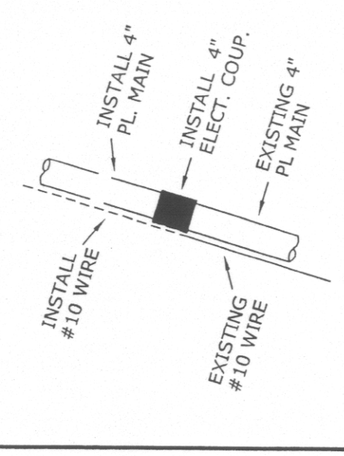

TEST AT 100-110 PSI FOR MINIMUM OF 5 MIN.			
PRESSURE	DURATION	INITIALS	DATE OF TEST
PLASTIC PIPE DATA			
SIZE	MANUFACTURED	DATE OF MANUFACTURE	

GAS JOB COMPLETED

DATE: _____
BY: _____
FOREMAN

NOTIFIED U.S.A.

DATE:
TICKET #
BY:

Underground Service Alert
Call: TOLL FREE
1-800-227-2600
TWO WORKING DAYS BEFORE YOU DIG

PLATS: 2947E7 & 2947E8

CO:
SD:
NOTIF.: 102222044
Other:
SHT: 1 of 1 SHEETS
PM: 30540809 REV.

ENGINEERING AND PLANNING DEPT.
4101 Wible Rd
Bakersfield, CA 93313
PHONE #: FAX #:
PG&E PACIFIC GAS AND ELECTRIC COMPANY

EST: Gabe Ruiz
ADE: Scott Guerrero
SUPV: Albert Woo
REP: Dave Rymers
PLNR:
SCALE: 1"=100'
DATE: 02/27/07

PG&E
PG&E
Ashley from Hildredth to Fernwood
Stockton

07-120-1