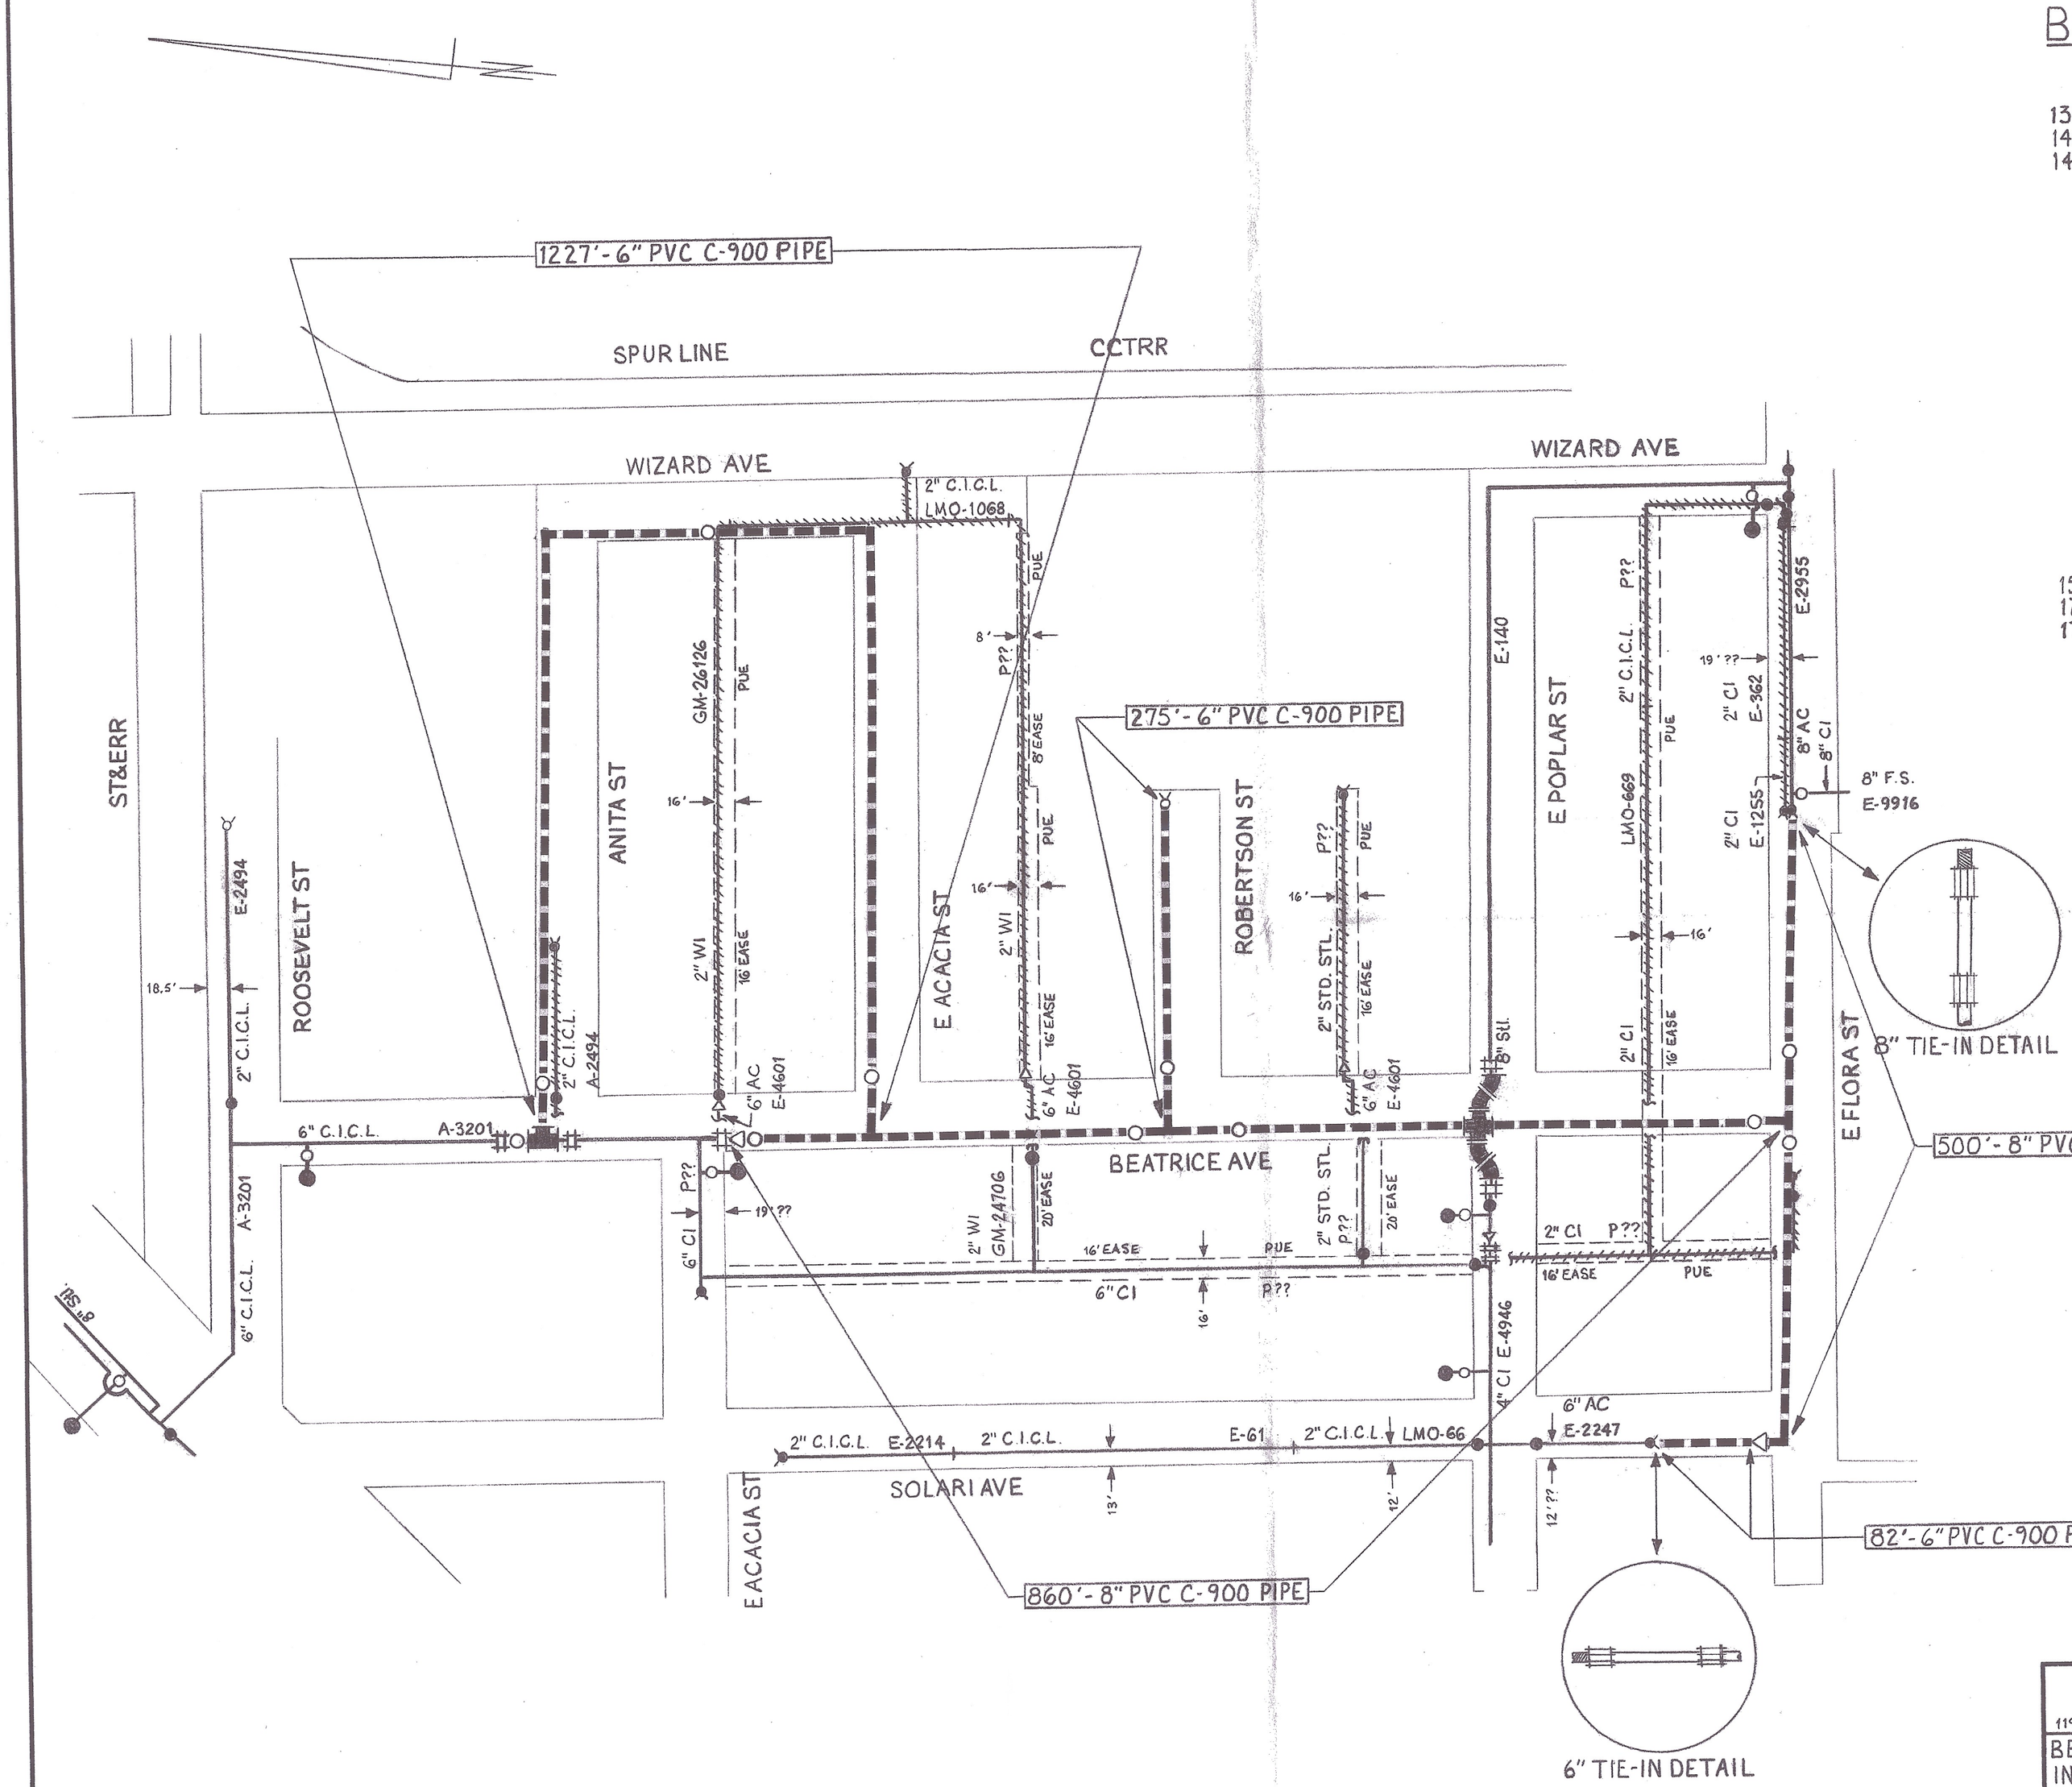


# BILL OF MATERIALS

## 8" MAIN

1360' - 8" PVC C-900 PIPE
1496' - LINEGUARD TAPE
1496' - TRACER WIRE #12 AWG SOLID COPPER
6 - 8" GATE VALVE PO
6 - VALVE CASING & COVER ASSY.
1 - 8" CROSS PO
1 - 8" TEE PO
2 - 8" X 6" TEE PO
1 - 8" ELL 90° PO
2 - 8" X 6" REDUCER PO
4 - 8" ELL 45° PO
8 - 8" FIELD LOK GASKET
2 - 8" O.D. STEEL X D.I. FLEX. CPLG.
2 - 8" ACME X D.I. FLEX. CPLG.
18' - 8" D.I. PIPE (FOR TIE-INS)
47 - 8" X 1" CC SADDLE

## 6" MAIN

1584' - 6" PVC C-900 PIPE
1742' - LINEGUARD TAPE
1742' - TRACER WIRE #12 AWG SOLID COPPER
5 - 6" GATE VALVE PO
1 - 2" BLOWOFF ASSY.
6 - VALVE CASING & COVER ASSY.
1 - 6" TEE PO
2 - 6" ELL 90° PO
3 - 6" AC/CI X DI FLEX. CPLG.
38 - 6" X 1" CC SADDLE

## ABANDONMENT MATERIAL

2 - 4" AC/CI X D.I. FLEX. CPLG.
3' - 4" PVC C-900 PIPE
2 - 2" CAP MJ

**CALIFORNIA WATER SERVICE CO.**
ENGINEERING DEPARTMENT

119 - STOCKTON DISTRICT

BEATRICE AVE.-ACACIA TO FLORA
INSTALL 1360' OF 8" AND 1584' OF 6" PVC C-900
RETIRE: 2690'-STL. OTHER; 150'-2" C.I. & 85'-6" AC

| DRAWN BY | DATE | APPROVED BY |
|---|---|---|
| B. DAHLEN | 9/5/07 | |
| TRACED BY | | PROJECT NO. 00011403 |
| CHECKED BY | SCALE 1" = 100' | DWG. NO. |

E6.01.331