EP.08.0763

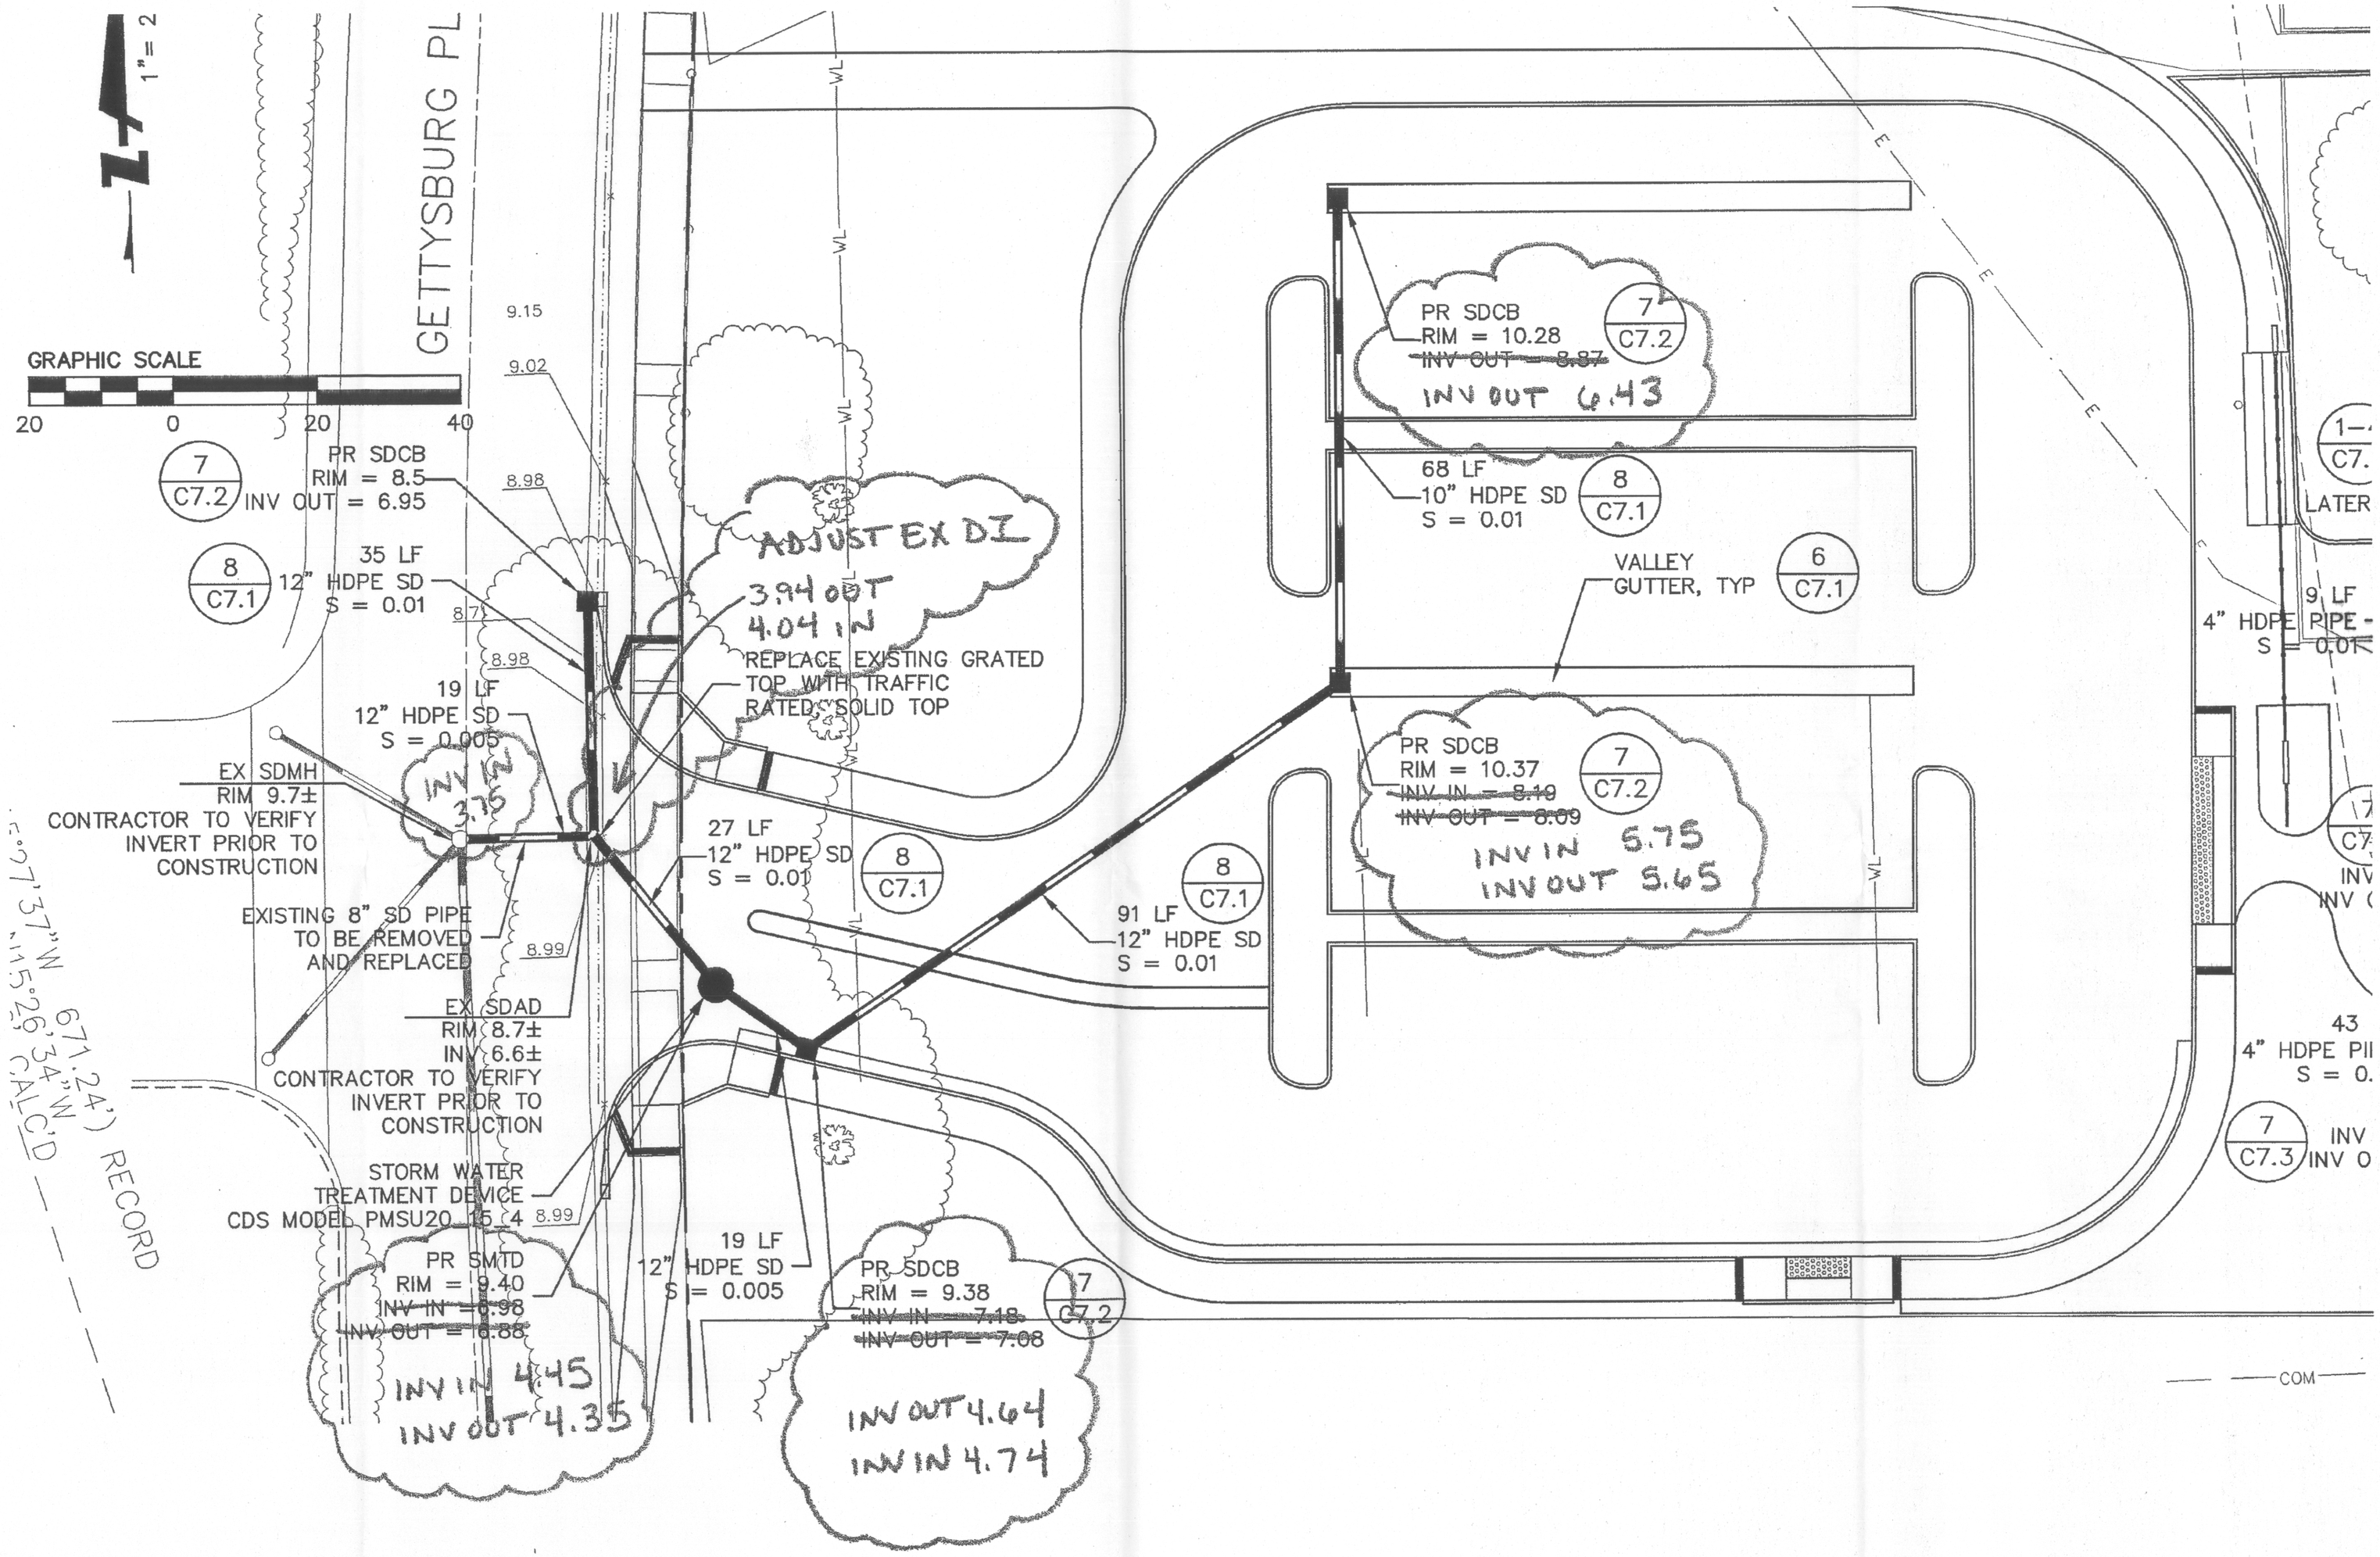

UTILITIES NOTES:

1. CONTRACTOR SHALL PROVIDE A MINIMUM OF TWELVE INCHES OF VERTICAL CLEARANCE AT ALL UTILITY PIPE CROSSINGS UNLESS OTHERWISE NOTED.