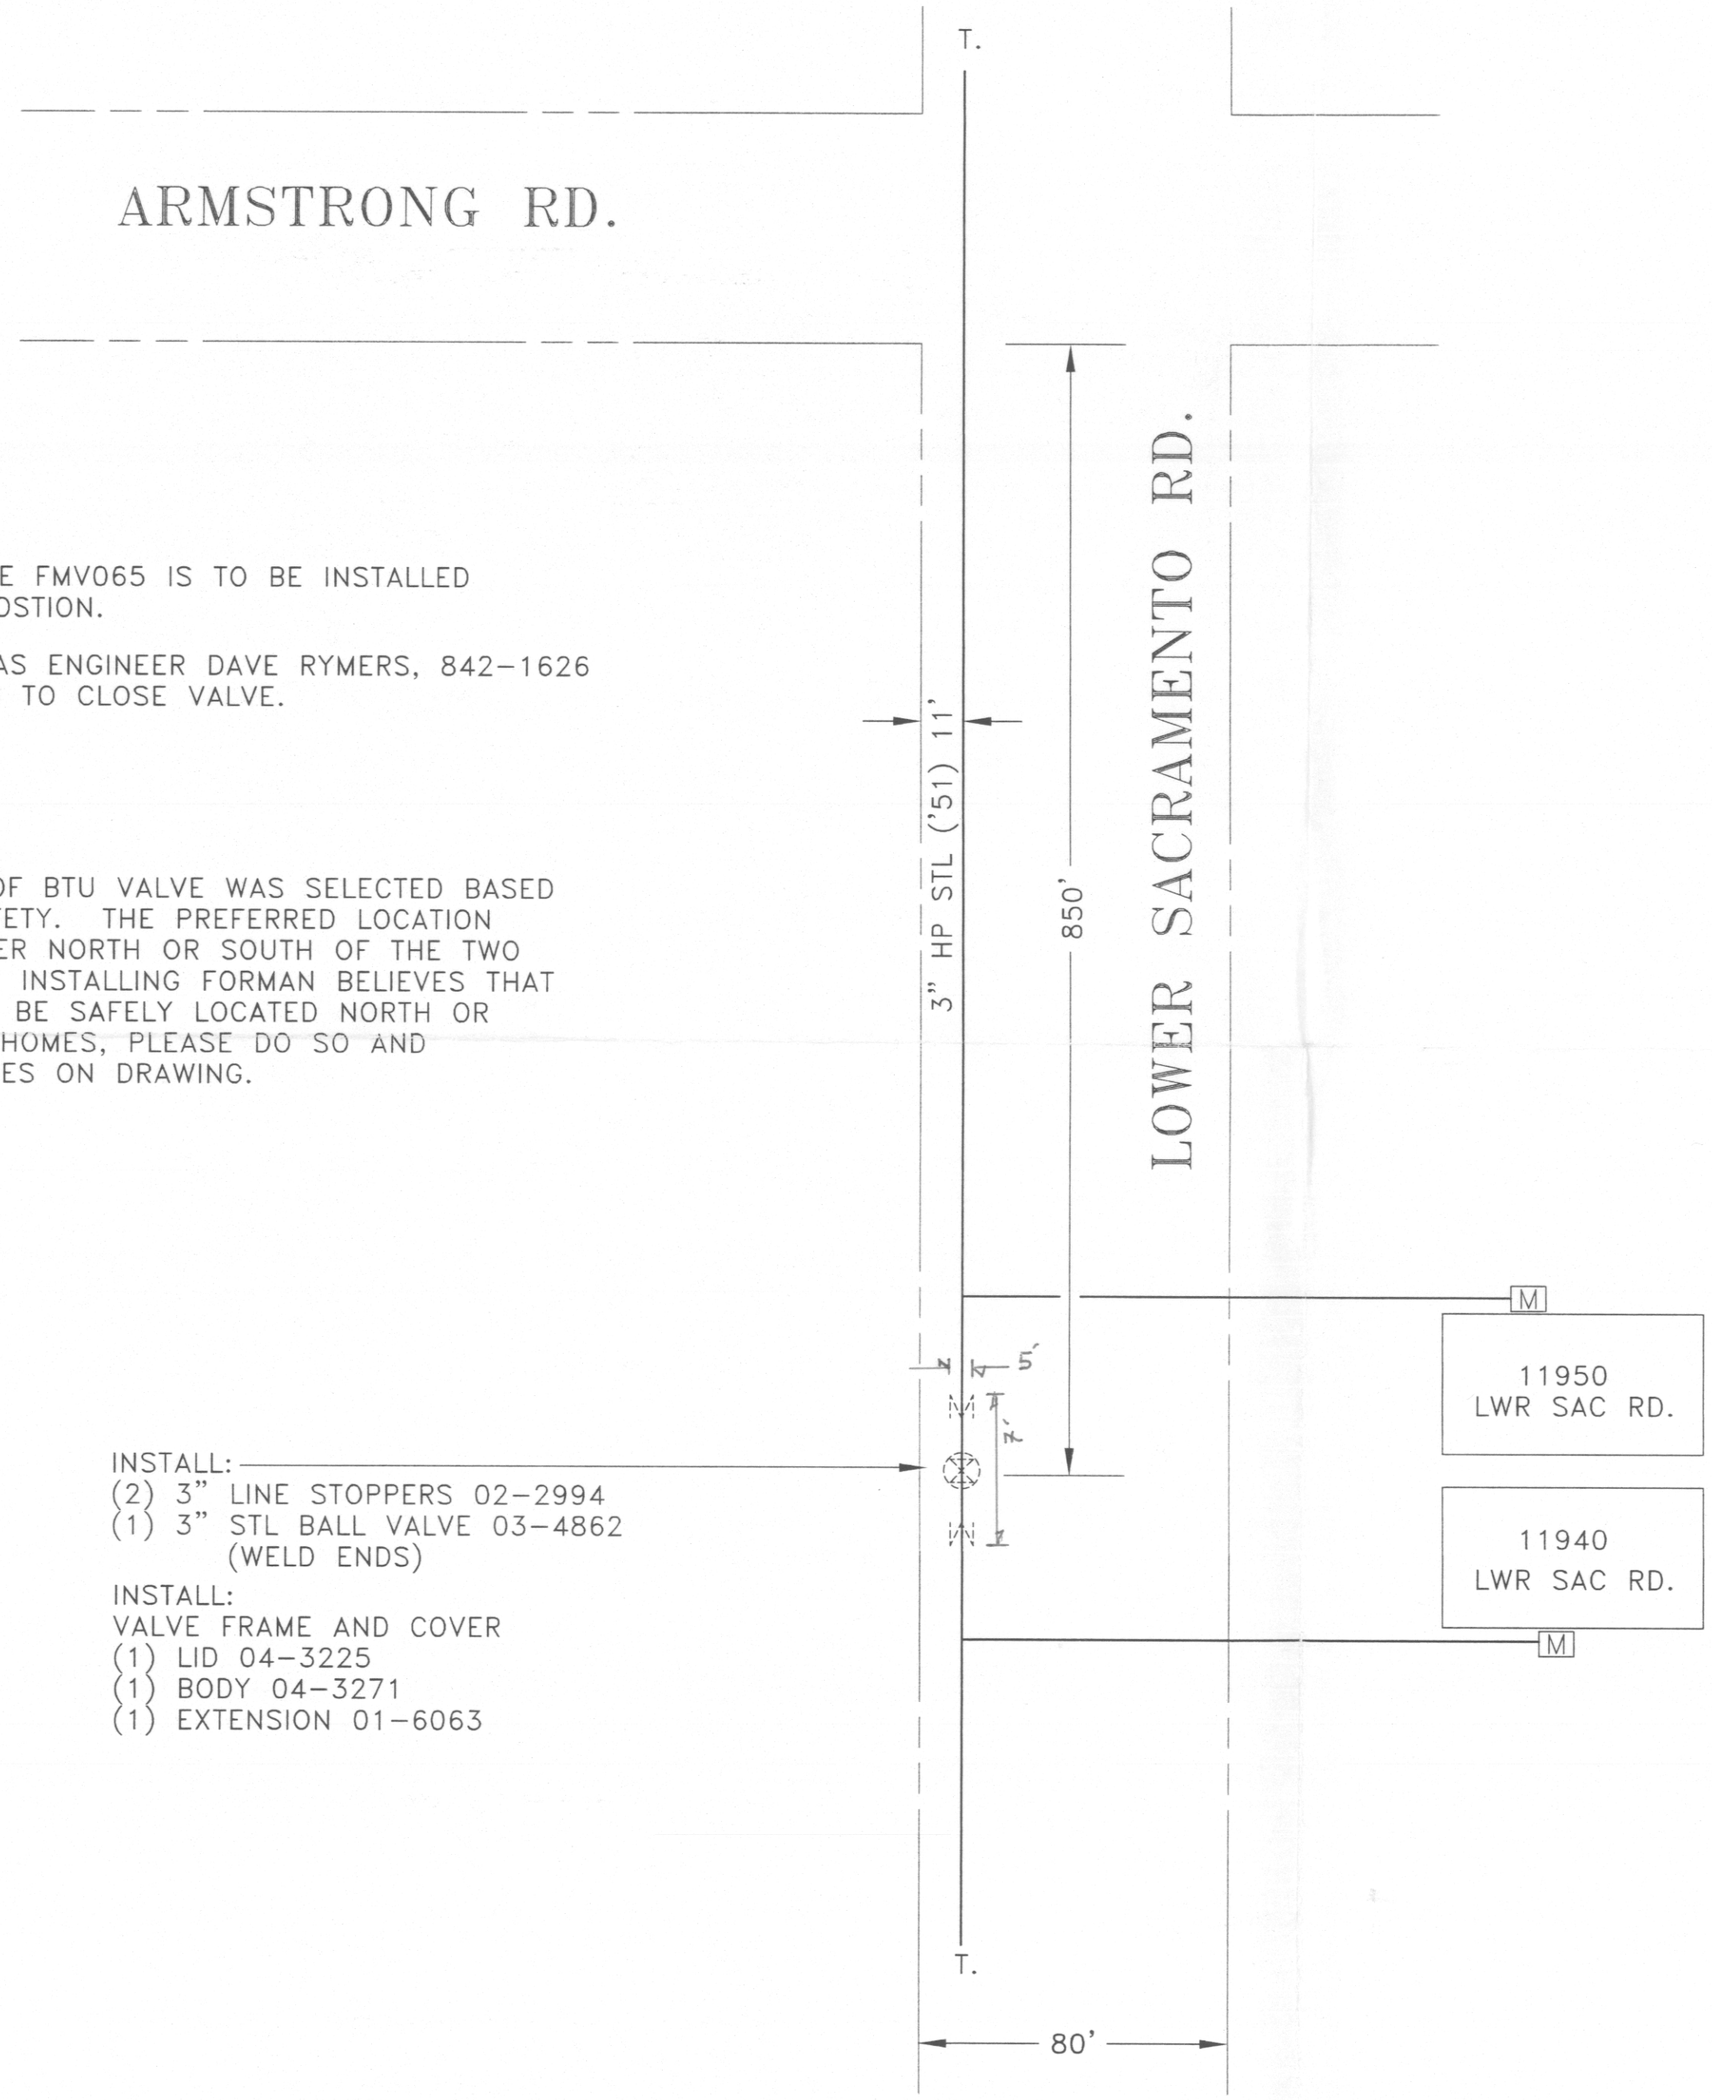

NOTE:
BTU ZONE VALVE FMV065 IS TO BE INSTALLED IN THE OPEN POSTION.

CONTACT SR. GAS ENGINEER DAVE RYMERS, 842-1626 FOR PERMISSION TO CLOSE VALVE.

NOTE:
THE LOCATION OF BTU VALVE WAS SELECTED BASED ON TRAFFIC SAFETY. THE PREFERRED LOCATION WOULD BE EITHER NORTH OR SOUTH OF THE TWO HOMES. IF THE INSTALLING FORMAN BELIEVES THAT THE VALVE CAN BE SAFELY LOCATED NORTH OR SOUTH OF THE HOMES, PLEASE DO SO AND INDICATE CHANGES ON DRAWING.

INSTALL:
(2) 3" LINE STOPPERS 02-2994
(1) 3" STL BALL VALVE 03-4862
(WELD ENDS)

INSTALL:
VALVE FRAME AND COVER
(1) LID 04-3225
(1) BODY 04-3271
(1) EXTENSION 01-6063

LEGEND

- EXISTING GAS MAIN
- EXISTING GAS SERVICE
- M EXISTING GAS METER
- 3" LINE STOPPER
- 3" BALL VALVE

Cathodic Protection Levels Inspected as Noted on Drawing on Existing Protected Steel. All Levels Satisfactory per PG&E GS&S O-16

Qualified Employee _____ Date _____

ATTENTION FOREMAN
PRIOR TO STARTING JOB, CONSULT AREA CORROSION MECHANIC FOR LOCATING WIRE INSTALLATION AND CATHODIC PROTECTION REQUIREMENTS.
ROGER MORSEHEAD 842-6555

WELDING INSPECTION
PER PG&E GAS STD D-40

BY: _____
INSPECTOR

PLEASE CALL U.S.A. AT
LEAST 48 HOURS PRIOR TO
EXCAVATING IN THIS AREA

1-800-227-2600

TICKET # _____

DATE CALLED _____

N

MAP: 2869-J6
CPA: 286902
MAOP: 60 PSIG
E.S.ZONE: 16-ST-11-B

CO:
SD:
NOTIF.: 102643312
Other:
SHT: SHEETS
PM: 306161377
REV.

EP.08.813

ENGINEERING AND PLANNING DEPT.
404 WEST LANE
STOCKTON, CA 9204
PHONE #:(209) 942-1498 FAX #:(209) 942-1768
PG&E PACIFIC GAS AND ELECTRIC COMPANY

EST: JG HOUBEIN
ADE: RD GIBBS
SUPV: MM LANG
REP: DC RYMERS
PLNR: DC RYMERS
SCALE: 1"=40'
DATE: 3/8/08

INSTALL B.T.U. VALVE, FMV065

W/S LOWER SACRAMENTO RD.
850' S/O ARMSTRONG RD.
LODI UNINC. - S.J. COUNTY