PS 08:3137

LEGEND

EXISTING	INSTALL	
———	— — —	GAS MAIN
———	- - - - - - - -	GAS SERVICE
M	M	MUELLER PCF
D	D	MAIN CAP
●	●	ANODE
E	E	ELECTROLYSIS TEST STATION
▼	▼	REDUCER COUPLING
	H	IN-LINE TEE
	EM	ELECTRONIC MARKER

WORK RECAP -- FOREMANS NOTES

INSTALL 170' OF 4" HPPL MAIN
TRANSFER (1) 1" HPPL SVC. MAIN
DEACTIVATE 170' OF 4" HPPL MAIN
SHUTDOWN & RELIGHT 1 CUSTOMER
INSTALL ANODES CP AREA 286902
PERMITS REQUIRED SAN JOAQUIN COUNTY
SOIL DISPOSAL: HAUL X SPREAD AT SITE
SELECT IMPORT: YES A.C.PAVING YES
CONCRETE YES

NOTES ON CATHODIC PROTECTION

IN ORDER TO MAINTAIN CATHODIC PROTECTION (1) #4 STRANDED COPPER WIRE MUST BE INSTALLED WITH THE 4" PLASTIC MAIN IN ADDITION TO THE STANDARD #10 LOCATING WIRE. FOREMAN MUST CONTACT LOCAL CORROSION DEPT. PERSONNEL TO ENSURE CATHODIC PROTECTION REQUIREMENTS ARE MET.

CATHODIC PROTECTION LEVELS INSPECTED AS NOTED ON DRAWING ON EXISTING PROTECTED STEEL. ALL LEVELS SATISFACTORY PER PG&E. GS&S 0-16

QUALIFIED EMPLOYEE DATE

ATTENTION FOREMAN

PRIOR TO STARTING JOB, CONSULT AREA CORROSION MECHANIC FOR LOCATING WIRE INSTALLATION AND CATHODIC PROTECTION REQUIREMENTS

Ed Mitchell (209)-406-7852
Bill Belaski (209)-406-7844

Welding Inspected per PG&E Gas Standard D-40
Visual ☐
Magnetic Particle ☐
Inspector
Date

4" PL. MAIN

PLASTIC PIPE INSPECTION/DATA

PIPE MANUFACTURER
DATE MANUFACTURED

1" PL SVC.

PLASTIC PIPE INSPECTION/DATA

PIPE MANUFACTURER
DATE MANUFACTURED

* TEST DATA STAMP *

ACTUAL TEST PRESSURE psig
DURATION OF TEST
DATE OF TEST

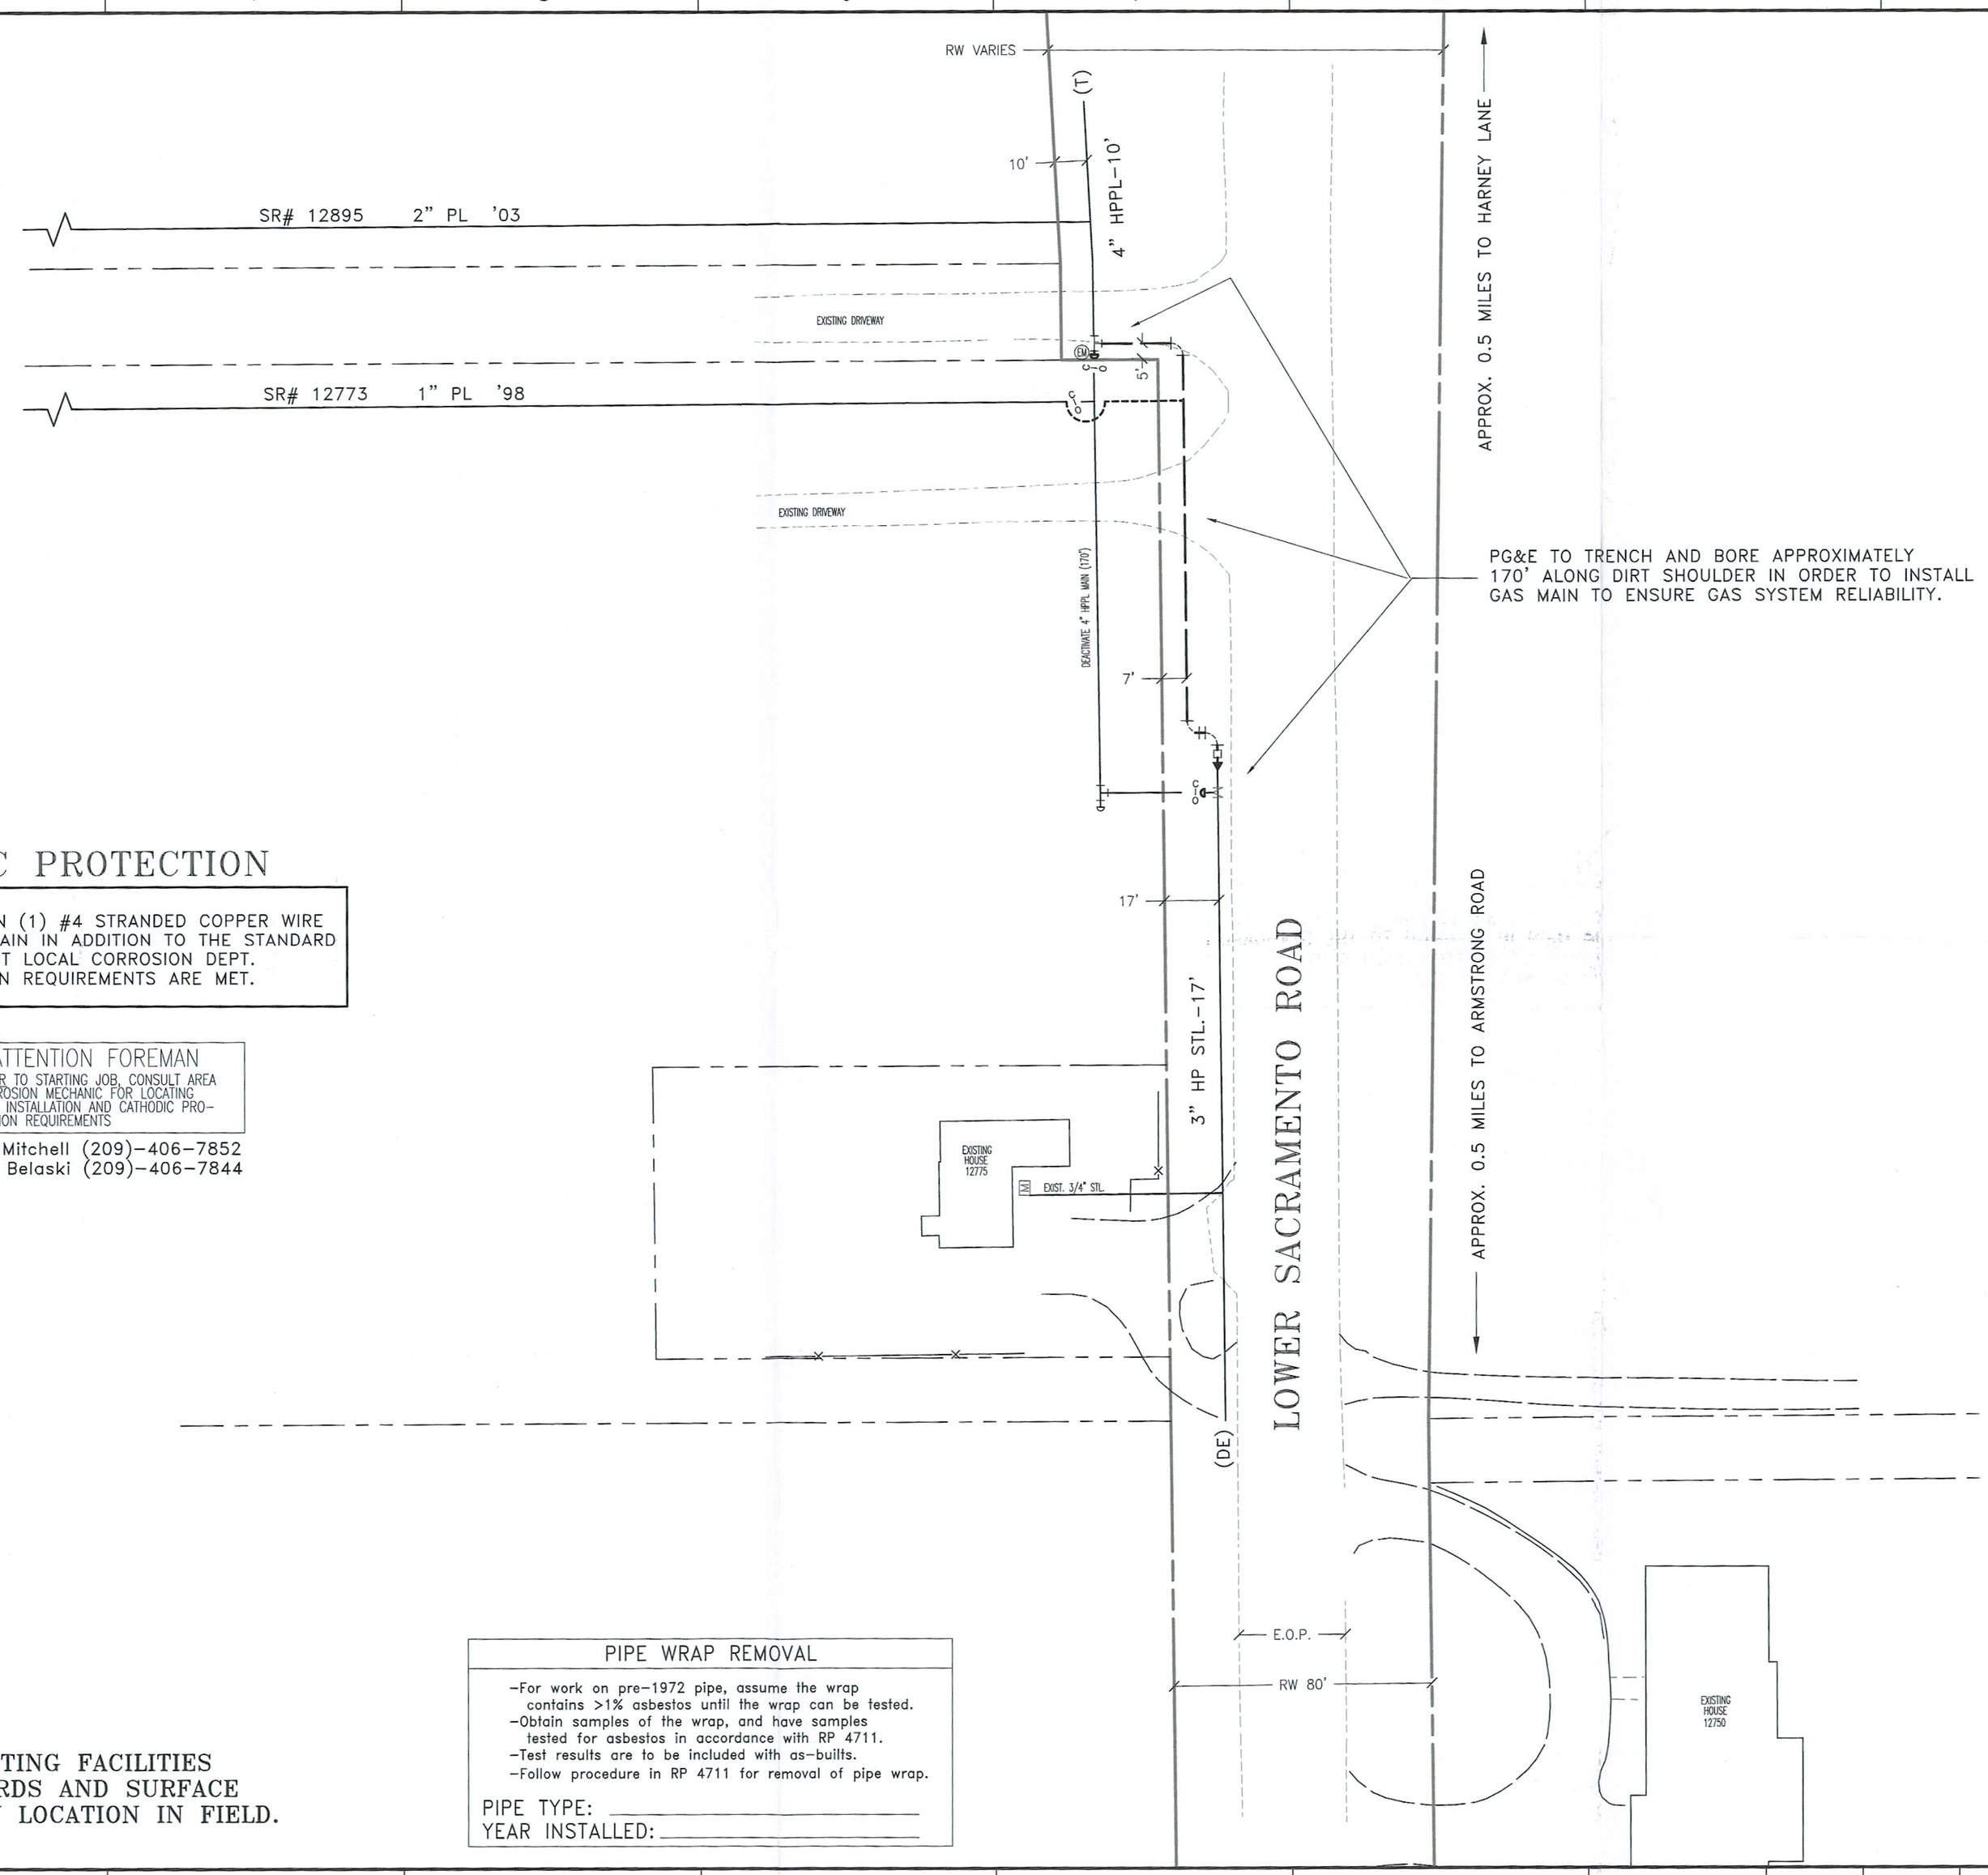

WALL MAP - 2869-I6
M.A.O.P. - 60 PSIG
CPA NUMBER - 286902
THERM BILLING AREA -X-05
EMERGENCY ZONE - 16-LO-01-B

CALL BEFORE YOU DIG UNDERGROUND SERVICE ALERT 800-227-2600

LOCATION OF EXISTING FACILITIES SHOWN PER RECORDS AND SURFACE MARKINGS. VERIFY LOCATION IN FIELD.

PIPE WRAP REMOVAL

-For work on pre-1972 pipe, assume the wrap contains >1% asbestos until the wrap can be tested.
-Obtain samples of the wrap, and have samples tested for asbestos in accordance with RP 4711.
-Test results are to be included with as-builts.
-Follow procedure in RP 4711 for removal of pipe wrap.

PIPE TYPE:
YEAR INSTALLED:

CO:
SD:
NOTIF.: 10159902
Other:
SHT: 1 OF 1 SHEETS
PM: 30643958 REV.

ENGINEERING AND PLANNING DEPT.
4040 WEST LANE
STOCKTON, CA. 95204
PHONE #: (209) 942-1564 FAX #: (209) 942-1737
PG&E PACIFIC GAS AND ELECTRIC COMPANY

EST: RMJ1 (1564)
ADE: RDGO (1429)
SUPV: MMJ1 (1489)
REP: DCR5 (1626)
PLNR: DCR5 (1626)
SCALE: 1"=30' DATE: 09/17/2008

NO.	DATE	DESCRIPTION	ORDER #	DWN	CHKD	SUPV	APVD BY

REVISIONS

RELOCATE 4" HPPL GAS MAIN
LOWER SACRAMENTO RD. S/O HARNEY LANE
STOCKTON DIV. - SAN JOAQUIN COUNTY