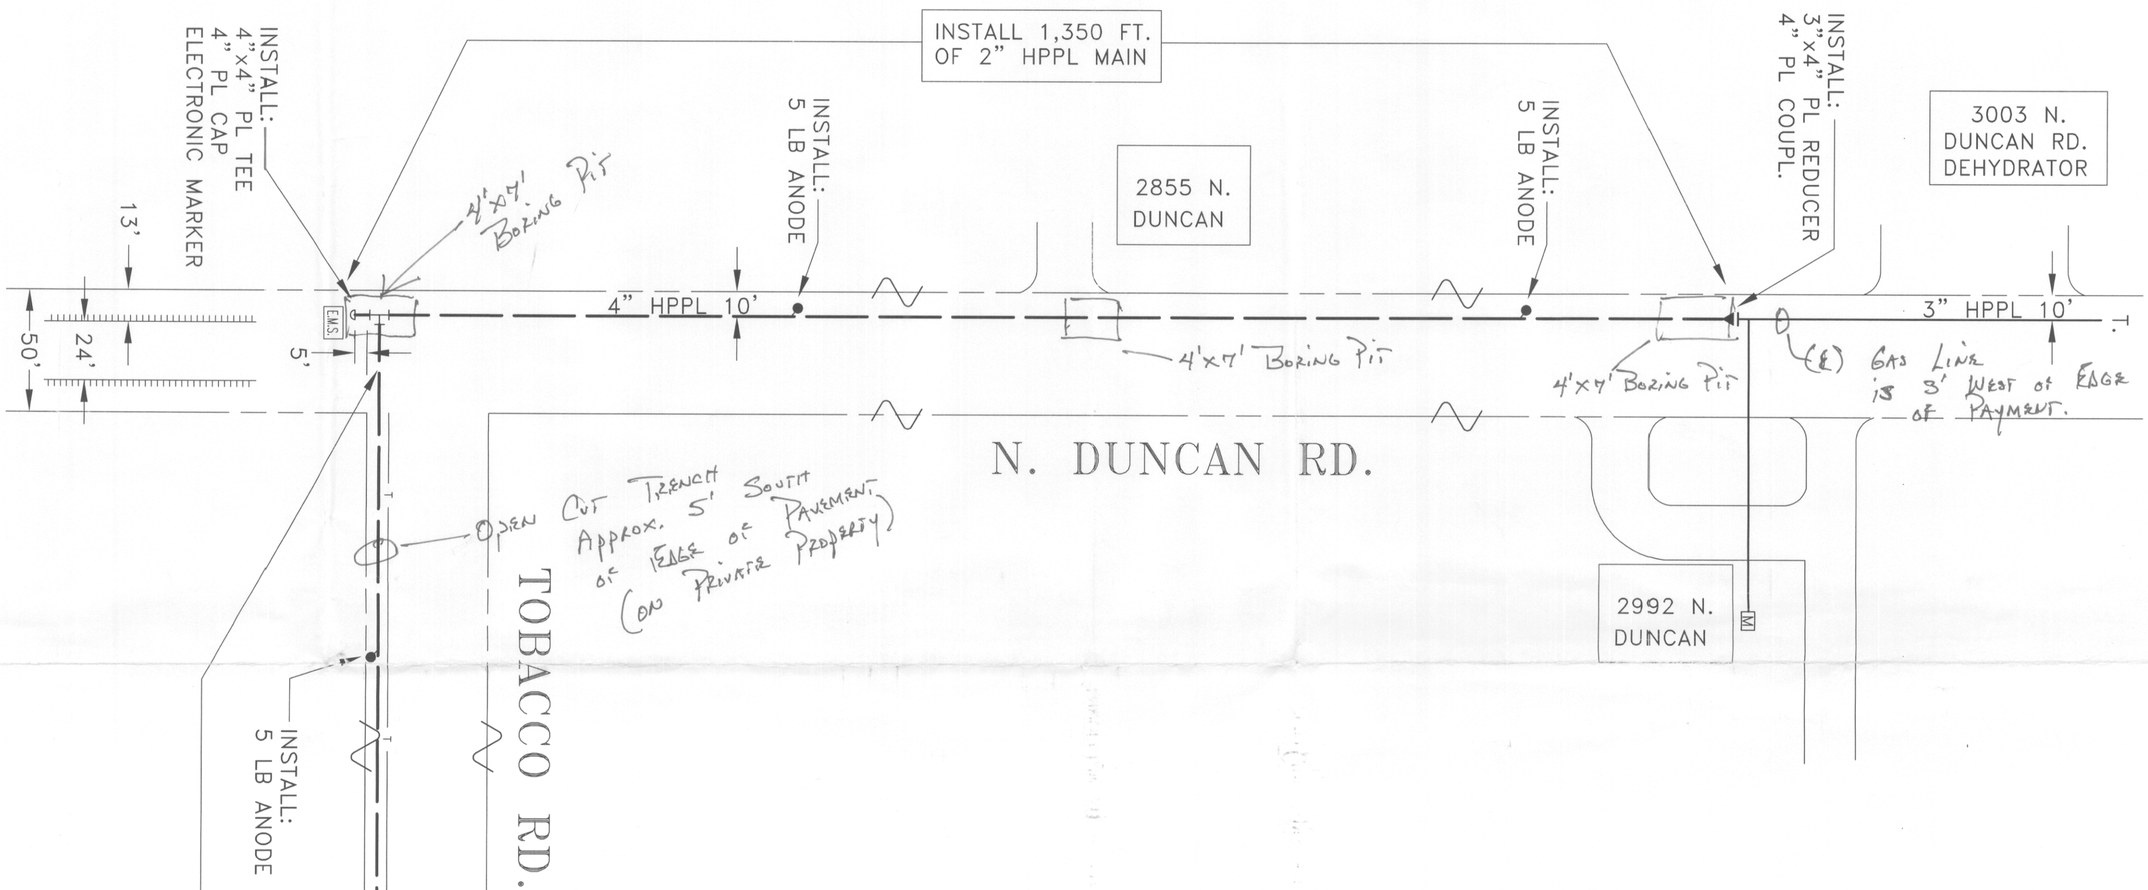

AIR QUALITY MITIGATION MEASURES:

1. ALL MATERIAL EXCAVATED OR GRADED SHOULD BE SUFFICIENTLY WATERED TO PREVENT EXCESSIVE AMOUNTS OF DUST. WATERING SHOULD OCCUR AT LEAST TWICE A DAY WITH COMPLETE COVERAGE.
2. ALL CLEARING, GRADING, EARTH MOVING OR EXCAVATION ACTIVITIES SHALL CEASE DURING PERIODS OF HIGH WINDS GREATER THAN 20 MPH AVERAGE OVER ONE HOUR.
3. ALL MATERIAL TRANSPORTED OFF-SITE SHALL BE EITHER SUFFICIENTLY WATERED OR SECURELY COVERED TO PREVENT EXCESSIVE AMOUNTS OF DUST.
4. THE AREA DISTURBED BY CLEARING, EARTH MOVING OR EXCAVATION ACTIVITIES SHOULD BE MINIMIZED AT ALL TIMES.
5. ON-SITE VEHICLE SPEED SHALL BE LIMITED TO 15 MPH.
6. ALL AREAS WITH VEHICLE TRAFFIC SHOULD BE WATERED PERIODICALLY FOR STABILIZATION OF DUST EMISSIONS.
7. STREETS ADJACENT TO THE PROJECT SITE SHOULD BE SWEPT AS NEEDED TO REMOVE SILT WHICH MAY HAVE ACCUMULATED FROM CONSTRUCTION ACTIVITIES.

Cathodic Protection Levels Inspected as Noted on Drawing on Existing Protected Steel. All Levels Satisfactory per PG&E GS&S 0-16

Qualified Employee _____ Date _____

ATTENTION FOREMAN
PRIOR TO STARTING JOB, CONSULT AREA CORROSION MECHANIC FOR LOCATING WIRE INSTALLATION AND CATHODIC PROTECTION REQUIREMENTS.
ROGER MORSEHEAD 842-6555

PLEASE CALL U.S.A. AT LEAST 48 HOURS PRIOR TO EXCAVATING IN THIS AREA
1-800-227-2600
TICKET # _____
DATE CALLED _____

2" PL. SERVICE

* TEST DATA STAMP *
ACTUAL TEST PRESSURE _____ psig
DURATION OF TEST _____
DATE OF TEST _____

4" PL. MAIN

* TEST DATA STAMP *
ACTUAL TEST PRESSURE _____ psig
DURATION OF TEST _____
DATE OF TEST _____

2" PL. SERVICE

PLASTIC PIPE INSPECTION/DATA
PIPE MANUFACTURER _____
DATE MANUFACTURED _____

4" PL. MAIN

PLASTIC PIPE INSPECTION/DATA
PIPE MANUFACTURER _____
DATE MANUFACTURED _____

NOTE: BOND LOCATING WIRES TOGETHER AT ALL PLASTIC TO PLASTIC TIE-INS.

WORK RECAP -- FOREMANS NOTES

INSTALL 3560' OF 4" HPPL MAIN
INSTALL 95' OF 2" HPPL SERVICE
INSTALL 1 METER,
1 REG AND 1 MON.
INSTALL 4-5LB ANODES CP AREA NON-CPA
PERMITS REQUIRED COUNTY - BY APPLICANT
SOIL DISPOSAL: HAUL XXX YD^3 SPREAD AT SITE X
SELECT IMPORT: XXX YD^3 A.C.PAVING NONE
CONCRETE NONE
IMPROVEMENT PLANS ARE NOT AVAILABLE AT STOCKTON DIVISION SVC PLANNING OFFICE.
OTHER NOTES:
CUSTOMER TO TRENCH AND PG&E TO INSTALL.

NOTE:
CUSTOMER TO INSTALL METER PROTECTION POSTS AND DEDICATED PHONE LINE.

LEGEND

- PROPOSED GAS MAIN (4" HPPL)
- EXISTING GAS MAIN (3" HPPL)
- PROPOSED GAS SERVICE (2" HPPL)
- EXISTING GAS SERVICE (1/2" HPPL)
- EDGE OF PAVEMENT
- RIGHT-OF-WAY
- EXISTING TELEPHONE
- 5LB ANODE
- 4" PL CAP
- E.M.S. ELECTRONIC MARKER
- 3"x4" PL REDUCER
- 4" PL TEE
- M ROOTS 7M METER @ 5 PSIG

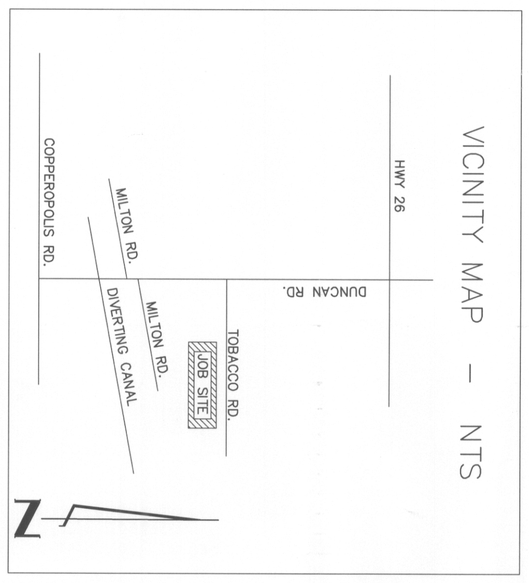

MAP: 2950-J1
CPA: NON-CPA
TBA: X-02
MAOP: 60 PSIG
E.S.ZONE: 16-ST-07-B

GAS MAIN AND SERVICE EXTENSION
INSTALL 4" HPPL MAIN & 2" HPPL SVC
18600 TOBACCO RD.
LINDEN UNINC. - S.J. COUNTY

NO.	DATE	DESCRIPTION	ORDER #	DWN	CHKD	SUPV	APVD BY

REVISIONS

EST: JG HOUBEIN
ADE: RD GIBBS
SUPV: MM LANG
REP: SS OKAMOTO
PLNR: DC RYMERS
SCALE: 1"=50' DATE: 3/12/09

ENGINEERING AND PLANNING DEPT.
4040 WEST LANE
STOCKTON, CA 95204
PHONE #: 209-942-1498 FAX #: 209-942-1768
PG&E PACIFIC GAS AND ELECTRIC COMPANY

CO:
SD:
NOTIF.: 103604828
Other:
SHT: SHEETS
PM: 30694541
REV.

0 INCH 1