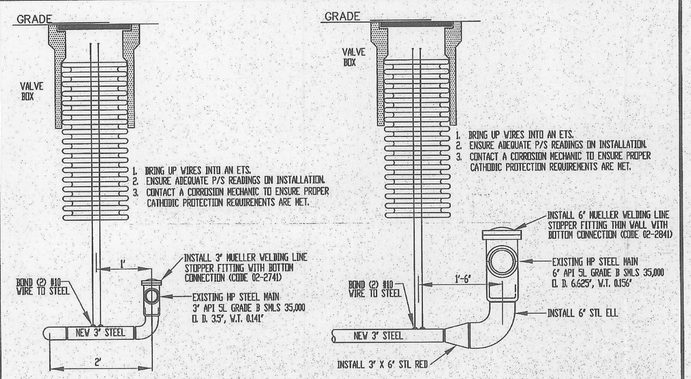

TIE-IN 3" STL X 3" STL
ETS & TIE-IN DETAIL

TIE-IN 6" STL X 3" STL
ETS & TIE-IN DETAIL

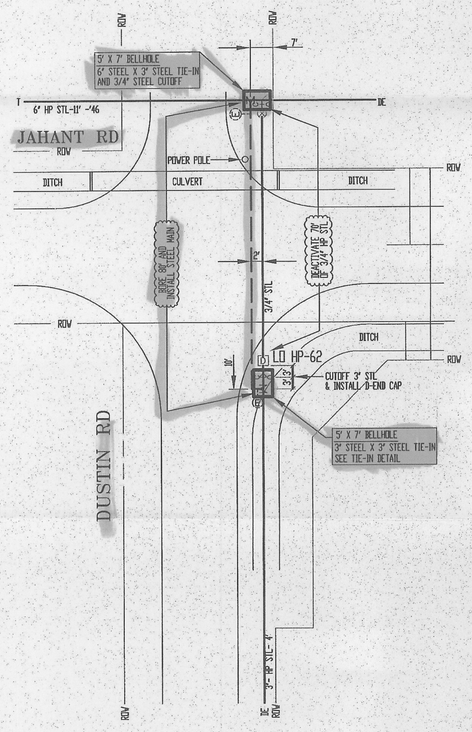



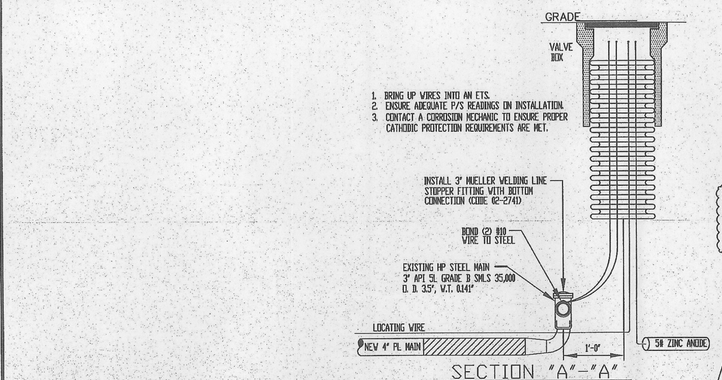

SECTION "A"-"A"

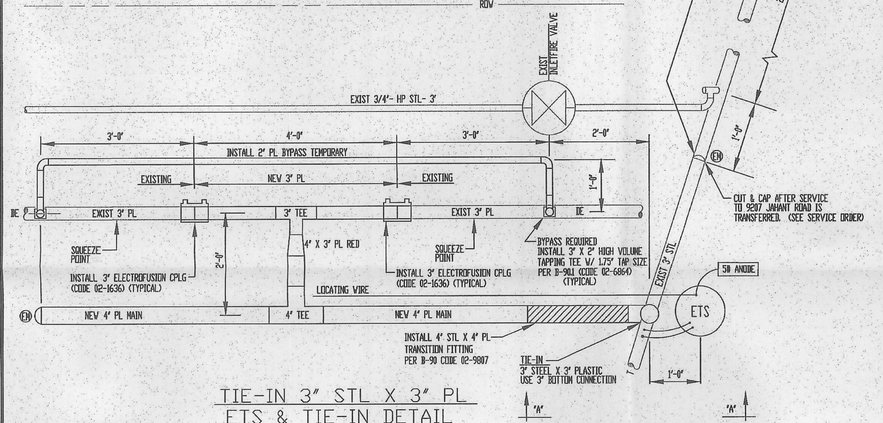

TIE-IN 3" STL X 3" PL
ETS & TIE-IN DETAIL

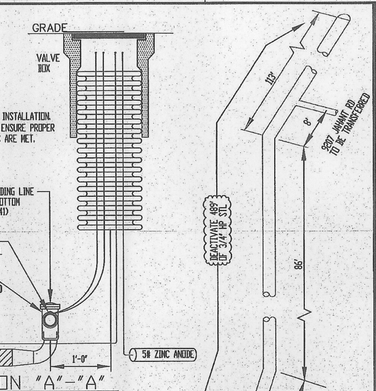

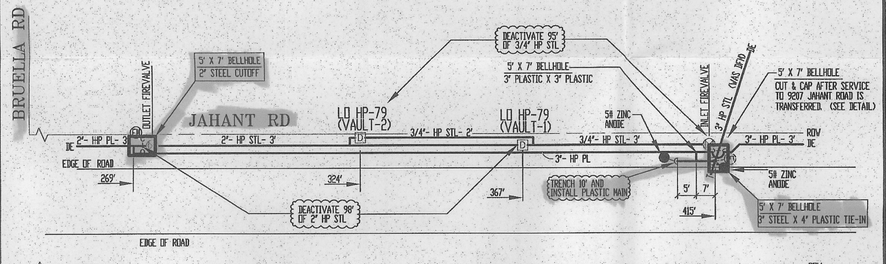

LO HP-79
DETAIL VIEW
(FOR LOCATION SEE SHEET 4)

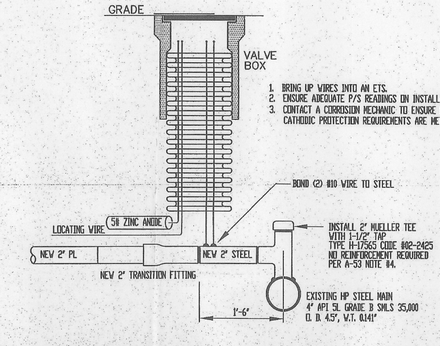

TIE-IN 4" STL X 2" PL
ETS & 2" MUELLER TEE DETAIL

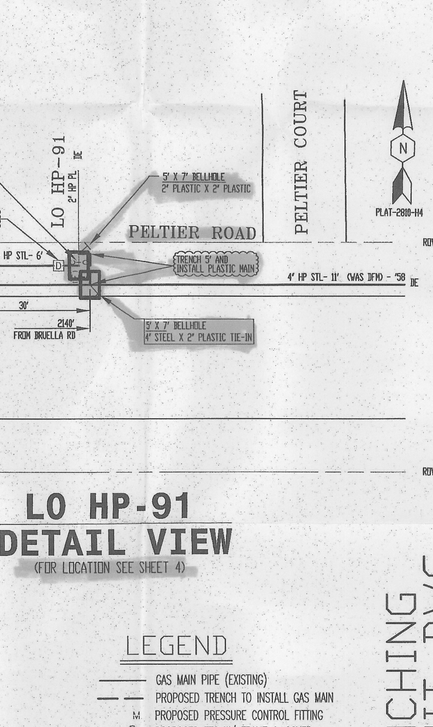

LO HP-91
DETAIL VIEW
(FOR LOCATION SEE SHEET 4)

LEGEND

- GAS MAIN PIPE (EXISTING)
- PROPOSED TRENCH TO INSTALL GAS MAIN
- M PROPOSED PRESSURE CONTROL FITTING
- (E)– PROPOSED ETS W/ FRAME & COVER
- PROPOSED 2" SERVICE TEE
- M EXISTING PRESSURE CONTROL FITTING
- 5# ZINC ANODE
- (E) ELECTRONIC MARKER
- EFV PROPOSED EXCESS FLOW VALVE

Underground Service Alert
Call: TOLL FREE
811
TWO WORKING DAYS BEFORE YOU DIG

LO HP-62
DETAIL VIEW
(FOR LOCATION SEE SHEET 4)

ENGINEERING AND PLANNING DEPT.
8 RIVER PARK PLACE EAST
FRESNO, CA 93720
PHONE #:559-347-5003 FAX #:559-347-5342
PACIFIC GAS AND ELECTRIC COMPANY

CO:
SD:
NOTIF.: 105233936
Other:
SHT: 8 OF 9 SHEETS
PM: 30840277 REV.

EST: JAVIER MENDIA
ADE: ROGER WILLIAMS
SUPV: CHAMENG YANG
REP: ALAN FONG
PLNR: DAVID RYMERS
SCALE: 1"=500' DATE: 7-08-2011 PRC

NO.	DATE	DESCRIPTION	ORDER #	DWN	CHKD	SUPV	APVD	BY

REVISIONS

TRENCHING PERMIT DWG

CONVERT JAHANT ROAD DFM (LINE 140)
TO DISTRIBUTION PRESSURE
JAHANT RD AND HWY 99
STOCKTON, CALIFORNIA

INCH 0 1
6 5 4 3 2 1 INCH 0