PS-1200573

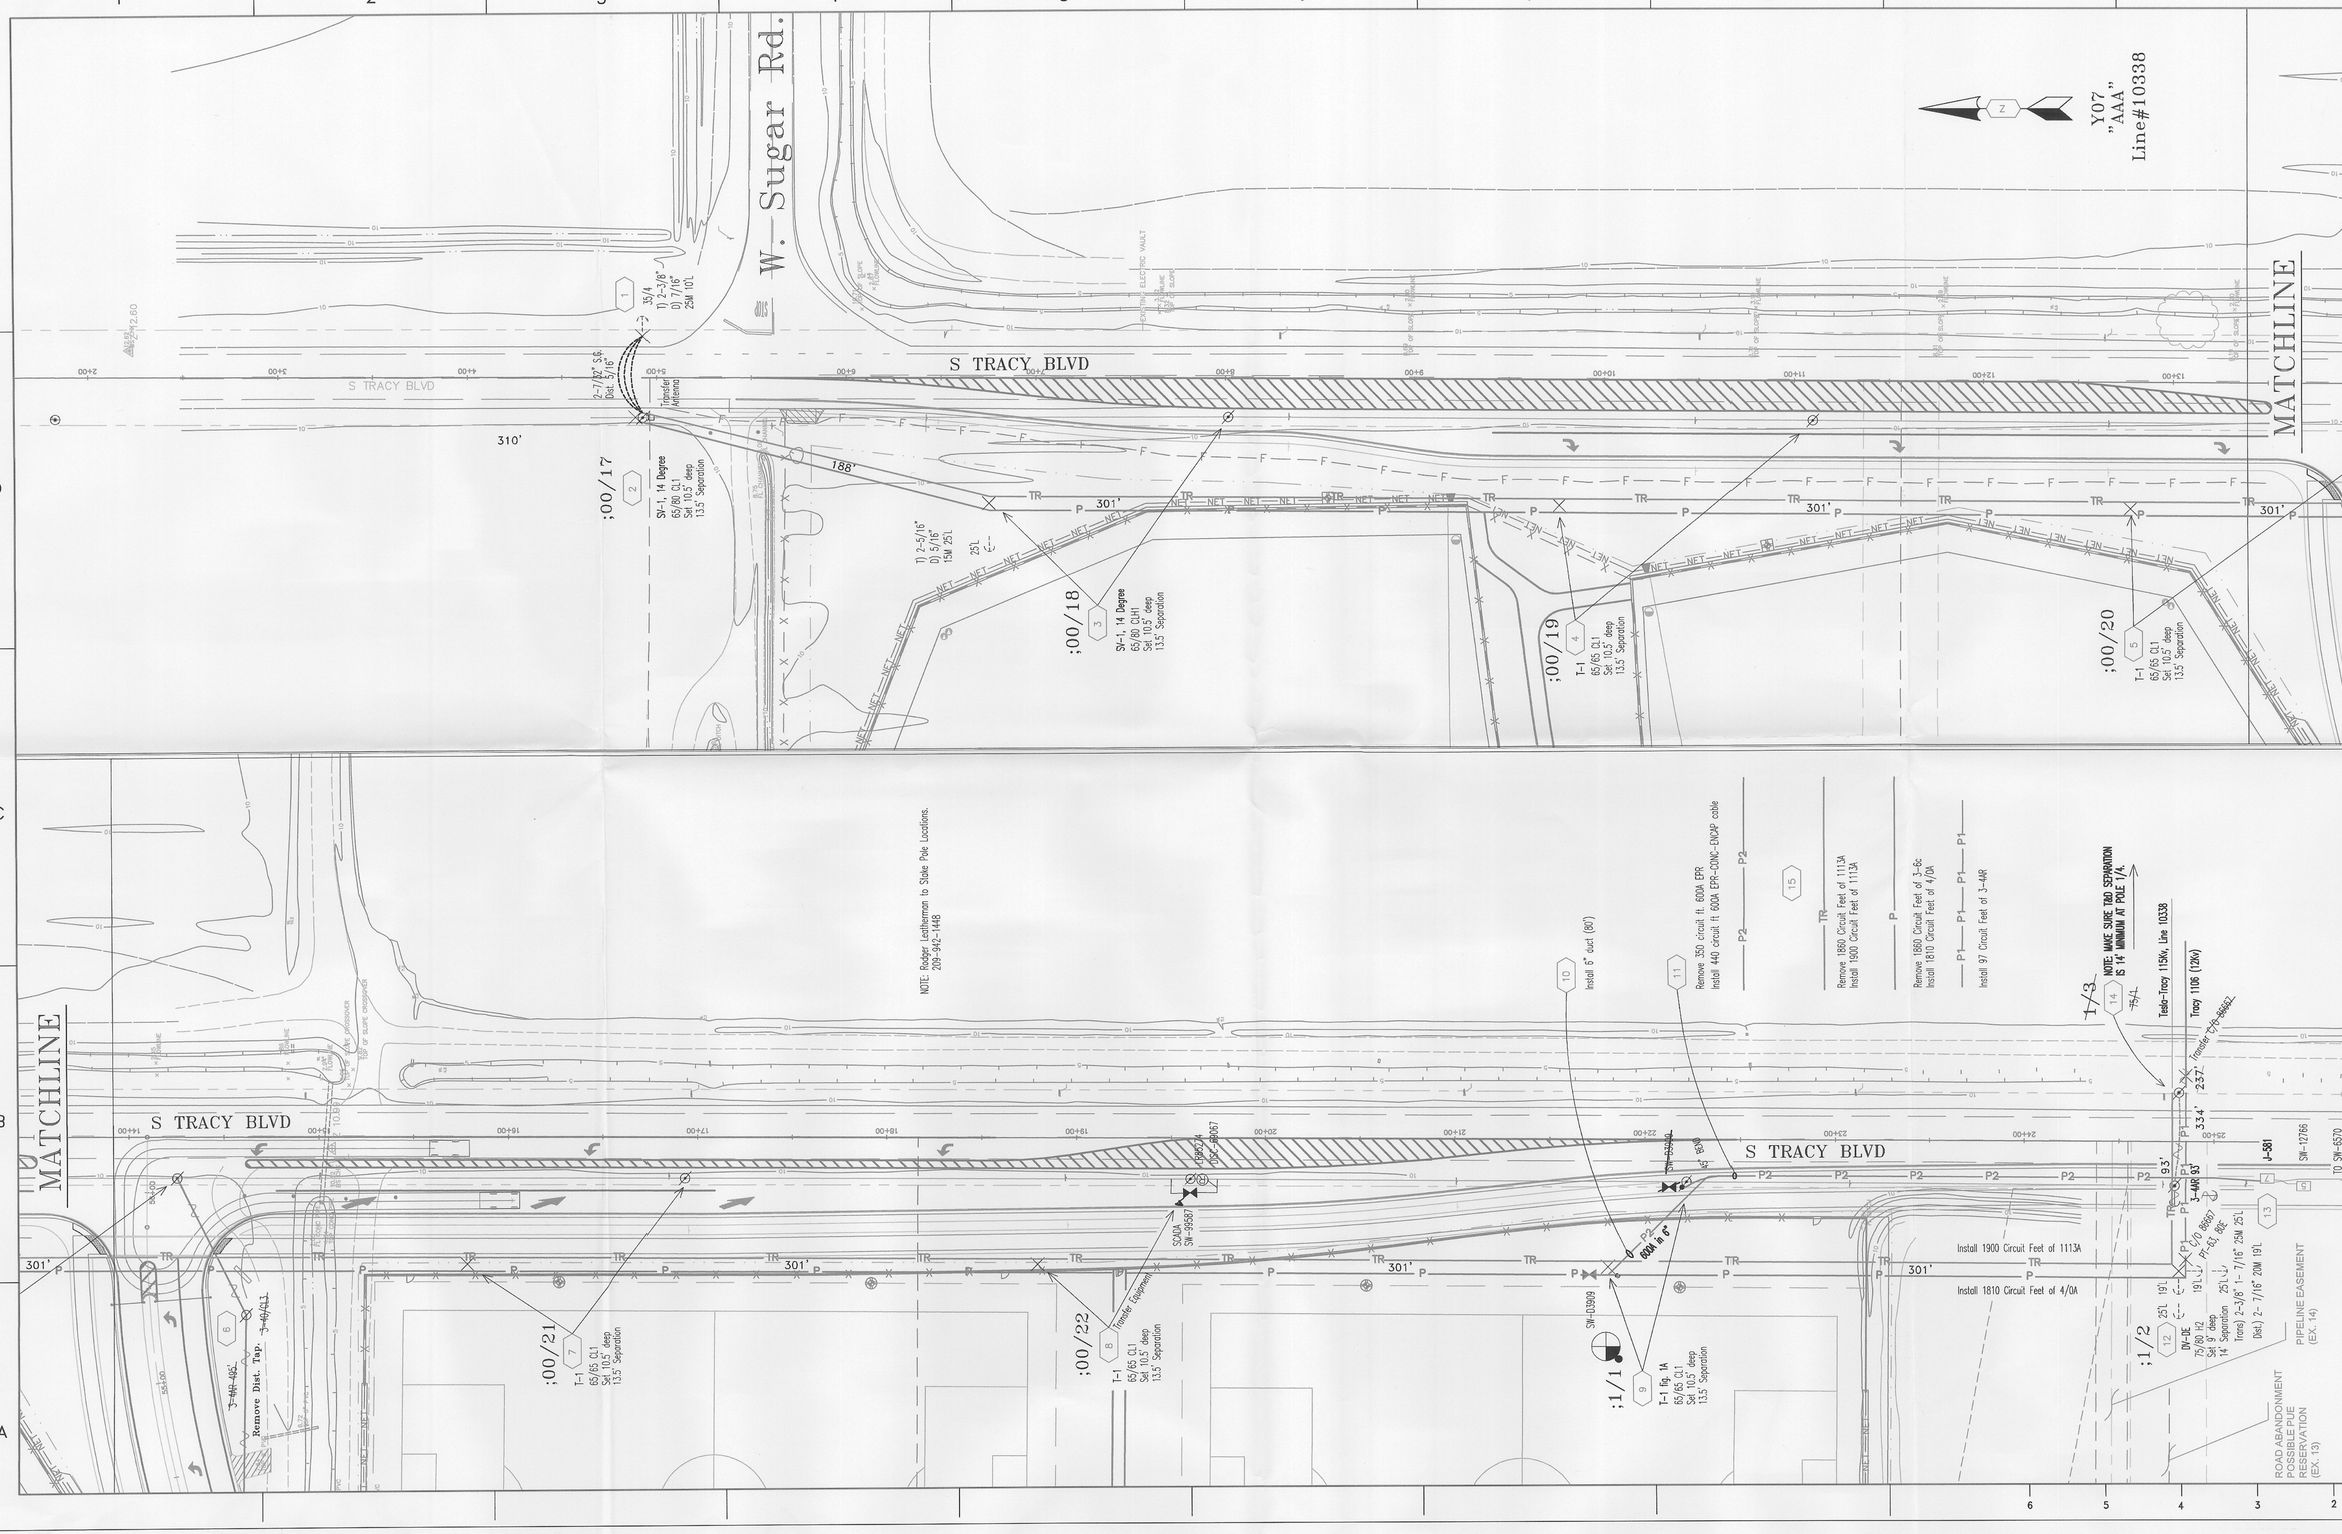
W. Sugar Rd.
S TRACY BLVD
MATCHLINE
Y07 "AAA" Line#10338
;00/17
;00/18
;00/19
;00/20
;00/21
;00/22
;1/1
;1/2
1/3
NOTE: Roger Leatherman to Stake Pole Locations. 209-942-1448
Remove 1880 Circuit Feet of 1113A
Install 1900 Circuit Feet of 1113A
Remove 1880 Circuit Feet of 3-6c
Install 1810 Circuit Feet of 4/0A
Install 97 Circuit Feet of 3-4AR
Remove 350 circuit ft. 600A EPR
Install 440 circuit ft 600A EPR-CONC-ENCAP cable
Install 6" duct (80')
NOTE: MAKE SURE T&D SEPARATION IS 14' MINIMUM AT POLE 1/14.
Tesla-Tracy 115kv, Line 10338
Tracy 1106 (12kv)
Install 1900 Circuit Feet of 1113A
Install 1810 Circuit Feet of 4/0A
PIPELINE EASEMENT (EX. 14)
ROAD ABANDONMENT POSSIBLE PUE RESERVATION (EX. 13)
Remove Dist. Tap.
Transfer Equipment
600A in 6"
SW-03909
SW-12786
SW-6570
TO SW-6570
J-581
J-440 93'
334'
237'
93'
301'
188'
310'
Tracy Sports Complex
S. Tracy Blvd.
Elec. Transmission Eng. Dept.
850 Stillwater Dr. Bldg. "E"
Sac., Ca. 98605
PHONE #:
FAX #:
PG&E PACIFIC GAS AND ELECTRIC COMPANY
CO:
SD:
NOTIF.: 105288451
Other:
SHT: 1 of 1
SHEETS
PM: 30853158
REV. 0
EST: David Stone 916-760-1958
ADE: Chris Girants
SUPV: Alison Nelson
REP: Chris Collos
PLNR:
SCALE: 1"=40'
DATE: 9/12/11
NO. DATE DESCRIPTION ORDER # DWN CHKD SUPV APVD BY
REVISIONS
INCH