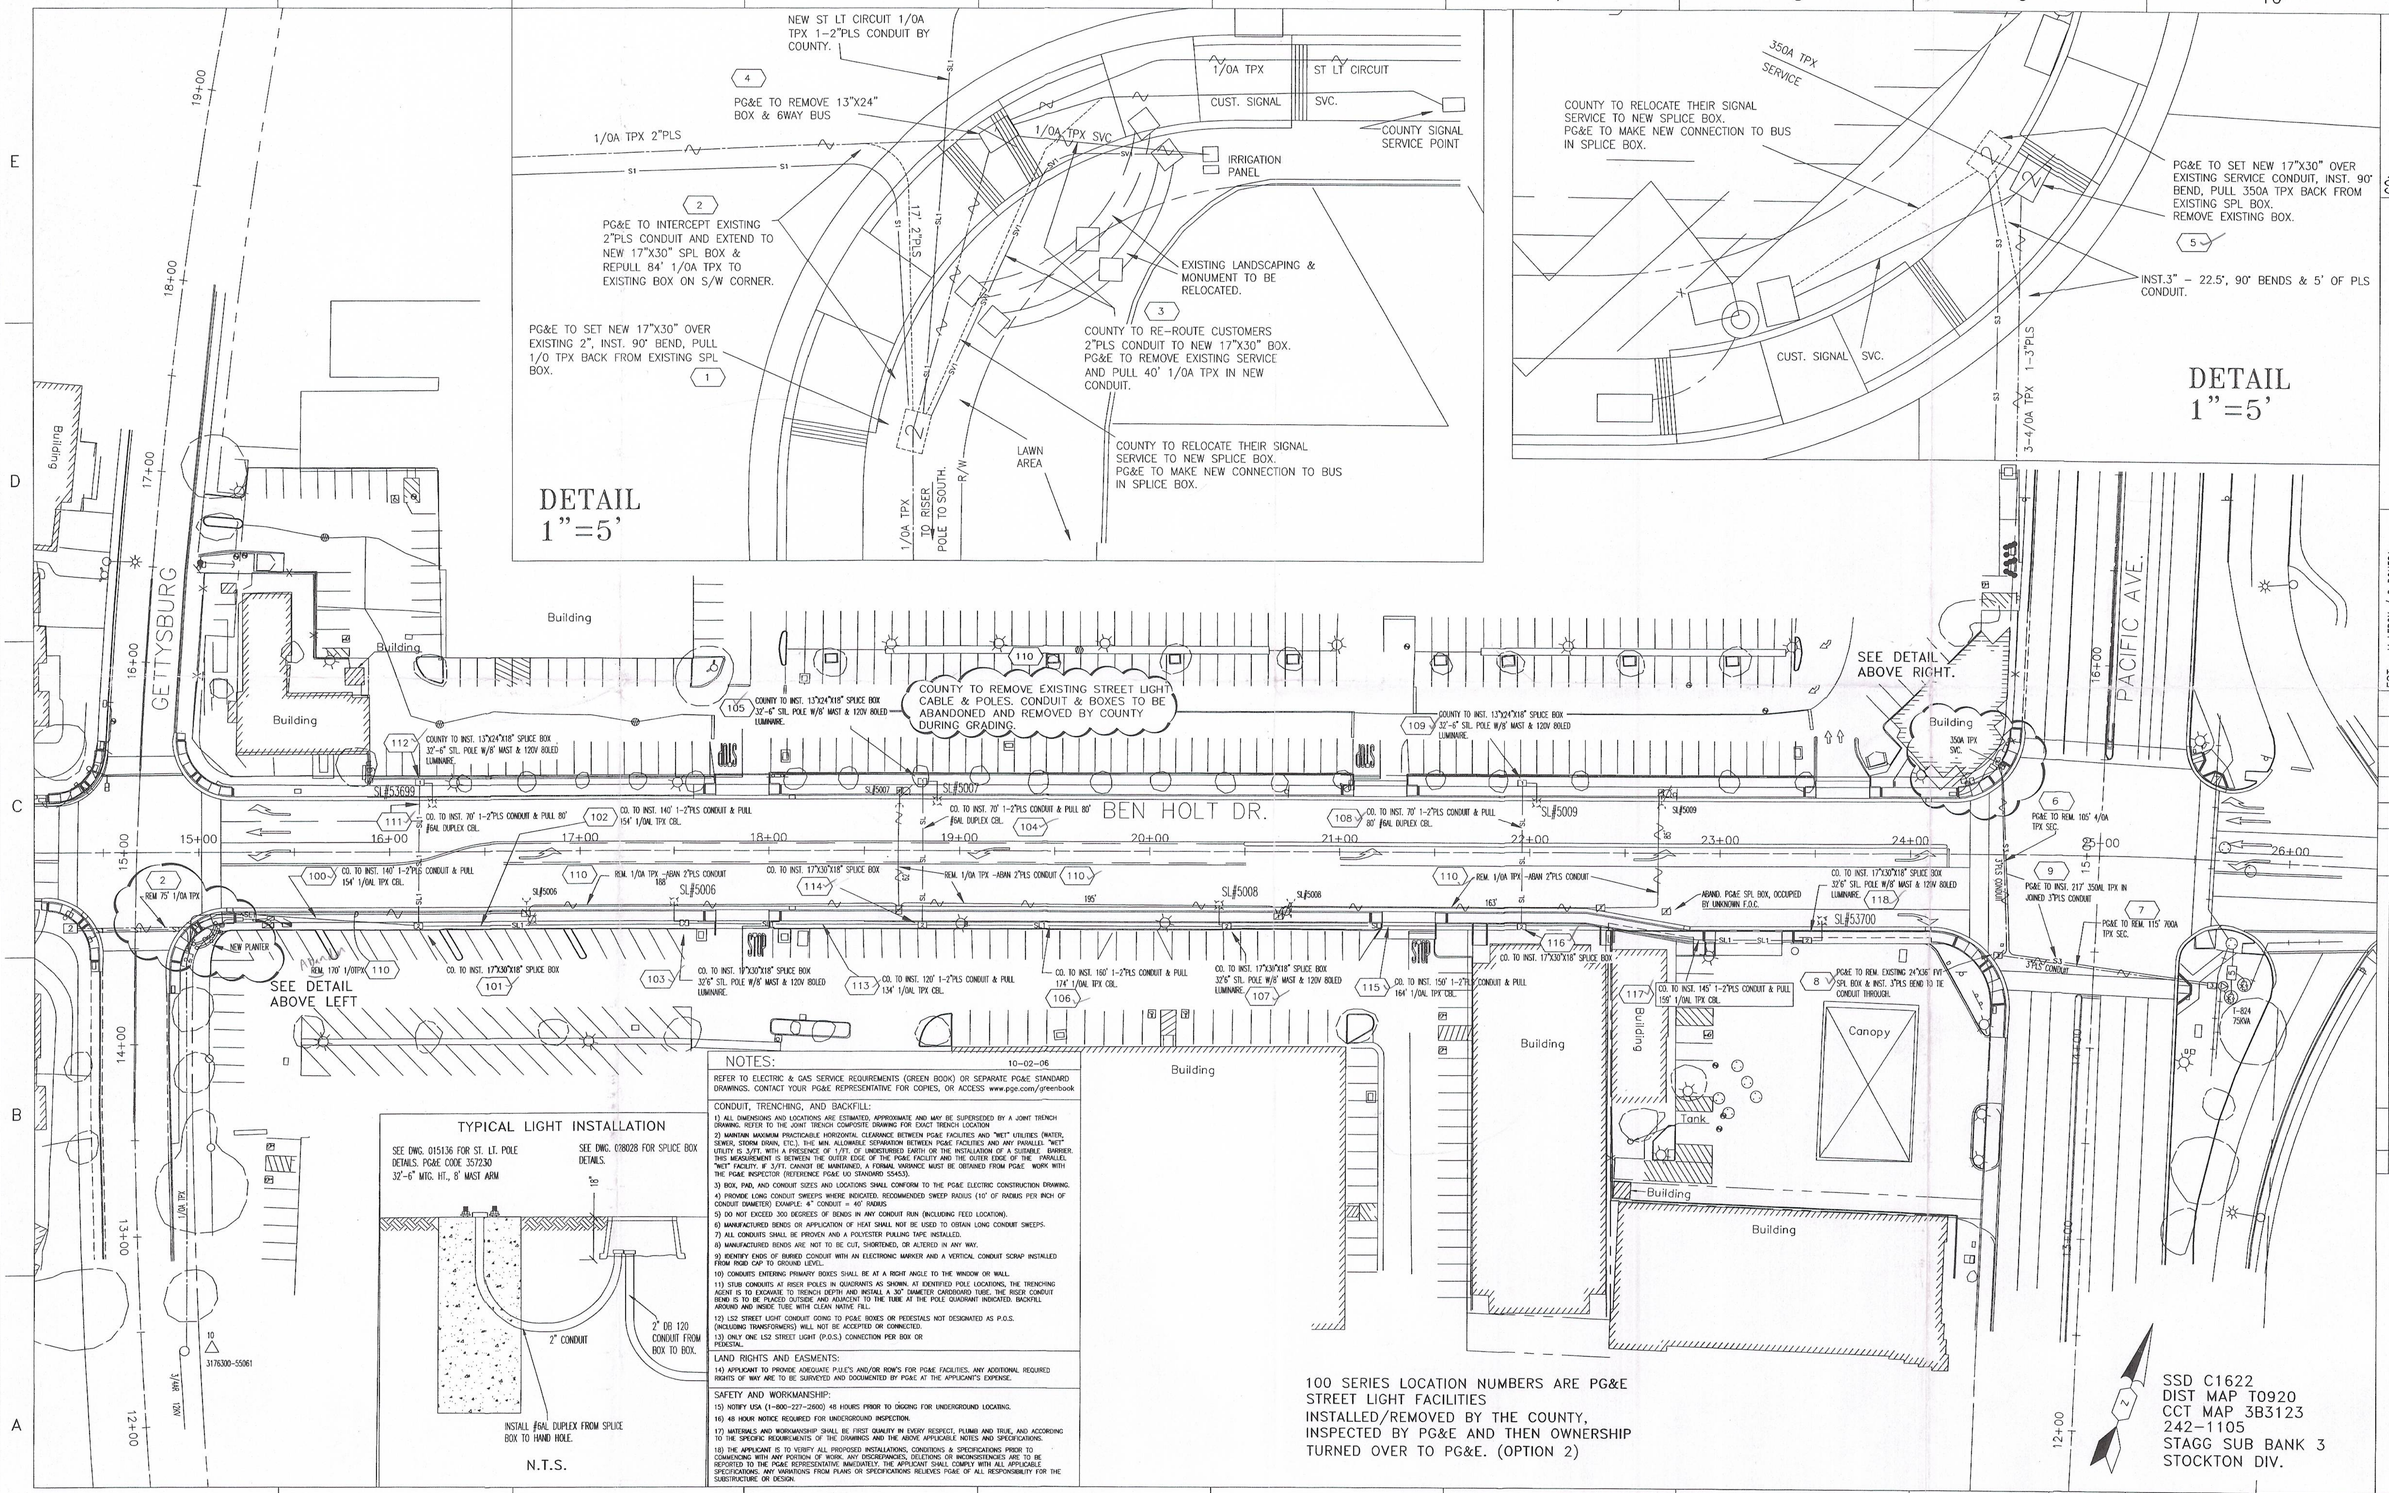

NOTES: 10-02-06

REFER TO ELECTRIC & GAS SERVICE REQUIREMENTS (GREEN BOOK) OR SEPARATE PG&E STANDARD DRAWINGS. CONTACT YOUR PG&E REPRESENTATIVE FOR COPIES, OR ACCESS www.pge.com/greenbook

CONDUIT, TRENCHING, AND BACKFILL:

1) ALL DIMENSIONS AND LOCATIONS ARE ESTIMATED, APPROXIMATE AND MAY BE SUPERSEDED BY A JOINT TRENCH DRAWING. REFER TO THE JOINT TRENCH COMPOSITE DRAWING FOR EXACT TRENCH LOCATION

2) MAINTAIN MAXIMUM PRACTICABLE HORIZONTAL CLEARANCE BETWEEN PG&E FACILITIES AND "WET" UTILITIES (WATER, SEWER, STORM DRAIN, ETC.). THE MIN. ALLOWABLE SEPARATION BETWEEN PG&E FACILITIES AND ANY PARALLEL "WET" UTILITY IS 3/FT. WITH A PRESENCE OF 1/FT. OF UNDISTURBED EARTH OR THE INSTALLATION OF A SUITABLE BARRIER. THIS MEASUREMENT IS BETWEEN THE OUTER EDGE OF THE PG&E FACILITY AND THE OUTER EDGE OF THE PARALLEL "WET" FACILITY. IF 3/FT. CANNOT BE MAINTAINED, A FORMAL VARIANCE MUST BE OBTAINED FROM PG&E WORK WITH THE PG&E INSPECTOR (REFERENCE PG&E UO STANDARD S2453).

3) BOX, PAD, AND CONDUIT SIZES AND LOCATIONS SHALL CONFORM TO THE PG&E ELECTRIC CONSTRUCTION DRAWING.

4) PROVIDE LONG CONDUIT SWEEPS WHERE INDICATED. RECOMMENDED SWEEP RADIUS (10' OF RADIUS PER INCH OF CONDUIT DIAMETER) EXAMPLE: 4" CONDUIT = 40' RADIUS

5) DO NOT EXCEED 300 DEGREES OF BENDS IN ANY CONDUIT RUN (INCLUDING FEED LOCATION).

6) MANUFACTURED BENDS OR APPLICATION OF HEAT SHALL NOT BE USED TO OBTAIN LONG CONDUIT SWEEPS.

7) ALL CONDUITS SHALL BE PROVIDED AND A POLYESTER PULLING TAPE INSTALLED.

8) MANUFACTURED BENDS ARE NOT TO BE CUT, SHORTENED, OR ALTERED IN ANY WAY.

9) IDENTIFY ENDS OF BURIED CONDUIT WITH AN ELECTRONIC MARKER AND A VERTICAL CONDUIT SCRAP INSTALLED FROM RIGID CAP TO GROUND LEVEL.

10) CONDUITS ENTERING PRIMARY BOXES SHALL BE AT A RIGHT ANGLE TO THE WINDOW OR WALL.

11) STUB CONDUITS AT RISER POLES IN QUADRANTS AS SHOWN. AT IDENTIFIED POLE LOCATIONS, THE TRENCHING AGENT IS TO EXCAVATE TO TRENCH DEPTH AND INSTALL A 30" DIAMETER CARDBOARD TUBE. THE RISER CONDUIT BEND IS TO BE PLACED OUTSIDE AND ADJACENT TO THE TUBE AT THE POLE QUADRANT INDICATED. BACKFILL AROUND AND INSIDE TUBE WITH CLEAN NATIVE FILL.

12) LS2 STREET LIGHT CONDUIT GOING TO PG&E BOXES OR PEDESTALS NOT DESIGNATED AS P.O.S. (INCLUDING TRANSFORMERS) WILL NOT BE ACCEPTED OR CONNECTED.

13) ONLY ONE LS2 STREET LIGHT (P.O.S.) CONNECTION PER BOX OR PEDESTAL.

LAND RIGHTS AND EASMENTS:

14) APPLICANT TO PROVIDE ADEQUATE P.U.E'S AND/OR ROW'S FOR PG&E FACILITIES. ANY ADDITIONAL REQUIRED RIGHTS OF WAY ARE TO BE SURVEYED AND DOCUMENTED BY PG&E AT THE APPLICANT'S EXPENSE.

SAFETY AND WORKMANSHIP:

15) NOTIFY USA (1-800-227-2600) 48 HOURS PRIOR TO DIGGING FOR UNDERGROUND LOCATING.

16) 48 HOUR NOTICE REQUIRED FOR UNDERGROUND INSPECTION.

17) MATERIALS AND WORKMANSHIP SHALL BE FIRST QUALITY IN EVERY RESPECT, PLUMB AND TRUE, AND ACCORDING TO THE SPECIFIC REQUIREMENTS OF THE DRAWINGS AND THE ABOVE APPLICABLE NOTES AND SPECIFICATIONS.

18) THE APPLICANT IS TO VERIFY ALL PROPOSED INSTALLATIONS, CONDITIONS & SPECIFICATIONS PRIOR TO COMMENCING WITH ANY PORTION OF WORK. ANY DISCREPANCIES, DELETIONS OR INCONSISTENCIES ARE TO BE REPORTED TO THE PG&E REPRESENTATIVE IMMEDIATELY. THE APPLICANT SHALL COMPLY WITH ALL APPLICABLE SPECIFICATIONS. ANY VARIATIONS FROM PLANS OR SPECIFICATIONS RELIEVES PG&E OF ALL RESPONSIBILITY FOR THE SUBSTRUCTURE OR DESIGN.

ENGINEERING AND PLANNING DEPT.
4040 WEST LANE
STOCKTON, CA 95204
PHONE #: 209-942-1784 FAX #:
PG&E PACIFIC GAS AND ELECTRIC COMPANY

CC:
SD:
NOTIF.: 105880658
Other:
SHT: 1 OF 1 SHEETS
PM: 30926771 REV. 1

EST: M LEROY / D DONESA
ADE: R GAEBEL
SUPV: CANDACE BRISKEY
REP: B JOAQUIN
PLNR:
SCALE: 1"=40' DATE: 10/21/2013

NO.	DATE	DESCRIPTION	ORDER #	DWN	CHKD	SUPV	APV'D BY

REVISIONS

RELOCATE SECONDARY / SERVICE FACILITIES. COUNTY TO RELOCATE ST LTS BENJAMIN HOLT DR, PACIFIC TO GETTYSBURG STOCKTON