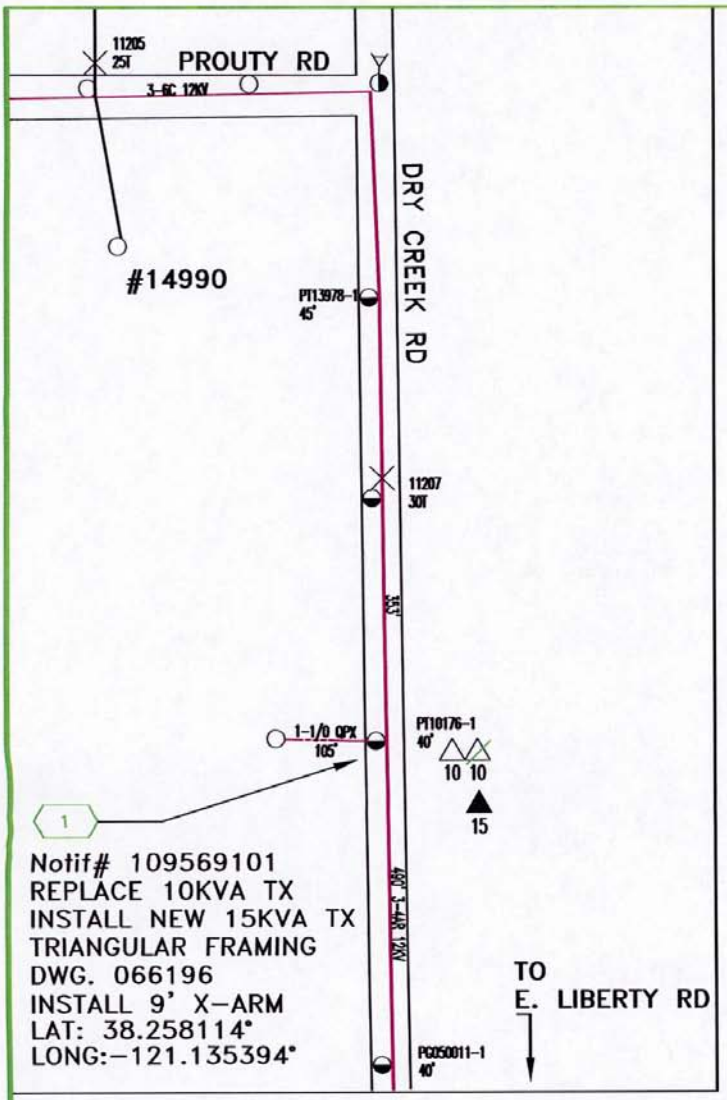

PROJECT CONDITIONS STAMP

Type(s) of Work:
- ☐ New Business
- ☐ PG&E Maintenance & Construction

Project Conditions:
- ☐ NONE APPARENT (If project design changes, contact ADE)
- or
- ☐ CONDITIONS APPLY:
  - ☐ PERMITS ☐ TAILBOARD ☐ OTHER
  - (Provide additional information on line below)

BY: _____
SIGNATURE, NAME, [CORPORATE ID], DATE

PRELIMINARY JOB

(1)

COORDINATE #
318178664067
LOADING DISTRICT
Summer Interior
TX SIZE – 15
KVA 1Ø – 0
KVA 3Ø – 12
% L.F. – 10

INSTALL NEW
▲ **TRANSFORMER**

REMOVE
△⁄△ **OPEN DELTA TX**

EXISTING
◑ **JOINT POLE**

N

12KV AREA
RAPTOR AREA
LIGHT LOADING
VOLTAGE CLASS: 1 AREA
INSULATION DISTRICT: D
NON CORROSION DIST.
BLOCK MAP: 014
CIRCUIT MAP: 2B & 2B43
BANK 4 OF LOCKFORD SUB
CCT# 2102 SSD: FUSE 11207

Underground Service Alert
Call: TOLL FREE
811
TWO WORKING DAYS BEFORE YOU DIG
NO PG&E GAS CONFLICTS FOR THIS PROJECT
GAS PLATS Map#

RAPTOR CONCENTRATION ZONE

EST: Ed Arroyo	Replace 10KVA on Open Delta TX 14990 Prouty Rd / Pole on Dry Creek Rd Galt PACIFIC GAS AND ELECTRIC COMPANY	CO:	
ADE: Mike Kartz		SD:	
SUPV: Charles Madison		NOTIF: 109569101	
REP:		OTHER:	
PLNR:		SHT: 1 of 1	SHEETS
SCALE: N.T.S. / DATE: 01-07-15	PG&E	PM: 31117623	REV.