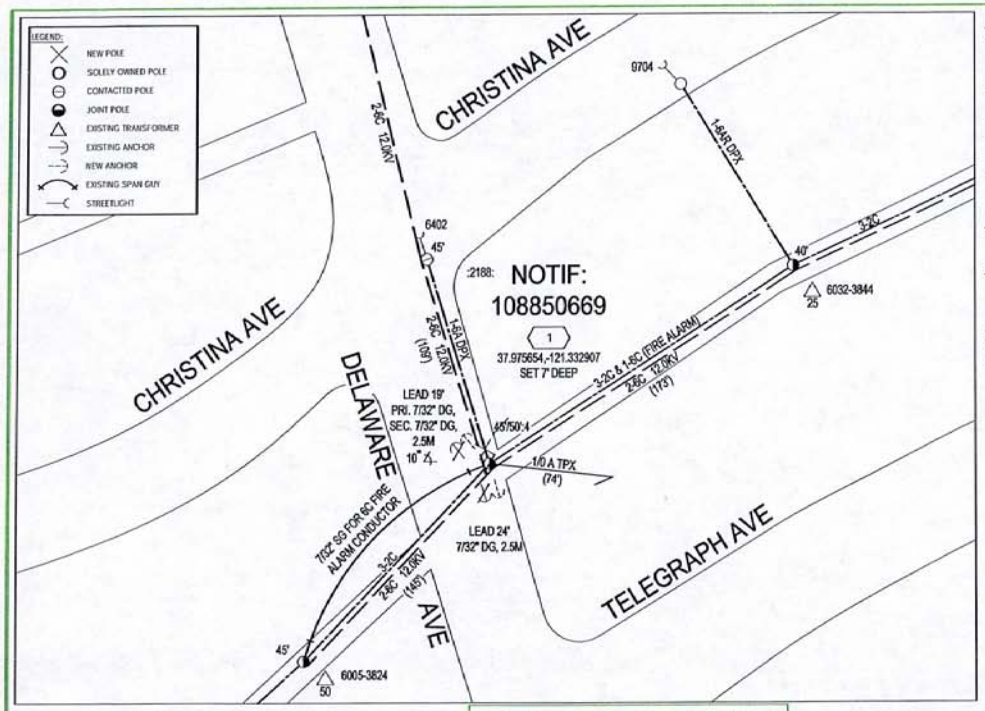

JOB NOTES:
- REPLACE 45' JOINTLY OWNED POLE WITH NEW 50':4 POLE SET 7' DEEP 1' NORTHWEST OF EXISTING POLE.
- TRANSFER OH PRIMARY AND SECONDARY OH CONDUCTORS.
- TRANSFER (1) FIRE ALARM WIRE W/ SPAN GUY.
- REPLACE (2) EXISTING 7/32" DG WITH NEW 7/32" DG WITH 15M ANCHOR, 19' LEAD.
- REPLACE (1) EXISTING 7/32" DG WITH NEW 7/32" DG WITH 15M ANCHOR, 24' LEAD.

PERMIT NOTES:
- SAN JOAQUIN COUNTY

ENVIRONMENTAL NOTES:
- REFER TO DM3 AND SUPPORTING DOCUMENTS IN CONSTRUCTION PACKAGE.

JOINT POLE NOTES:
- PG TO TOP POLE
- PT TO PTD

LOC # 1 ABN 45' POLE
UNK # UNKNOWN JP #UNKNOWN
SET 1947 SOLD UNKNOWN
SET NEW 50' POLE
PG 43-13 PT 24-6
PG #150047XT JP #1

RAPTOR CONSTRUCTION

N

12KV - LIGHT LOADING
DIST. PLAT MAP: U0909
SUB: COUNTRY CLUB 312 - BANK 2
CIRCUIT: 1101
S/S DEVICE: SWITCH 1273
'B' INSULATION / NON CORROSION
CLASS 1 AREA / FIRE AREA: LRA
RCZ: YES / SURGE DIST: 3

ESTIMATOR:	SUPERVISOR:
DANIEL TSO	CHARLES MADISON
(925) 327-0990	(916) 760-1954
ADE:	JOB OWNER
DAN CHAVIS	KIMBERLY VAN FLEET
(916) 760-2983	(209) 942-1622

PROJECT CONDITIONS STAMP

Type(s) of Work:
- ☐ New Business
- ■ PG&E Maintenance & Construction

Project Conditions:
- ☐ NONE APPARENT (if project design changes, contact ADE) or
- ■ CONDITIONS APPLY:
  - ☐ PERMITS ☐ TAILBOARD ■ OTHER
  - (Provide additional information on line below)

REFER TO DM3 AND SUPPORTING DOC IN CONST. PACKAGE

BY: DANIEL TSO [D1TL] 03/26/15
SIGNATURE, NAME, [CORPORATE ID], DATE

Underground Service Alert

CALL BEFORE YOU DIG

Call: TOLL FREE
811

TWO WORKING DAYS BEFORE YOU DIG

GAS CONFLICTS IDENTIFIED FOR THIS PROJECT
GAS PLATS: 3004B3

GAS FACILITIES IN CONFLICT WITH EXCAVATION AT LOC(S):

GAS FACILITIES IN PROXIMITY WITH EXCAVATION AT LOC(S):
1

FIRE AREA NON-EXEMPT EQUIPMENT STAMP

Identify the Subject Pole Fire Area District (per Doc. #07214B and UWy Bulletin TD-23018-004):

☐ FRA ☐ SRA ■ LRA
☐ OWF ☐ UWF

Per the Power Line Fire Prevention Field Guide, the equipment being installed is:

☐ Exempt ☐ Non-Exempt ■ N/A

☐ If Installing Non-Exempt Equipment in a Fire Area, verify in SAP that the the CN-25 has been activated.

By: DANIEL TSO [D1TL] 03/26/15
Signature, Name [Corp ID], Date

CO:
SD:
NOTIF.: 108850669
OTHER: SAP ID: 102056606
SHT: 1 OF 1 SHEETS
PM: 31102000 REV. 0

CONSTRUCTION DRAWING

REPLACE DETERIORATED POLE
2188 CHRISTINA AVE.
STOCKTON, CA 95204

PACIFIC GAS AND ELECTRIC COMPANY

EST: DANIEL TSO
ADE: DAN CHAVIS
SUPV: CHARLES MADISON
REP: KIMBERLY VAN FLEET
PLNR:
SCALE: N.T.S.
DATE: 03/26/15

ALL FLAGGERS WILL COMMUNICATE THROUGH HAND SIGNALS AND WALKIE TALKIES WITH ONE ANOTHER

SIGNS BEING USED

- 48X48" W3-4
- 48X48" C9A (CA)
- 48X48" W20-4
- 48X48" W20-1

ADDITIONAL FLAGGER TO MAINTAIN CLOSURE AND ASSIST BICYCLE, PEDESTRIAN AND DRIVE WAY TRAFFIC SHOULD NEED ARISE

TOW-AWAY ZONE

R30 24X24" BARRICADE MOUNTED, PLACED ON BOTH SIDES OF STREET 20' APART 72HR PRIOR TO START OF WORK

FOR TCP QUESTIONS CALL:
ROBERT @ 209-200-3351

SEE SPEC SHEET 2 FOR ADDITIONAL TRAFFIC CONTROL STIPULATIONS

PEDESTRIAN AND BICYCLE ACCESS TO REMAIN OPEN AT ALL TIMES

WORK SHALL NOT EXCEED 12HRS

MIN 12' CLEARANCE FOR TRAFFIC

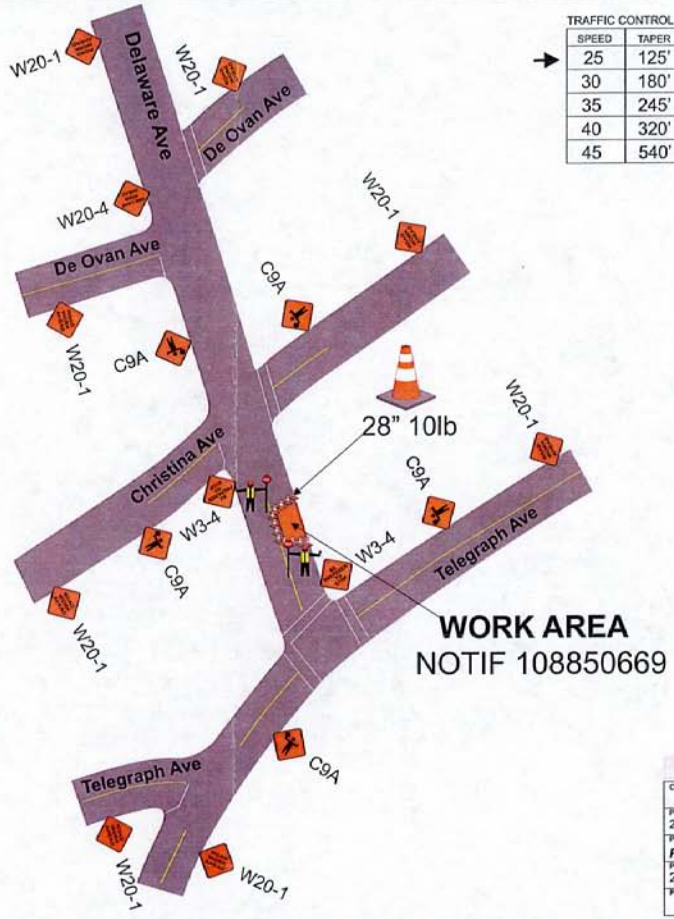

TRAFFIC CONTROL ZONES				MAX CONE SPACING	
SPEED	TAPER	BUFFER	SIGN SPACING	TAPER	TANGENT
25	125'	60'	**100'**	25	50
30	180'	90'		30	60
35	245'	120'	**250'**	35	70
40	320'	160'		40	80
45	540'	270'	**350'**	45	90

ELEC

NOT TO SCALE

PM 31102000

Owner: CITY OF STOCKTON	
Project Location: 2188 Christina Ave	Project City: Stockton, CA
Prime Contractor: *PG&E*	Traffic Control Contractor: ED SAFETY INC
Phone: 209-333-0807	Sheet Number: PS-1 / Date: 4/6/2015
Prepared By: ED SAFETY SERVICES, INC	

HOURS OF WORK SHALL BE DETERMINED BY THE CITY OF STOCKTON