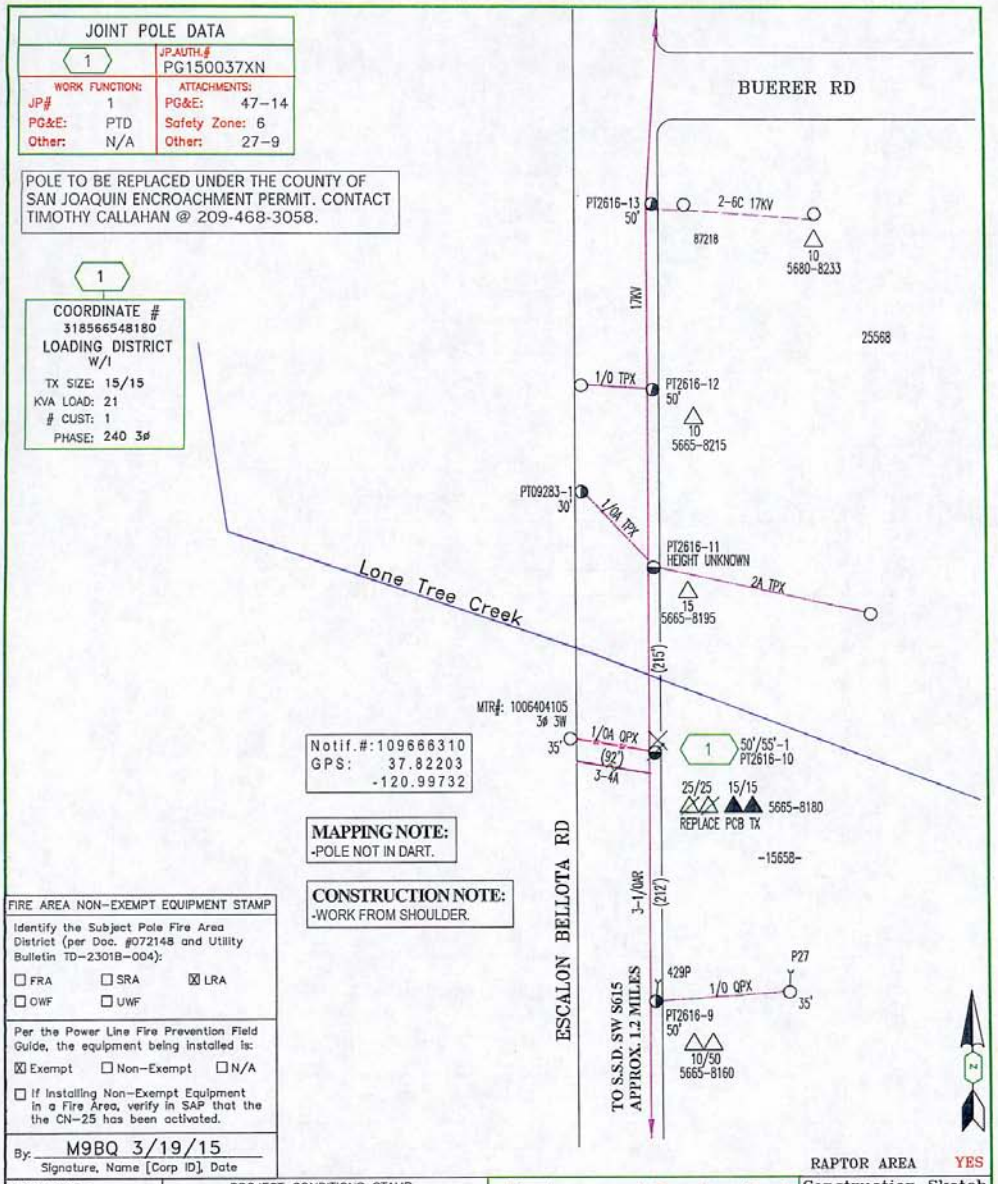
JOINT POLE DATA
1
JP AUTH.#
PG150037XN
WORK FUNCTION:
JP#: 1
PG&E: PTD
Other: N/A
ATTACHMENTS:
PG&E: 47-14
Safety Zone: 6
Other: 27-9
POLE TO BE REPLACED UNDER THE COUNTY OF SAN JOAQUIN ENCROACHMENT PERMIT. CONTACT TIMOTHY CALLAHAN @ 209-468-3058.
1
COORDINATE #
318566548180
LOADING DISTRICT
W/I
TX SIZE: 15/15
KVA LOAD: 21
CUST: 1
PHASE: 240 3ø
BUERER RD
PT2616-13
50'
2-6C 17KV
87218
10
5680-8233
17KV
25568
1/0 TPX
PT2616-12
50'
10
5665-8215
PT09283-1
30'
1/0A TPX
PT2616-11
HEIGHT UNKNOWN
2A TPX
15
5665-8195
Lone Tree Creek
(215')
MTR#: 1006404105
3ø 3W
35'
1/0A QPX
(92')
3-4A
1
50'/55'-1
PT2616-10
25/25
15/15
5665-8180
REPLACE PCB TX
-15658-
ESCALON BELLOTA RD
3-1/0AR
(212')
429P
1/0 QPX
P27
35'
PT2616-9
50'
10/50
5665-8160
TO S.S.D. SW S615
APPROX. 1.2 MILES
Notif.#:109666310
GPS: 37.82203
-120.99732
MAPPING NOTE:
-POLE NOT IN DART.
CONSTRUCTION NOTE:
-WORK FROM SHOULDER.
FIRE AREA NON-EXEMPT EQUIPMENT STAMP
Identify the Subject Pole Fire Area District (per Doc. #072148 and Utility Bulletin TD-2301B-004):
☐ FRA ☐ SRA ☒ LRA
☐ OWF ☐ UWF
Per the Power Line Fire Prevention Field Guide, the equipment being installed is:
☒ Exempt ☐ Non-Exempt ☐ N/A
☐ If Installing Non-Exempt Equipment in a Fire Area, verify in SAP that the the CN-25 has been activated.
By: M9BQ 3/19/15
Signature, Name [Corp ID], Date
RAPTOR AREA YES
ESTIMATOR:
MIKE BOWEN
(951) 377-9532
ADE:
DAN CHAVIS
(916) 760-3670
PROJECT MANAGER:
DELILA TALENT
(209) 726-5592
SUPERVISOR:
CHARLES MADISON
(916) 760-1954
PROJECT CONDITIONS STAMP
Type(s) of Work:
☐ New Business
☒ PG&E Maintenance & Construction
Project Conditions:
☐ NONE APPARENT (if project design changes, contact ADE)
or
☒ CONDITIONS APPLY:
☐ PERMITS ☐ TAILBOARD ☒ OTHER
(Provide additional information on line below)
SEE COMPLETED DM-3
M9BQ 3/19/15
SIGNATURE, NAME, [CORPORATE ID], DATE
Underground Service Alert
CALL BEFORE YOU DIG
Call: TOLL FREE
811
TWO WORKING DAYS BEFORE YOU DIG
NO GAS CONFLICTS FOR THIS PROJECT
GAS PLATS: NO RECORD FOUND
Construction Sketch
17KV
PLAT: X18
SSD: SW S615
CKT: RIVERBANK 1713
DESIGN VOLTAGE: 3
INSULATION DISTRICT: B
LOADING AREA: LIGHT
CORROSION AREA: NON
ARRESTOR DISTRICT: 3
FIRE AREA: LRA
EST: MIKE BOWEN
ADE: DAN CHAVIS
SUPV: CHARLES MADISON
REP: DELILA TALENT
PLNR: -
SCALE: NTS
DATE: 3/13/15
CONSTRUCTION DRAWING
REPLACE DETERIORATED POLE
15658 ESCALON BELLOTA RD
ESCALON, CA
PACIFIC GAS AND ELECTRIC COMPANY
CO:
SO: -
NOTIF: 109666310
SAP ID #: 103170748
SHT: 1 OF 1 SHEETS
PM: 31122914
REV. -

SIGNS BEING USED

- 48X48" C30A-CA
- 48X48" C24-CA
- 48X48" W20-1

ADDITIONAL TRAFFIC CONTROL PERSON TO MAINTAIN CLOSURE AND ASSIST BICYCLE, PEDESTRIAN AND DRIVE WAY TRAFFIC SHOULD NEED ARISE

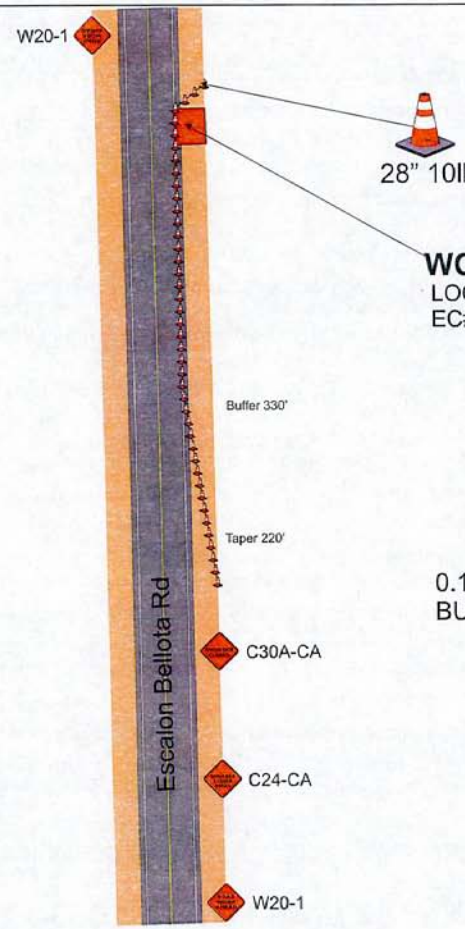

mph SPEED	feet TAPER	SIGN SPACING	TAPER	TANGENT
25	125'	500'	25	50
30	180'		30	60
35	245'		35	70
40	320'		40	80
45	540'		45	90
55	660'		55	110

BUFFER(1/2taper) SHOULDER(1/3taper)

N W E S

C17(CA)
ROAD WORK
45 MPH
Placed at each W20-1

R30 24X24" BARRICADE MOUNTED, PLACED ON BOTH SIDES OF STREET 20' APART 72HR PRIOR TO START OF WORK

TOW-AWAY ZONE

For TCP questions call
ROBERT @ 209-200-3351

SEE SPEC SHEET 2 FOR ADDITIONAL TRAFFIC CONTROL STIPULATIONS

Pedestrian and Bicycle Access to remain open at all times.

Minimum 12ft clearance for traffic

Work shall not exceed 12 hours

NOT TO SCALE

HOURS OF WORK SHALL BE DETERMINED BY SAN JOAQUIN COUNTY

PM# 31122914

Owner	SAN JOAQUIN COUNTY
Project Location	15658 Escalon Bellota Rd
Project City	Escalon, CA
Prime Contractor	PG&E
Traffic Control Contractor	City Rise Services, Inc.
Phone	209-333-0807
Sheet Number	PS-1
Date	6/15/2015
Prepared by	CITY RISE SERVICES, INC