NOTE TO MAPPING: LOCATION 1 ILLUSTRATES CORRECT PLACEMENT @ INTERSECTION.

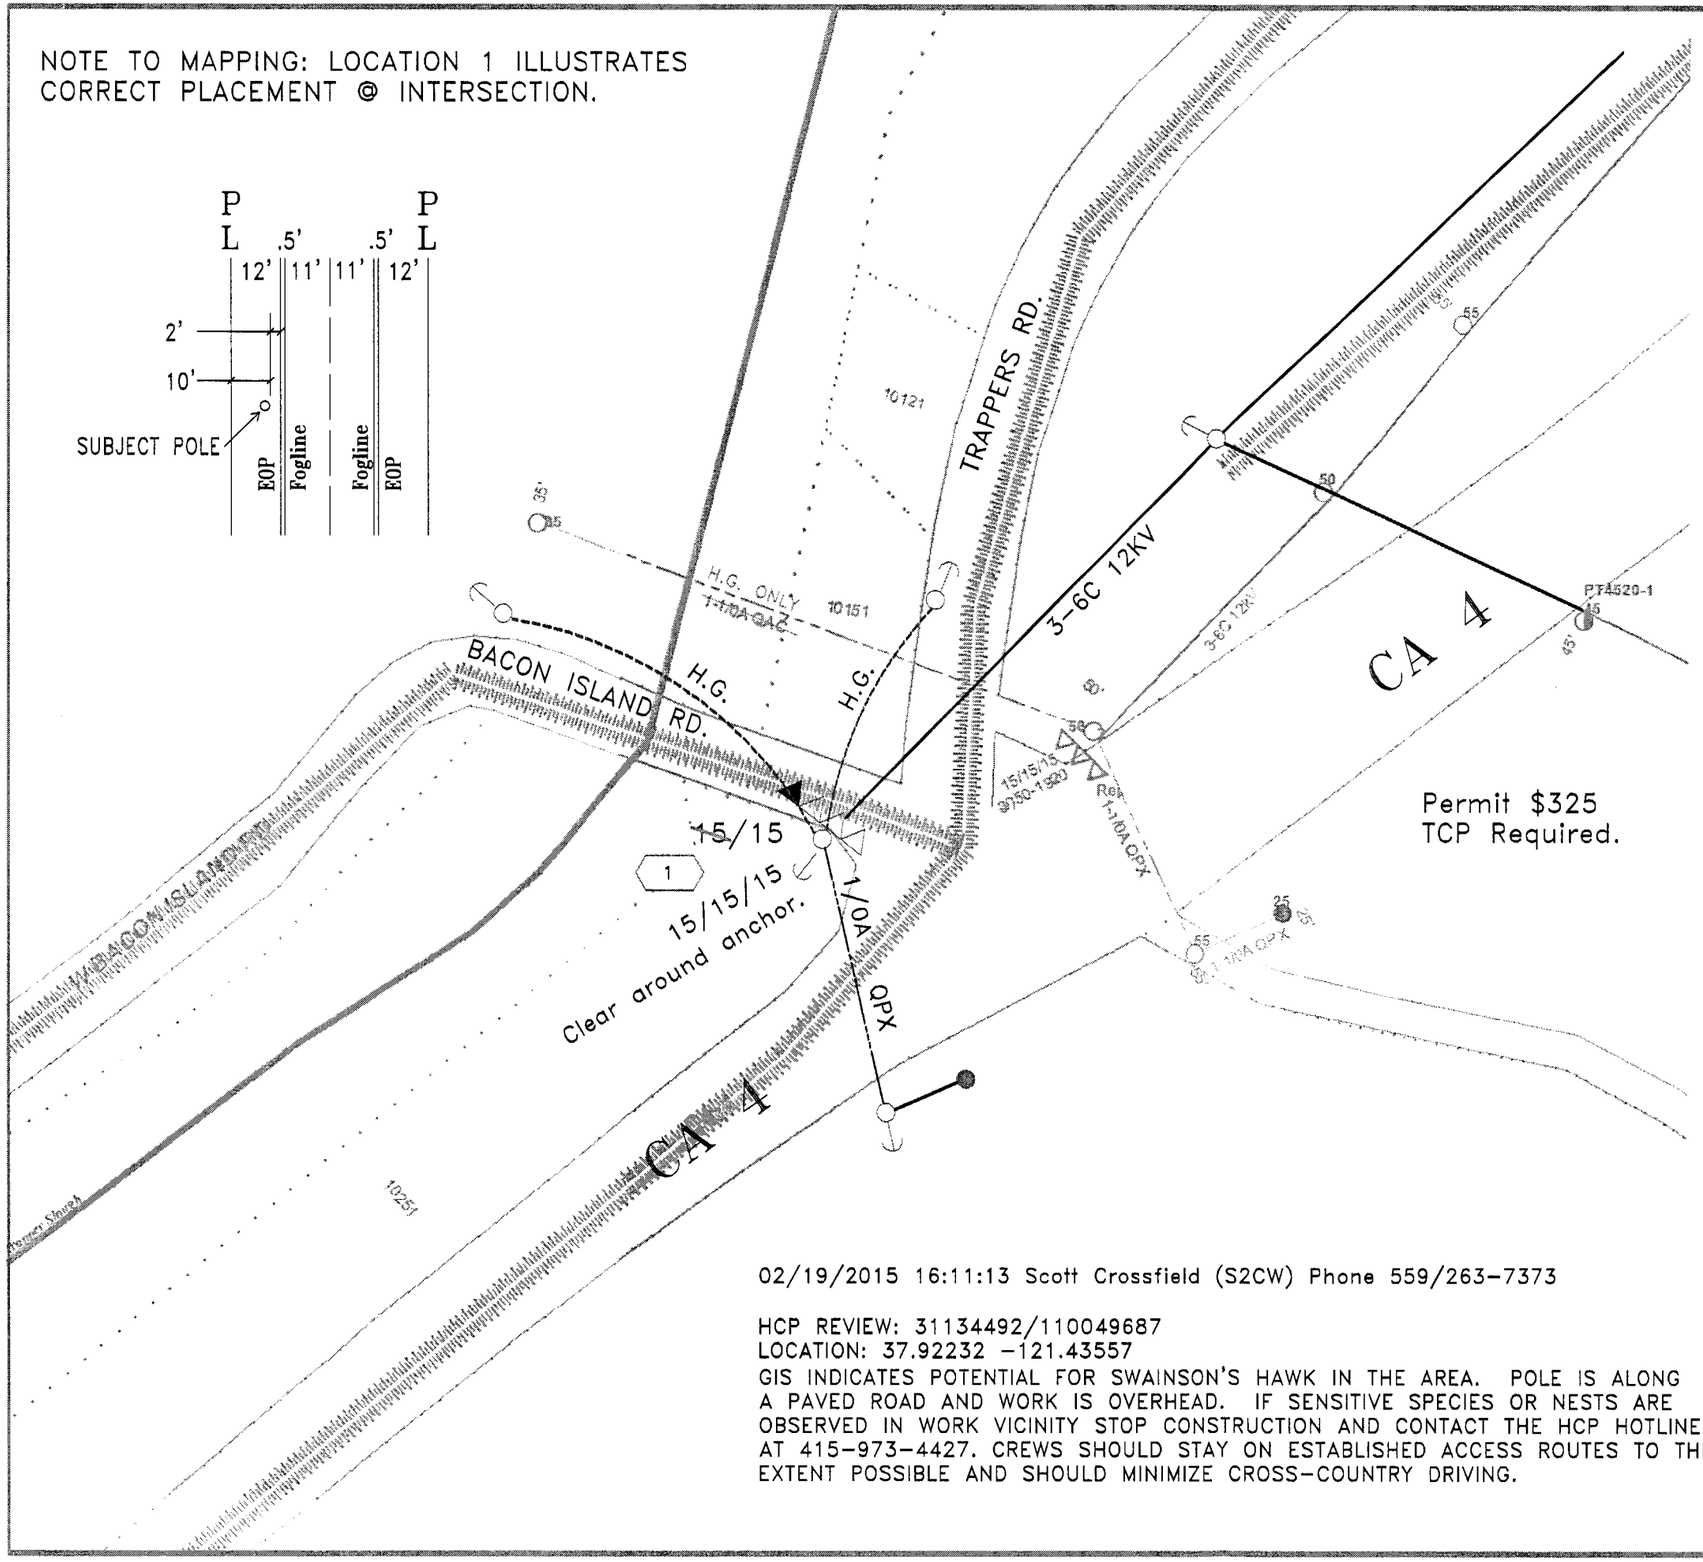

Permit $325
TCP Required.

Not #:109694852
Sap #:103113540
GPS: N 37° 55'20.48"
W121° 26'08.44"

ENVIRONMENTAL ISSUES

☐ NONE APPARENT
(IF PROJECT DESIGN CHANGES, CONTACT ADE)
☐ BASED ON APPLICANT/DEVELOPER-SUPPLIED PLANS

☐ PERMITS ☐ TAILBOARD ☒ OTHER

X

☐ APPLICANT DESIGN/RESPONSIBILITY
(CHECK PERMITS BOX IF PERMIT CONDITIONS APPLY TO PG&E ACTIONS.)

BY: _____
SIGNATURE, NAME, [CORPORATE ID], DATE

FIRE AREA NON-EXEMPT EQUIPMENT STAMP

Identify the Subject Pole Fire Area District (per Doc. #072148 and Utility Bulletin TD-2301B-004):

☐ FRA ☐ SRA ☒ LRA
☐ OWF ☐ UWF

Per the Power Line Fire Prevention Field Guide, the equipment being installed is:

☒ Exempt ☐ Non-Exempt ☐ N/A

☐ If Installing Non-Exempt Equipment in a Fire Area, verify in SAP that the the CN-25 has been activated.

By: _____
Signature, Name [Corp ID], Date

1

COORDINATE #
317305051920
LOADING DISTRICT
Summer Interior
TX SIZE - 15/15/15
KVA 1Ø - 13
KVA 3Ø - 0
% L.F. - 14

RAPTOR CONSTRUCTION

N

MAP: V07
ROUGH & READY SUB 1102
SSD: 7349
"B" INS. DIST.
12KV AREA
NON CORROSION
LIGHT LOADING, FIRE AREA

02/19/2015 16:11:13 Scott Crossfield (S2CW) Phone 559/263-7373

HCP REVIEW: 31134492/110049687
LOCATION: 37.92232 -121.43557
GIS INDICATES POTENTIAL FOR SWAINSON'S HAWK IN THE AREA. POLE IS ALONG A PAVED ROAD AND WORK IS OVERHEAD. IF SENSITIVE SPECIES OR NESTS ARE OBSERVED IN WORK VICINITY STOP CONSTRUCTION AND CONTACT THE HCP HOTLINE AT 415-973-4427. CREWS SHOULD STAY ON ESTABLISHED ACCESS ROUTES TO THE EXTENT POSSIBLE AND SHOULD MINIMIZE CROSS-COUNTRY DRIVING.

CO:
SD:
NOTIF.: 109694852
OTHER:
SHT: 1 OF 1 SHEETS
PM: 31134492
REV. 0

Replace 1 of 3 Transformers

12 KV Circuit
W. Bacon Island Rd. & Trappers Rd.
Stockton, CA

PACIFIC GAS AND ELECTRIC COMPANY

EST: DOS3 916-760-1958
ADE: SLI3 916-760-5311
SUPV: CKM7 916-760-1954
REP: KDV2 209-942-1622
PLNR:
SCALE: NTS
DATE: 5/14/15