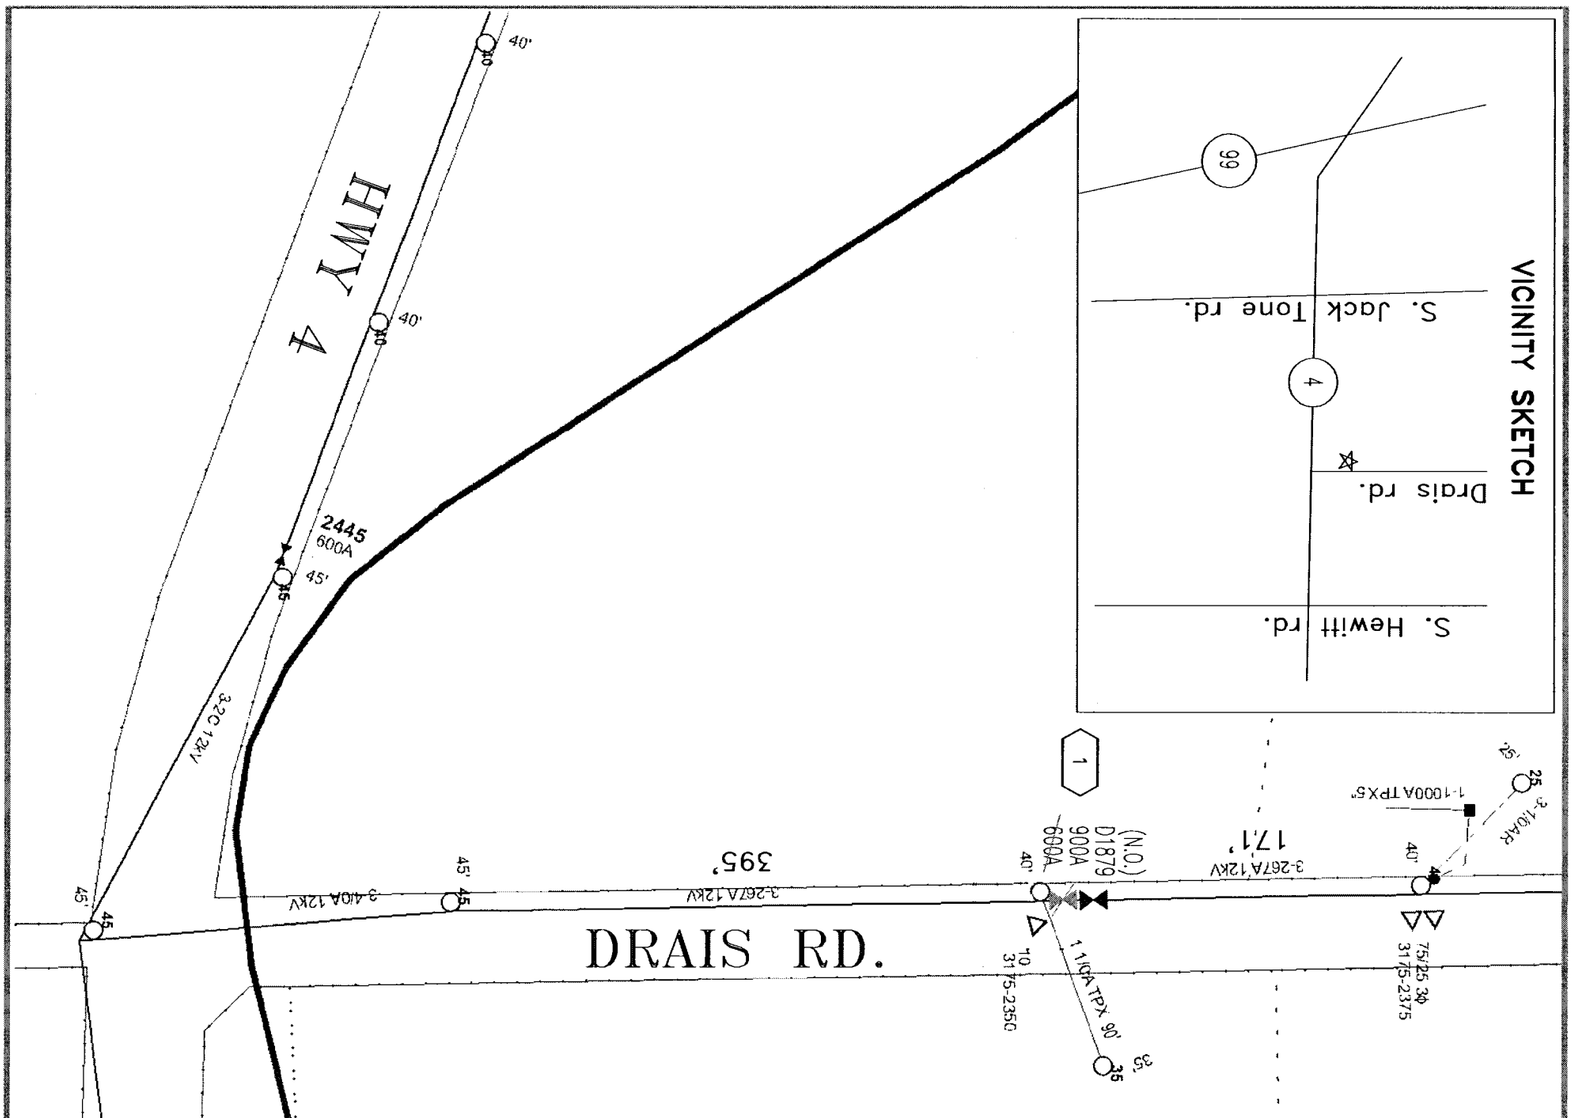

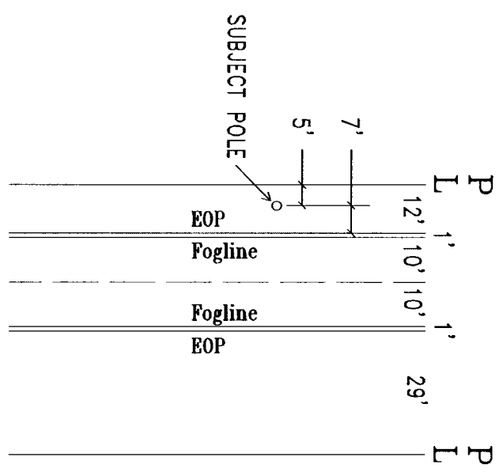

Not #:109259561
SapP #:102093572
GPS: N 37° 93629
W121° 08446

MAP: V16
SUB.MORMAN-1102 CIRCUIT
SSD: 2445
"B" INS. DIST.
12KV AREA
NON CORROSION
LIGHT LOADING, FIRE AREA

RAPTOR CONSTRUCTION

FIRE AREA NON-EXEMPT EQUIPMENT STAMP

Identify the Subject Pole Fire Area District (per Doc. #07248 and Utility Bulletin TD-2301B-004):
☐ FRA ☐ SRA ☒ LRA
☐ OWF ☐ UWF

Per the Power Line Fire Prevention Field Guide, the equipment being installed is:
☒ Exempt ☐ Non-Exempt ☐ N/A
☐ If installing Non-Exempt Equipment in a Fire Area, verify in SAP that the the CN-25 has been activated.

By: _____
Signature, Name [Corp ID], Date

APPLICANT DESIGN/RESPONSIBILITY
(CHECK PERMITS BOX IF PERMIT CONDITIONS APPLY TO PG&E ACTIONS.)
☐ APPLICANT
BY: **SEE COMPLETED DM3**
SIGNATURE, NAME, [CORPORATE ID], DATE

ENVIRONMENTAL ISSUES
☒ NONE APPARENT
(IF PROJECT DESIGN CHANGES, CONTACT ADE)
☐ BASED ON APPLICANT/DEVELOPER-SUPPLIED PLANS
☐ PERMITS ☐ TAILBOARD ☐ OTHER
X

EST: DOS3 916-760-1958		CO:	
ADE: GFH4 916-760-1946		SD:	
SUPV: CKM7 916-760-1954		NOTIF.: 109259561	
REP: AJLA 916-723-5211		OTHER:	
PLNR:		SHT: 1 OF 1	SHEETS
SCALE: NTS	DATE: 5/28/15	PM: 31134483	REV. 0

12KV CONSTRUCTION DRAWING

REPLACE O.H. SWITCH
3754 DRAIS RD.HWY 4
FARMINGTON, CA

PACIFIC GAS AND ELECTRIC COMPANY