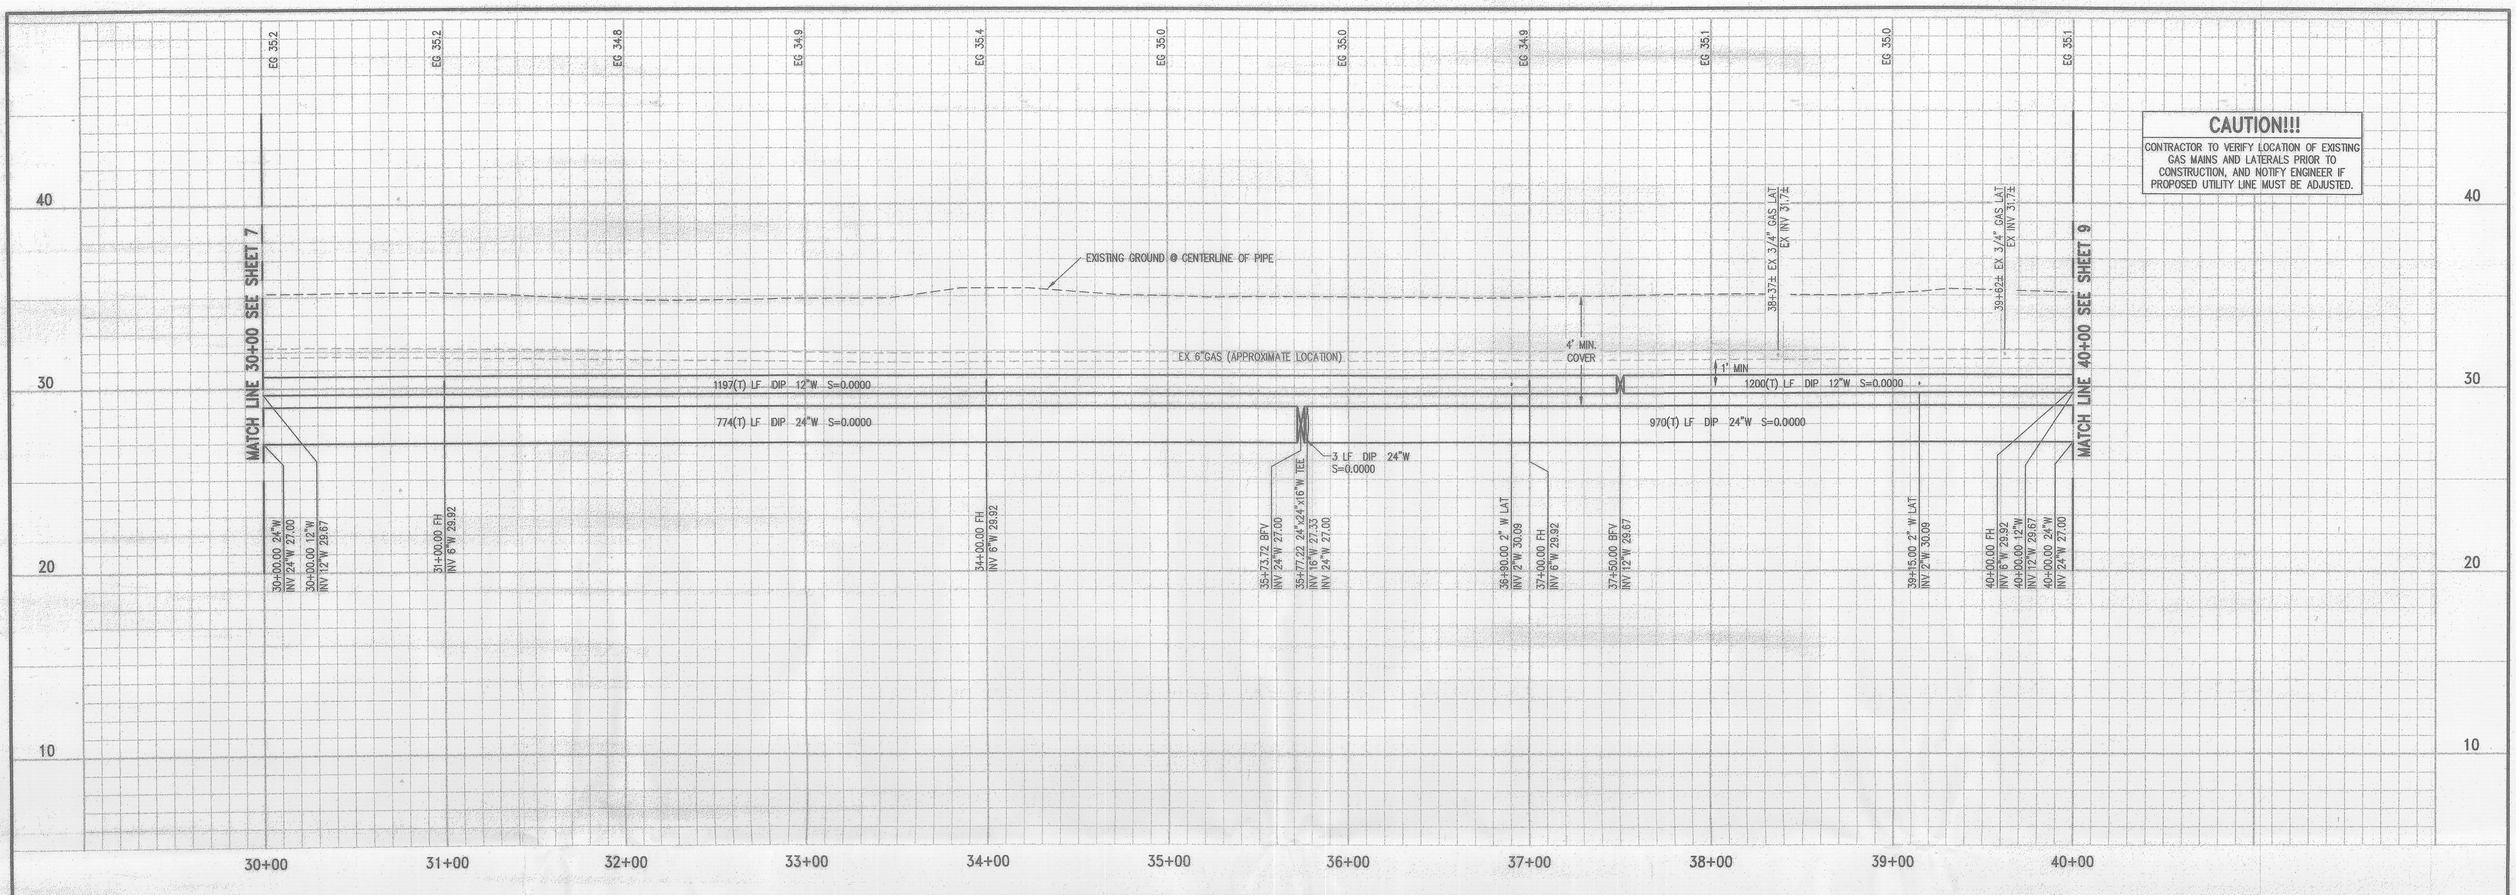

CAUTION!!!

CONTRACTOR TO VERIFY LOCATION OF EXISTING GAS MAINS AND LATERALS PRIOR TO CONSTRUCTION, AND NOTIFY ENGINEER IF PROPOSED UTILITY LINE MUST BE ADJUSTED.

TRANSMISSION MAIN (30+00 - 40+00)

SCALE: HORIZONTAL 1" = 40'
VERTICAL 1" = 4'

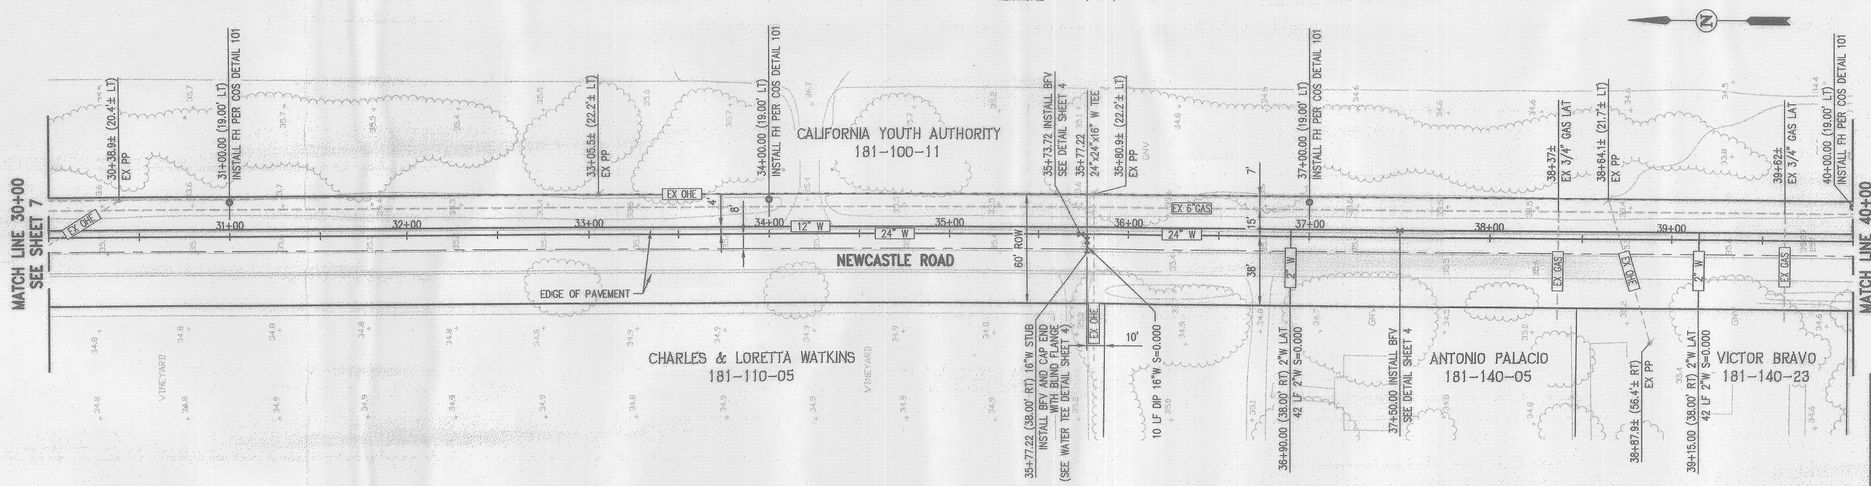

NOTES:

1. NEWCASTLE ROAD SHALL BE OVERLAYED 2", THE ENTIRE 24'± WIDTH AFTER THE TRENCH IS BACKFILLED AND PATCHED.
2. ANY ABOVE GROUND AIR RELIEF OR BLOW OFF APPURTENANCES SHALL EITHER BE UNDER GROUND IN A TRAFFIC BEARING BOX OR AWAY FROM EXISTING AND FUTURE TRAVEL WAY OF THE PUBLIC ROAD WITH ASSHTO RECOMMENDED CLEARANCES. EASEMENTS WILL BE SECURED FROM PRIVATE PROPERTY IF CLEAR ZONES ARE NOT ACHIEVABLE.
3. FOR CATHODIC PROTECTION IMPROVEMENTS SEE SHEETS CP-1 TO CP-5 PREPARED BY JDH CORROSION CONSULTANTS, INC.

cbg Carlson, Barbee & Gibson, Inc.
CIVIL ENGINEERS • SURVEYORS • PLANNERS
6111 BOLLINGER CANYON ROAD, SUITE 150
SAN RAMON, CALIFORNIA 94583
(925) 866-0322
FAX (925) 866-8575

REGISTERED PROFESSIONAL ENGINEER L. F. CARR No. 56... 07/31/10 CIVIL STATE OF CALIFORNIA

DIGALERT
DIAL TOLL FREE 1-800-227-2600
AT LEAST TWO DAYS BEFORE YOU DIG
UNDERGROUND SERVICE ALERT OF NORTHERN CALIFORNIA

REVISION NO.	REVISION	DATE	BY	APRVD. BY

NEWCASTLE TRANSMISSION MAIN

TRANSMISSION MAIN (30+00 - 40+00)

MUNICIPAL UTILITIES DEPARTMENT
CITY OF STOCKTON, CALIFORNIA

SCALE: 1"=40'
DESIGNED BY: M.J.S.
DRAWN BY: G.S.
CHECKED BY: L.F.C.
RECORD DWG: ---

APPROVED BY: DATE: 8/10/10
ASSISTANT DIRECTOR
STOCKTON, CALIFORNIA

SHEET NO. 8 OF 34 SHEETS
PROJECT NO. M07004

8/26/2010 10:10 AM
L:\1557\ACAD\P\P08.DWG