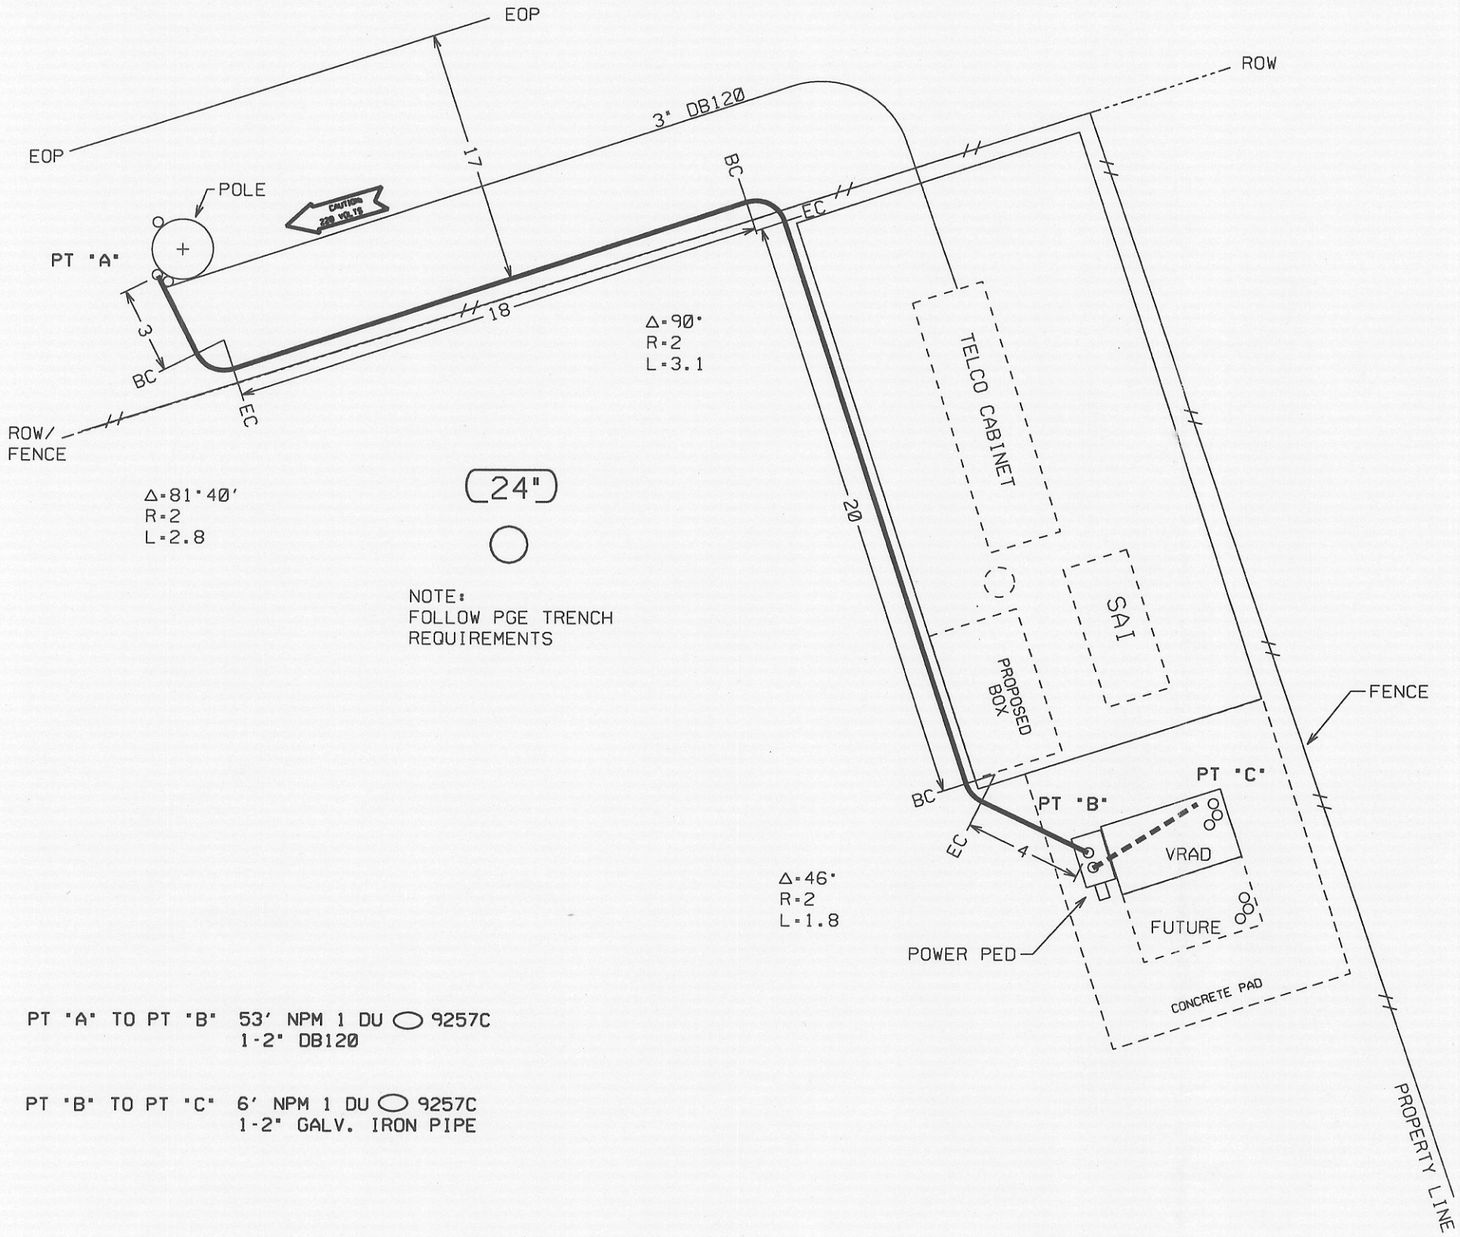

PT "A" TO PT "B" 53' NPM 1 DU ⬭ 9257C
1-2" DB120

PT "B" TO PT "C" 6' NPM 1 DU ⬭ 9257C
1-2" GALV. IRON PIPE

PLACE #2 GROUND WIRE FROM VRAD TO SAI
PER ATT-TELCO-JA-000-000-599 SECTION 7.2

CONFIDENTIAL
SOLELY FOR USE BY EMPLOYEES OF AT&T WHO HAVE A NEED TO KNOW. NOT TO BE DISCLOSED TO OR USED BY ANY OTHER PERSON WITHOUT PRIOR AUTHORIZATION

CALL USA
800-227-2600
BEFORE DIGGING

CAUTION!
LOCATION & DEPTH OF EXISTING SUBSTRUCTURES ARE NOT GUARENTEED. OTHER SUBSURFACE STRUCTURES NOT SHOWN MAY EXIST.

NOTE: ALL OTHER CABLES OMITTED FOR CLARITY.

M.O.P. REQUIRED
CATEGORY # 3
FOLLOW PROCEDURES AS DETAILED IN NORTHERN SECTOR PLAN FOE PROTECTION OF UNDERGROUND AND BURIED CABLES
M.O.P. DATED:

POWER CONDUIT
1"=5'-00"

ALL MEASUREMENTS IN FEET
UNLESS NOTED OTHERWISE

ABM: 589C, 589D



at&t	Ref: UE1141S			Date Req:
RNO (ARES):	Geo Loc: UE73	WC: STOCKTON MAIN		Date Issued: 1/10
Municipality: STOCKTON	County: SJC	Township:	¼Sec:	Tax Dist: 29866626
Location & Description: 526 E MARSH FTTN NODE				
ENG'R ARC: VØKDELD20	ENGINEER: TY WESTON	Tel#: 209-474-4366	PLR:	
REVISIONS:			Maj. Code:	
			EWO: 7612769	DESIGN #
			PRINT	OF