
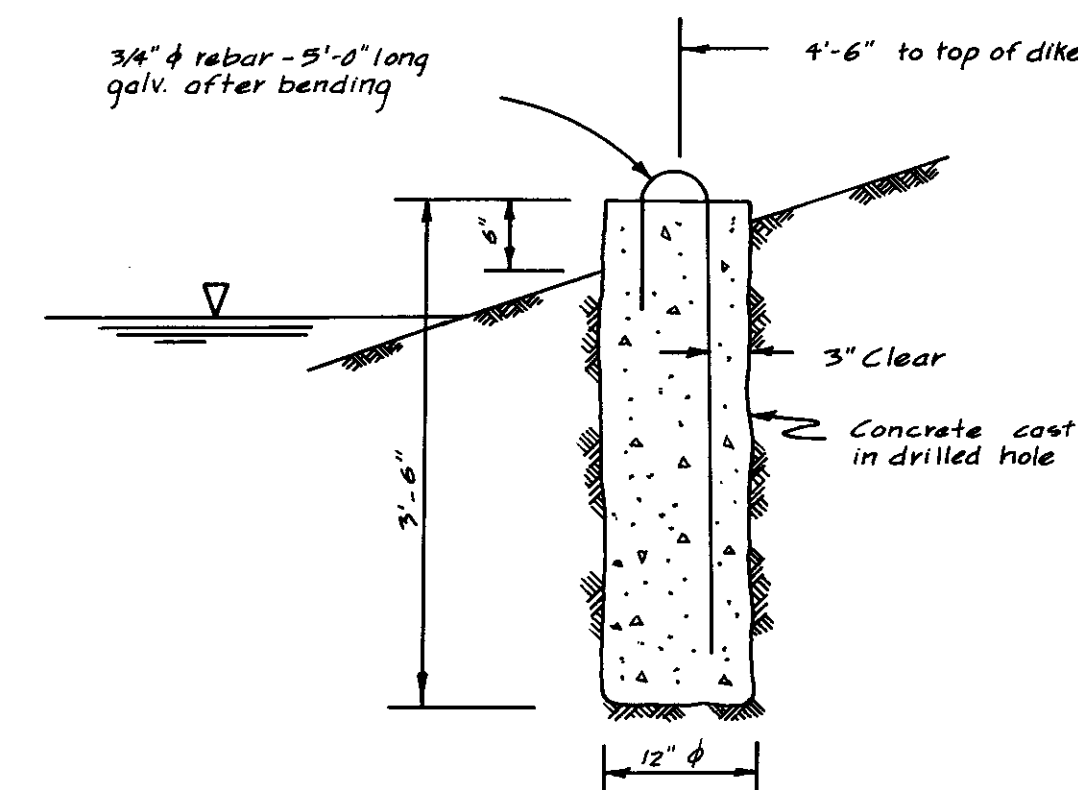
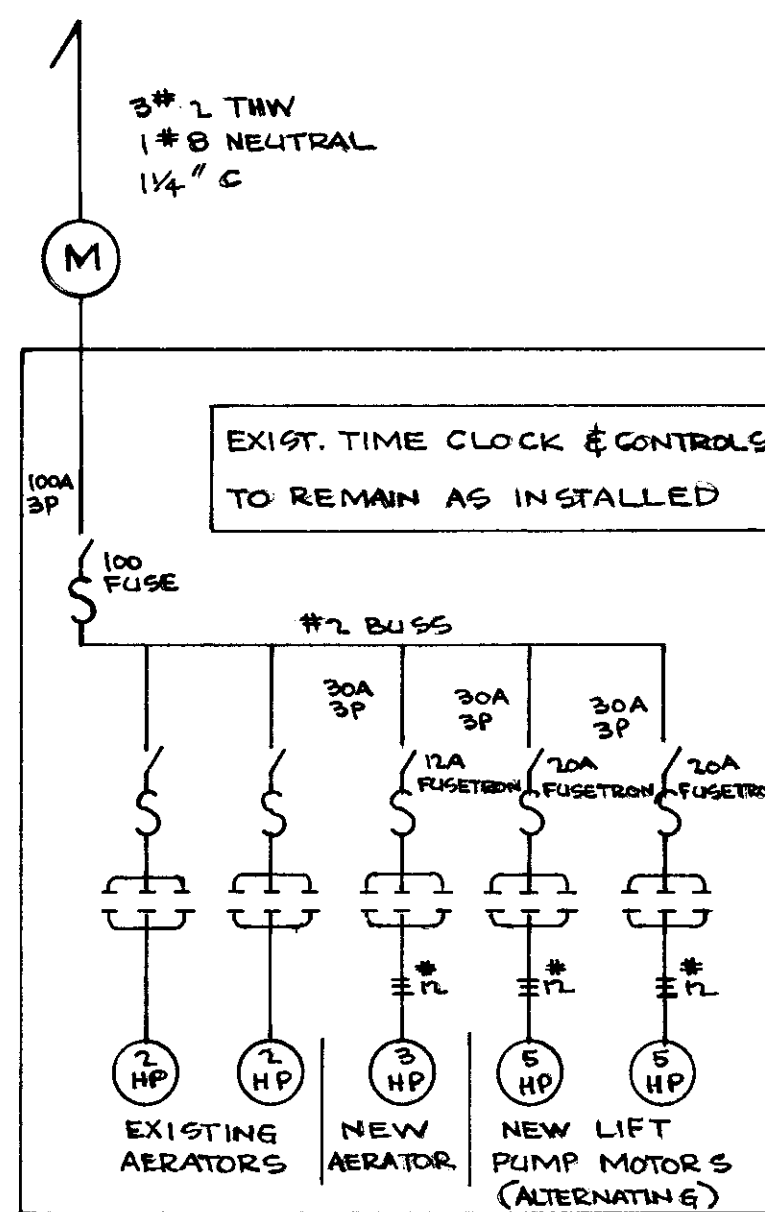
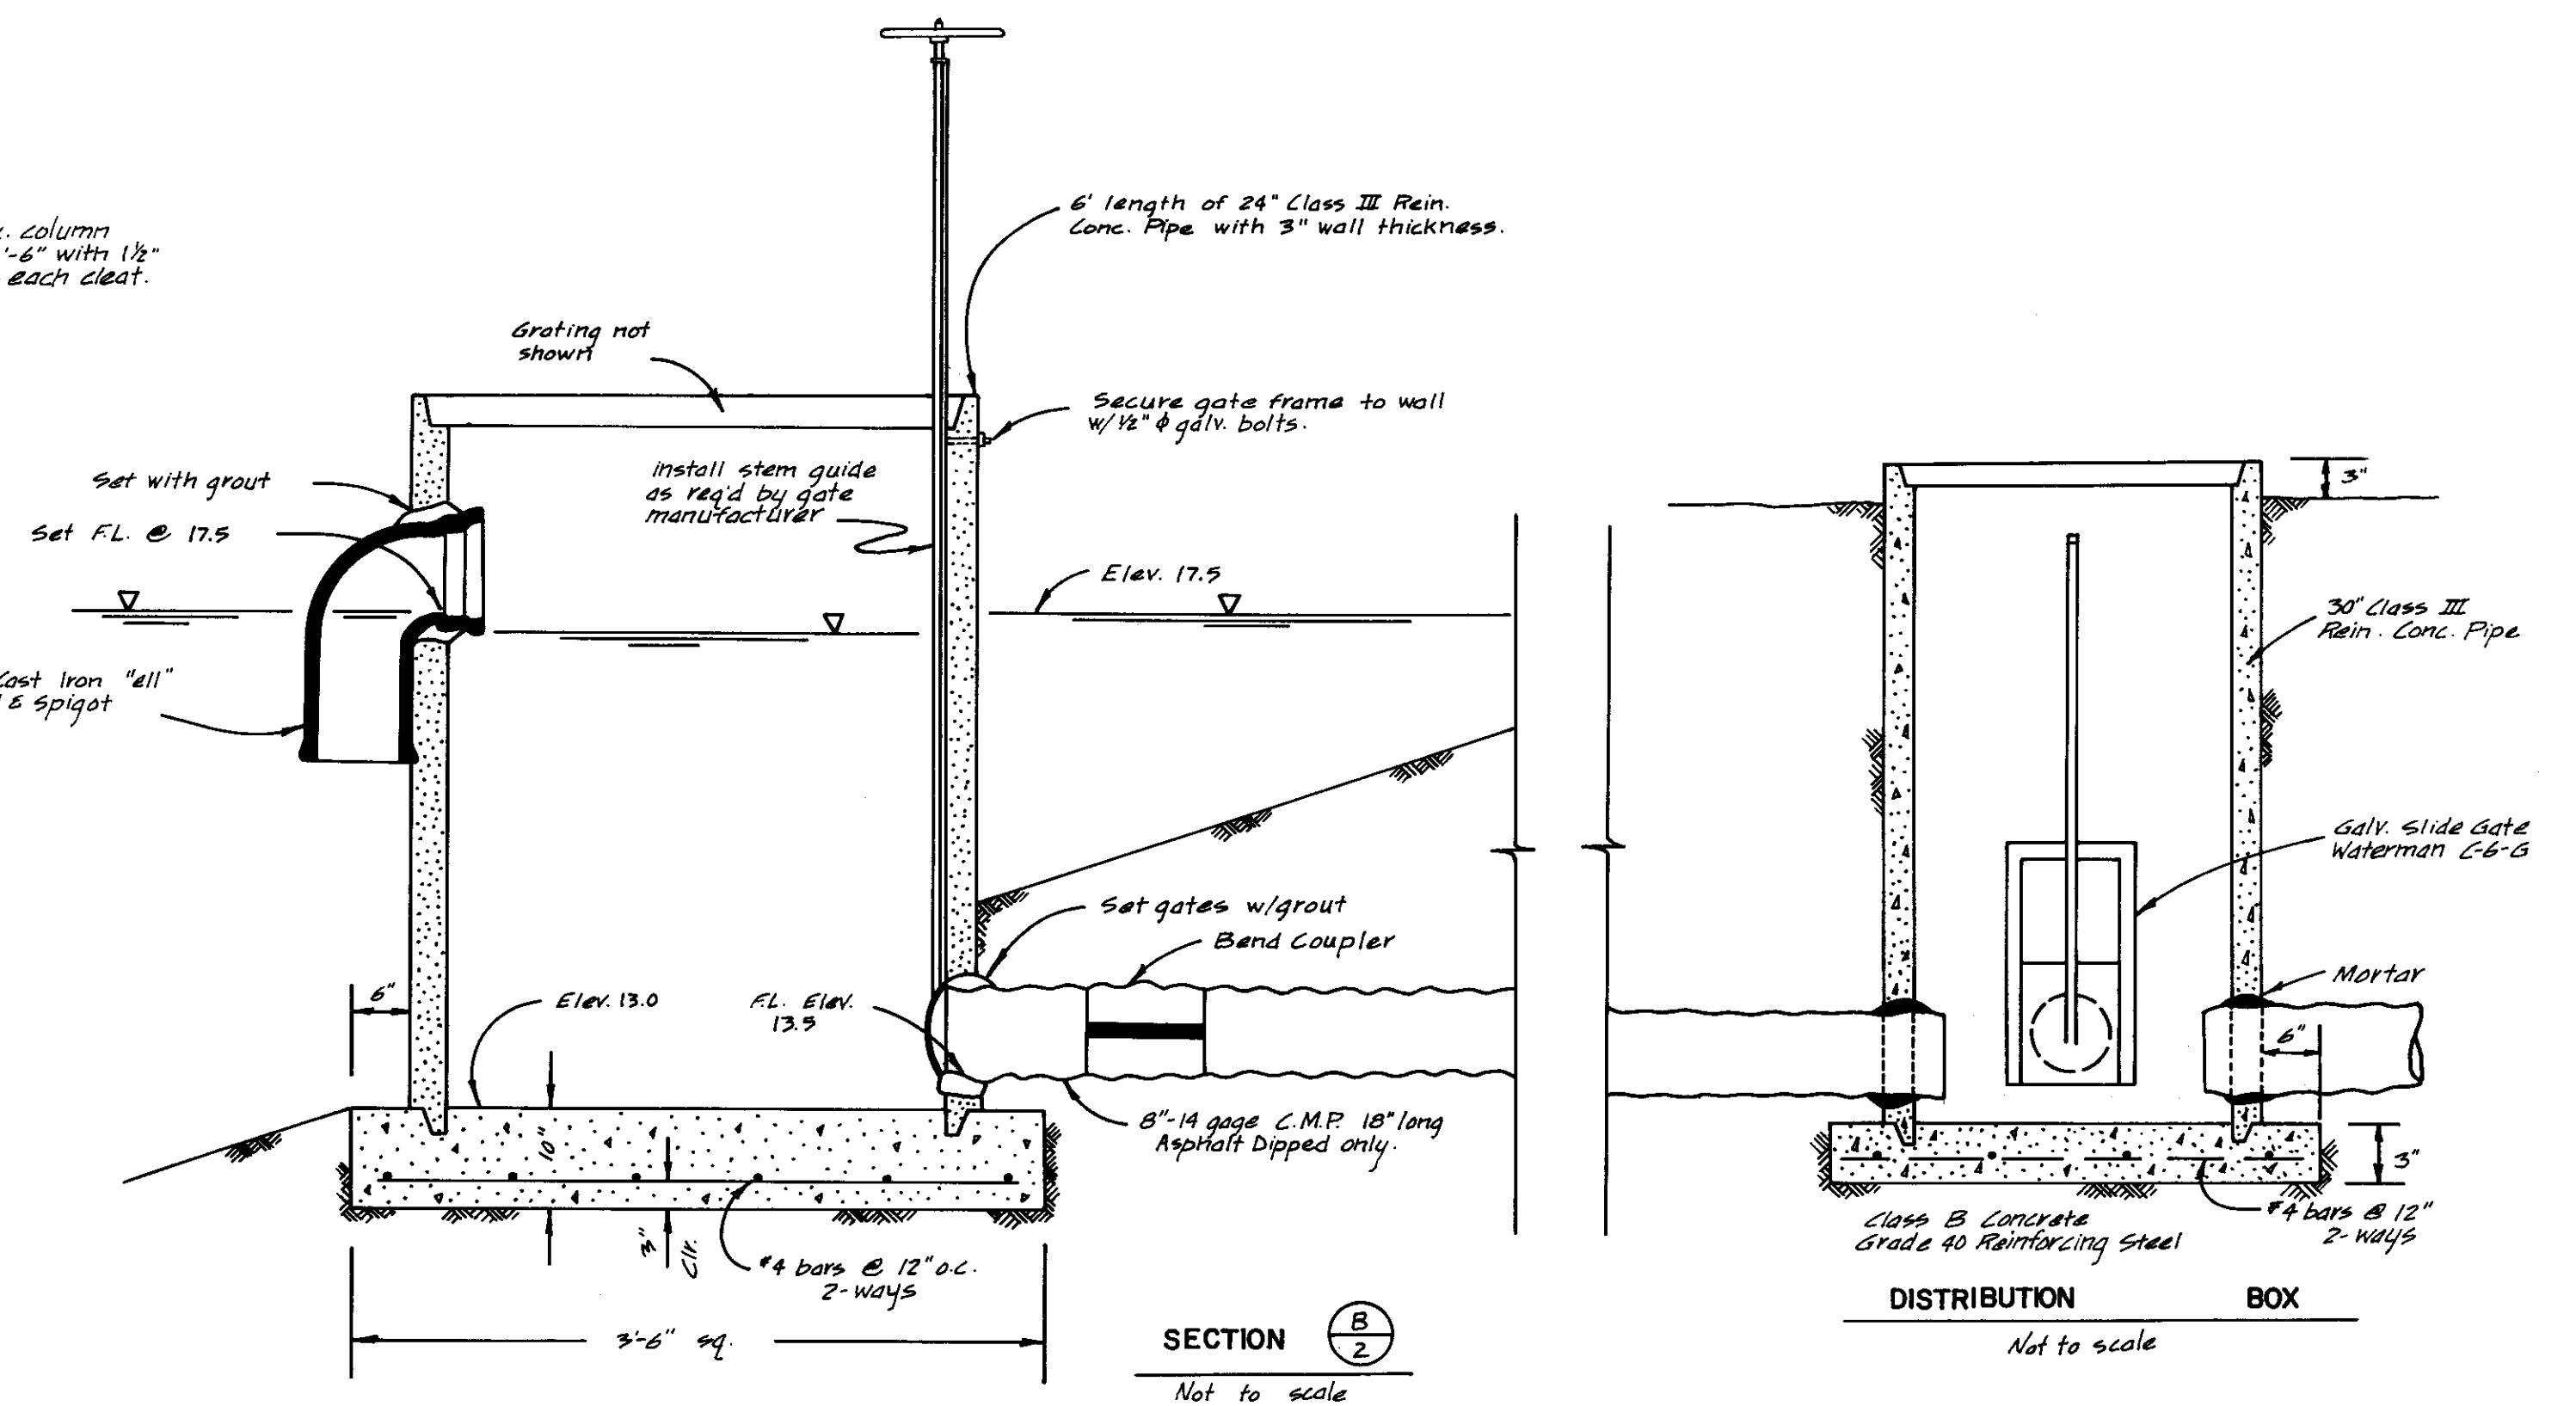
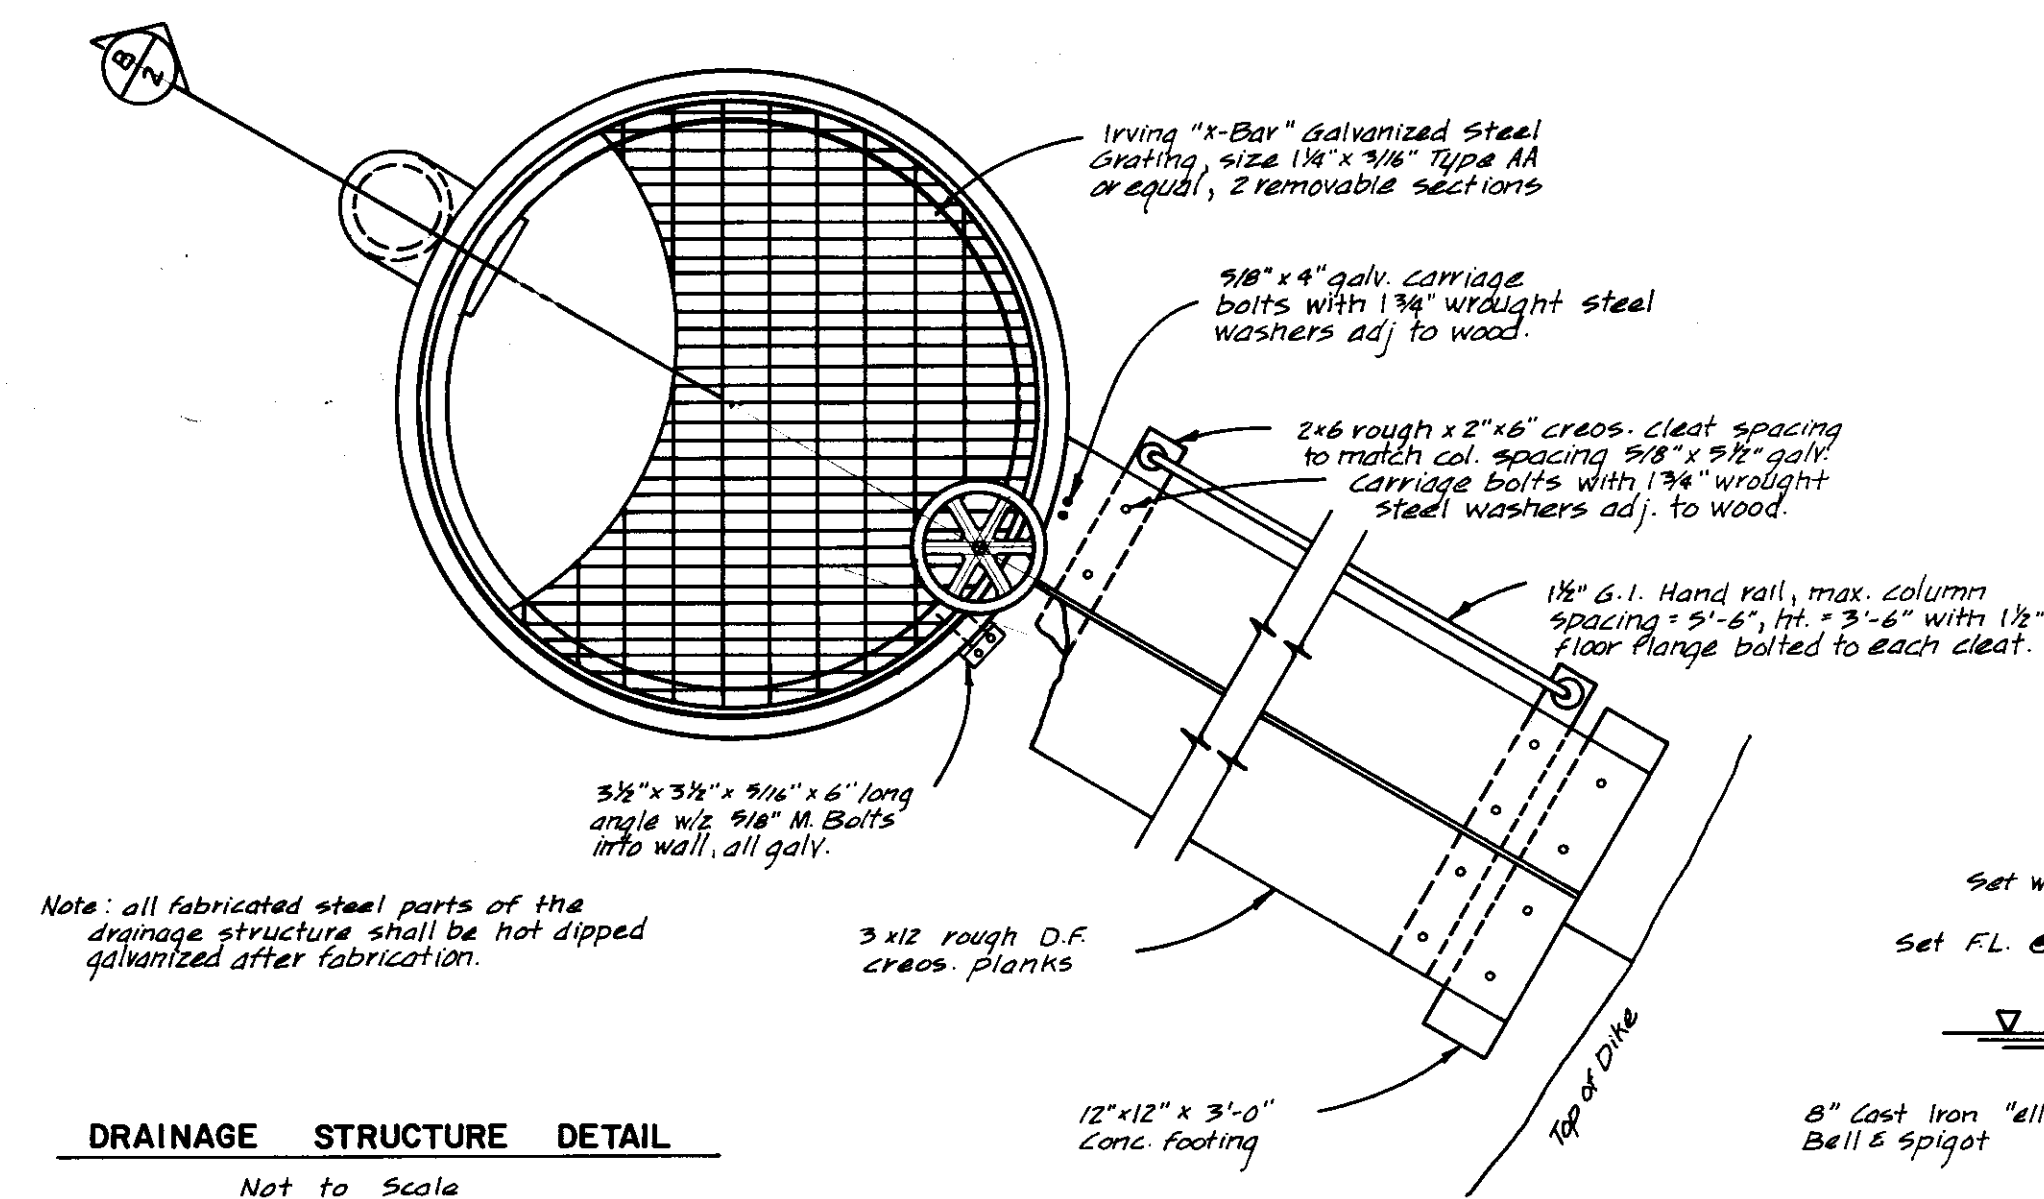


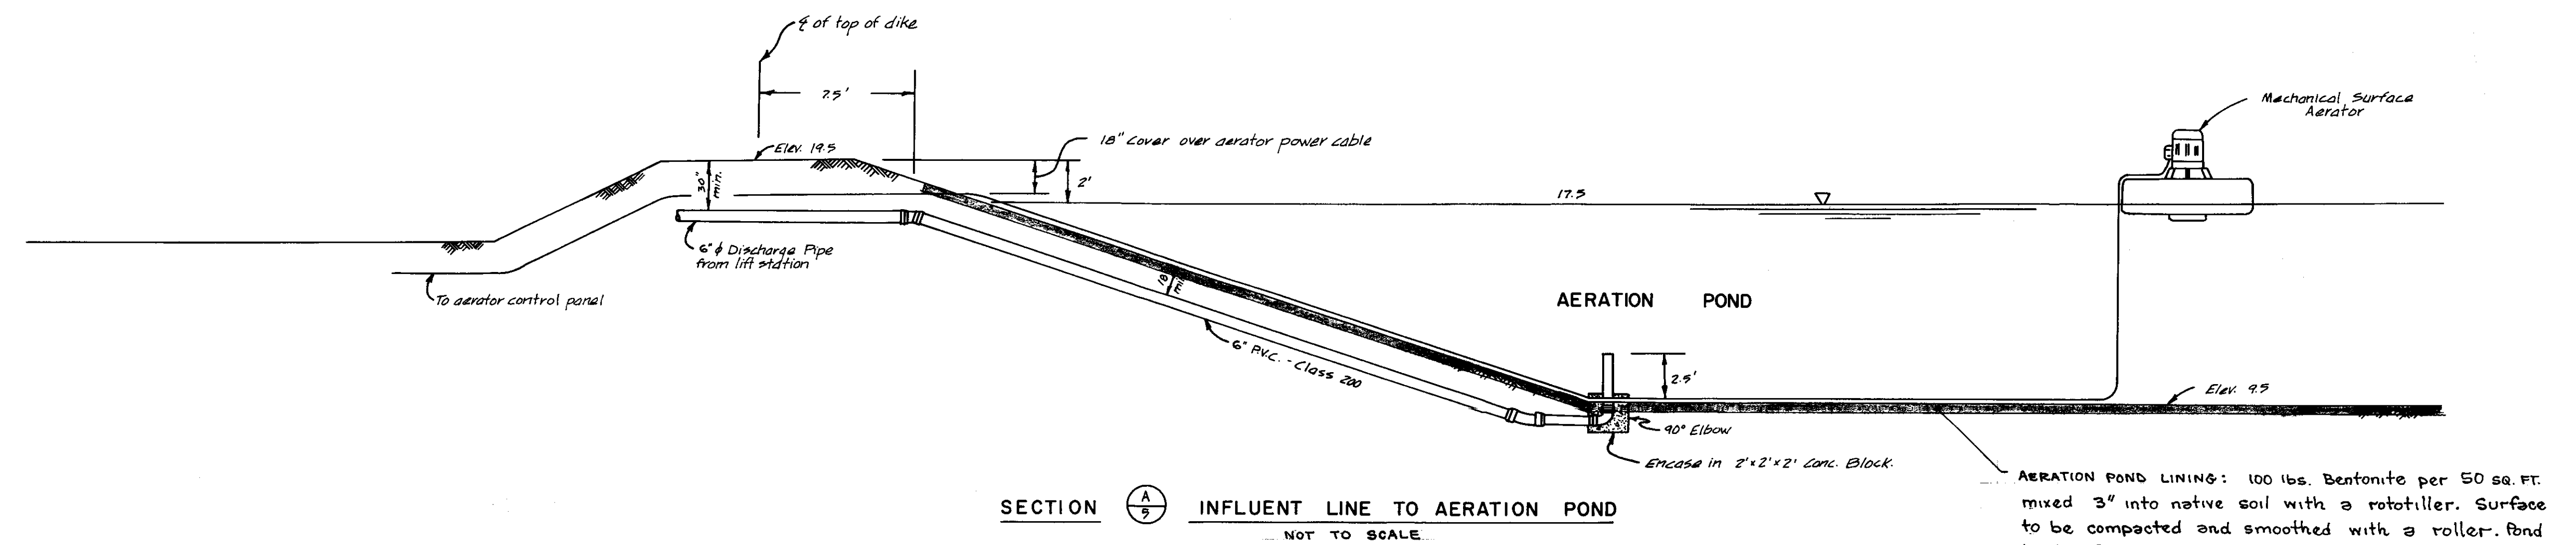

GENERAL NOTES

- 1- EXISTING LIFT STATION TO REMAIN - NEW 5HP PUMP MOTORS TO BE INSTALLED REPLACING 1 HP MOTORS.
- 2- CONTRACTOR SHALL PULL ONE PUMP AT A TIME AND CHANGE IMPELLERS TO THOSE FURNISHED BY CHICAGO PUMP CO.
- 3- ONE PUMP SHALL REMAIN IN SERVICE AT ALL TIMES.
- 4- A NEW 3HP AERATOR TO BE INSTALLED IN NEW AERATION POND IN ADDITION TO THE TWO EXISTING 2 HP AERATORS.

APPROVED Aug 24 19 77

SAN JOAQUIN COUNTY BUILDING DEPT.

APPROVED _____ 19 _____

SAN JOAQUIN LOCAL HEALTH DISTRICT

APPROVED _____ 19 _____

SAN JOAQUIN COUNTY PUBLIC WORKS DEPT.

revisions			
no.	description	date	by





WONG ENGINEERS
PLANNING • ENGINEERING • SURVEYING
STOCKTON, CALIFORNIA

R.C.E. No. 14269

job no. 1448
date AUG, 1978
scale AS SHOWN
drawn D.R.K.
design C.C.W.
check C.C.W.


SEWAGE TREATMENT PLANT EXPANSION
FOR LATHROP ACRES SEWER MAINTENANCE DISTRICT

SHEET
2
OF TWO
FILE

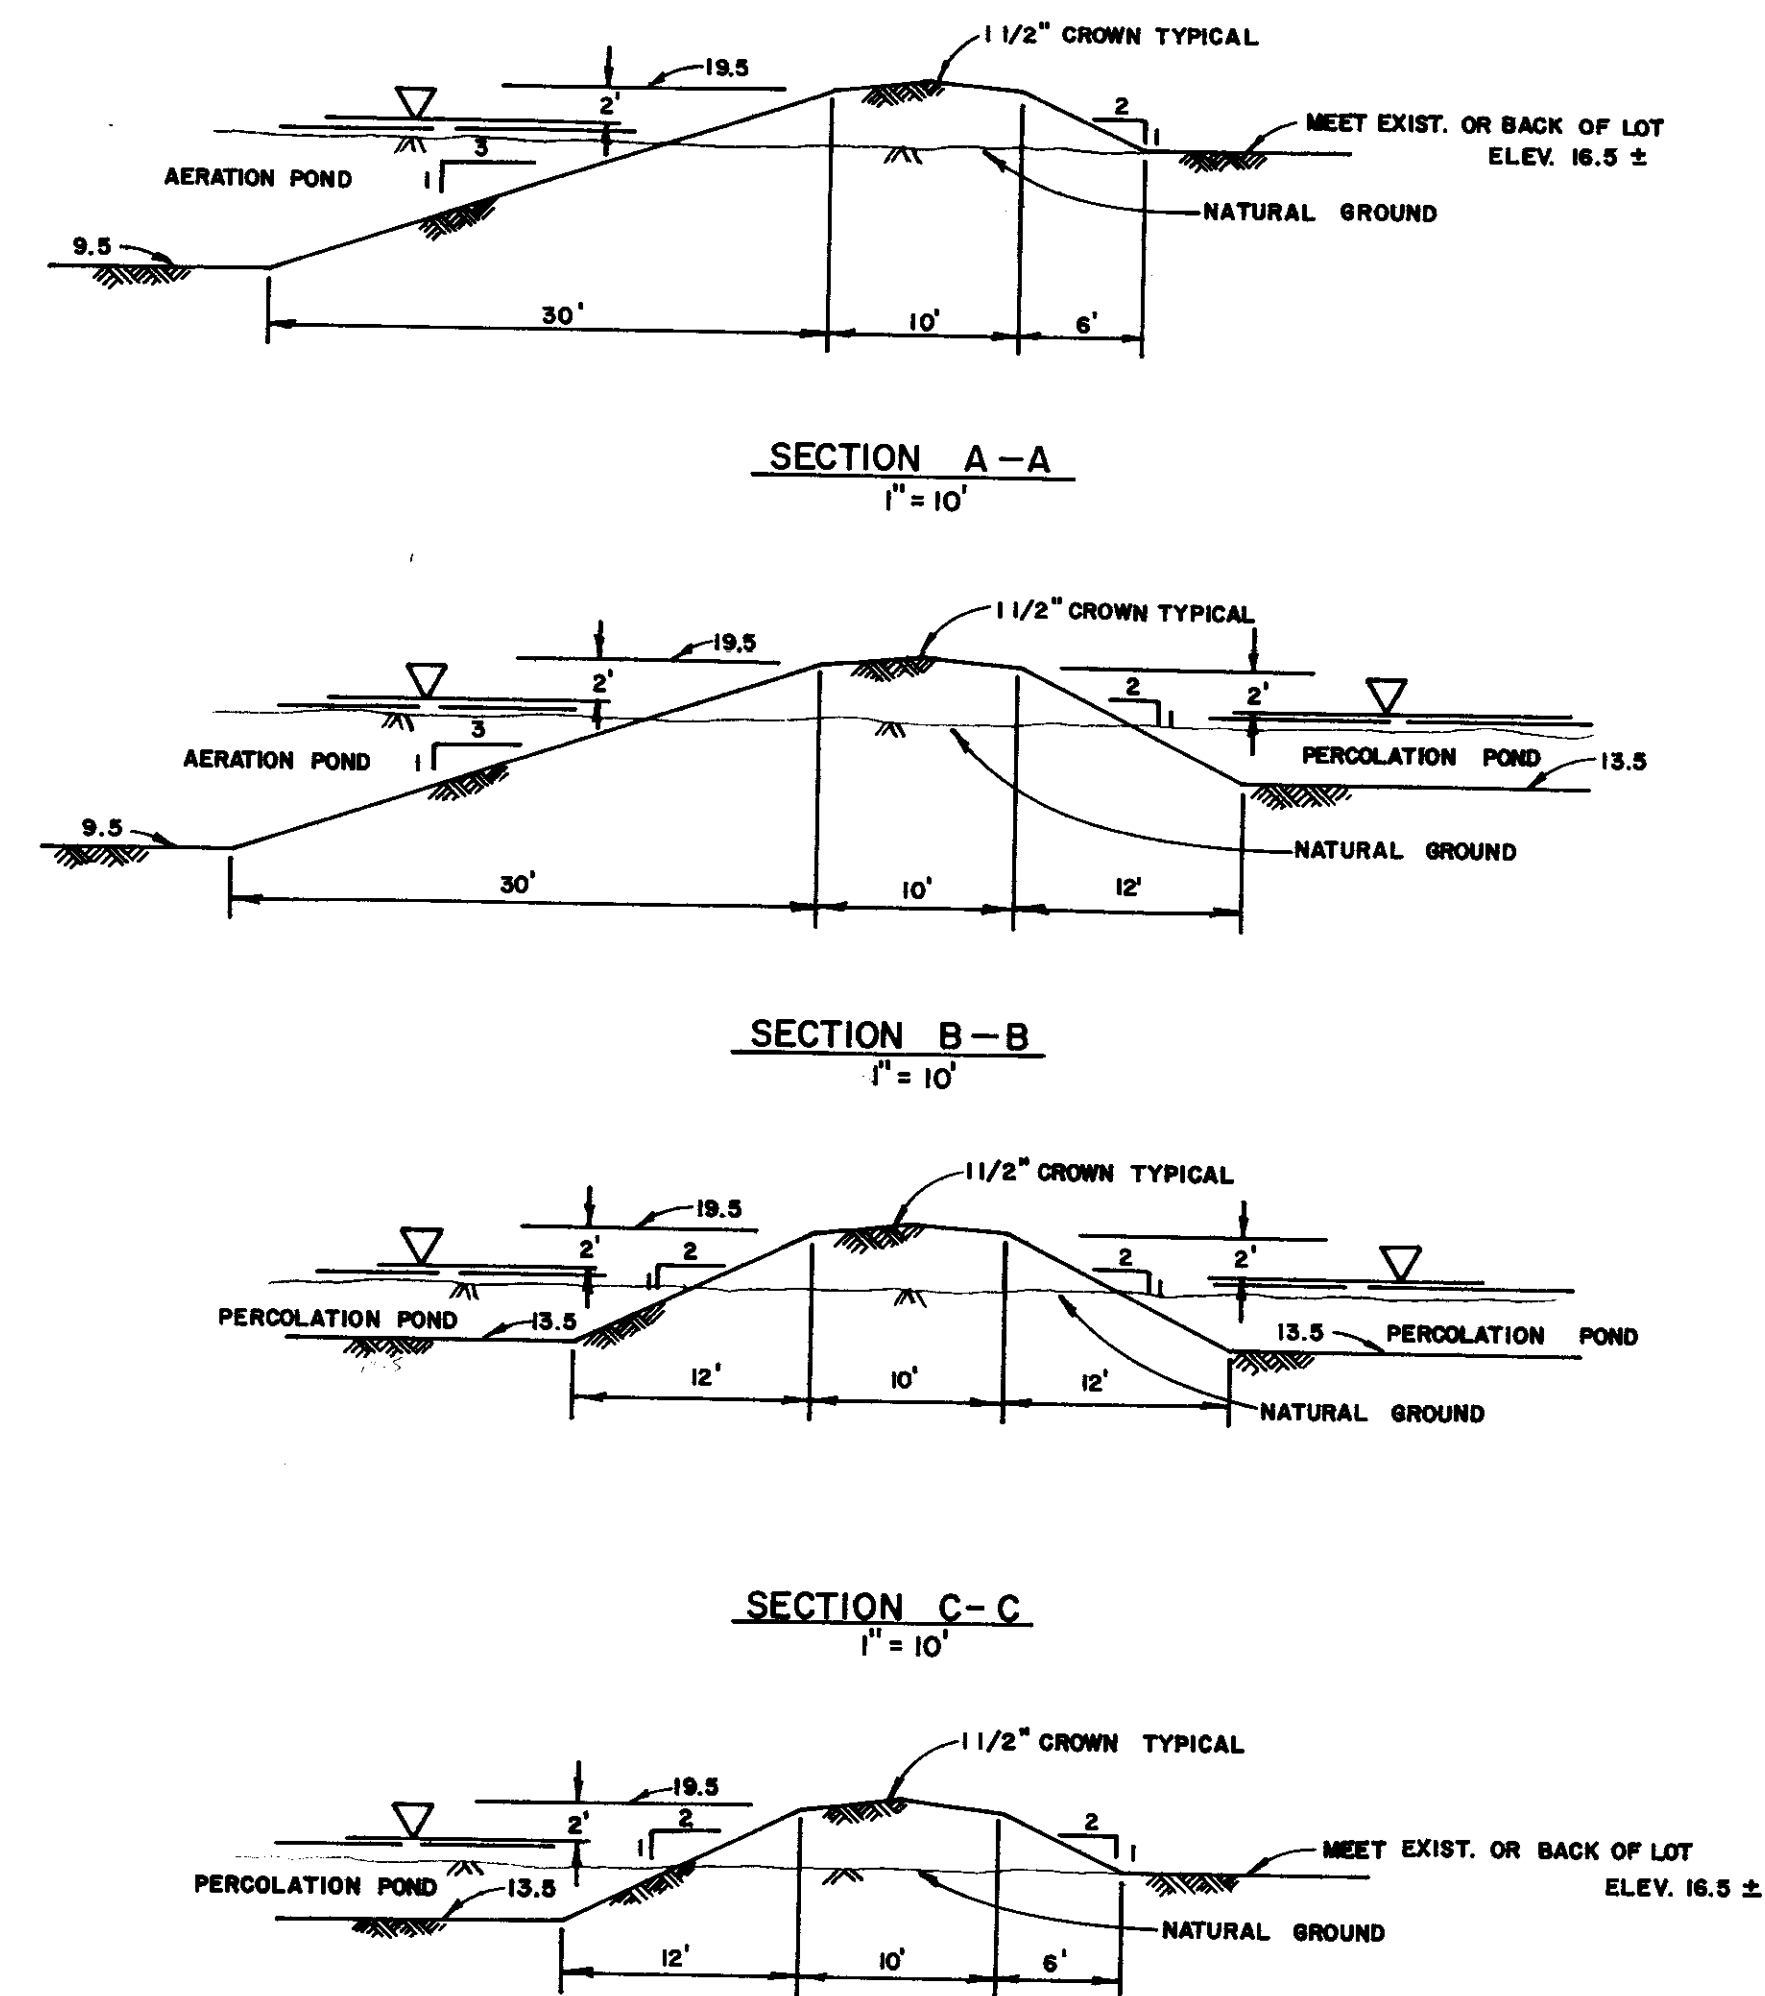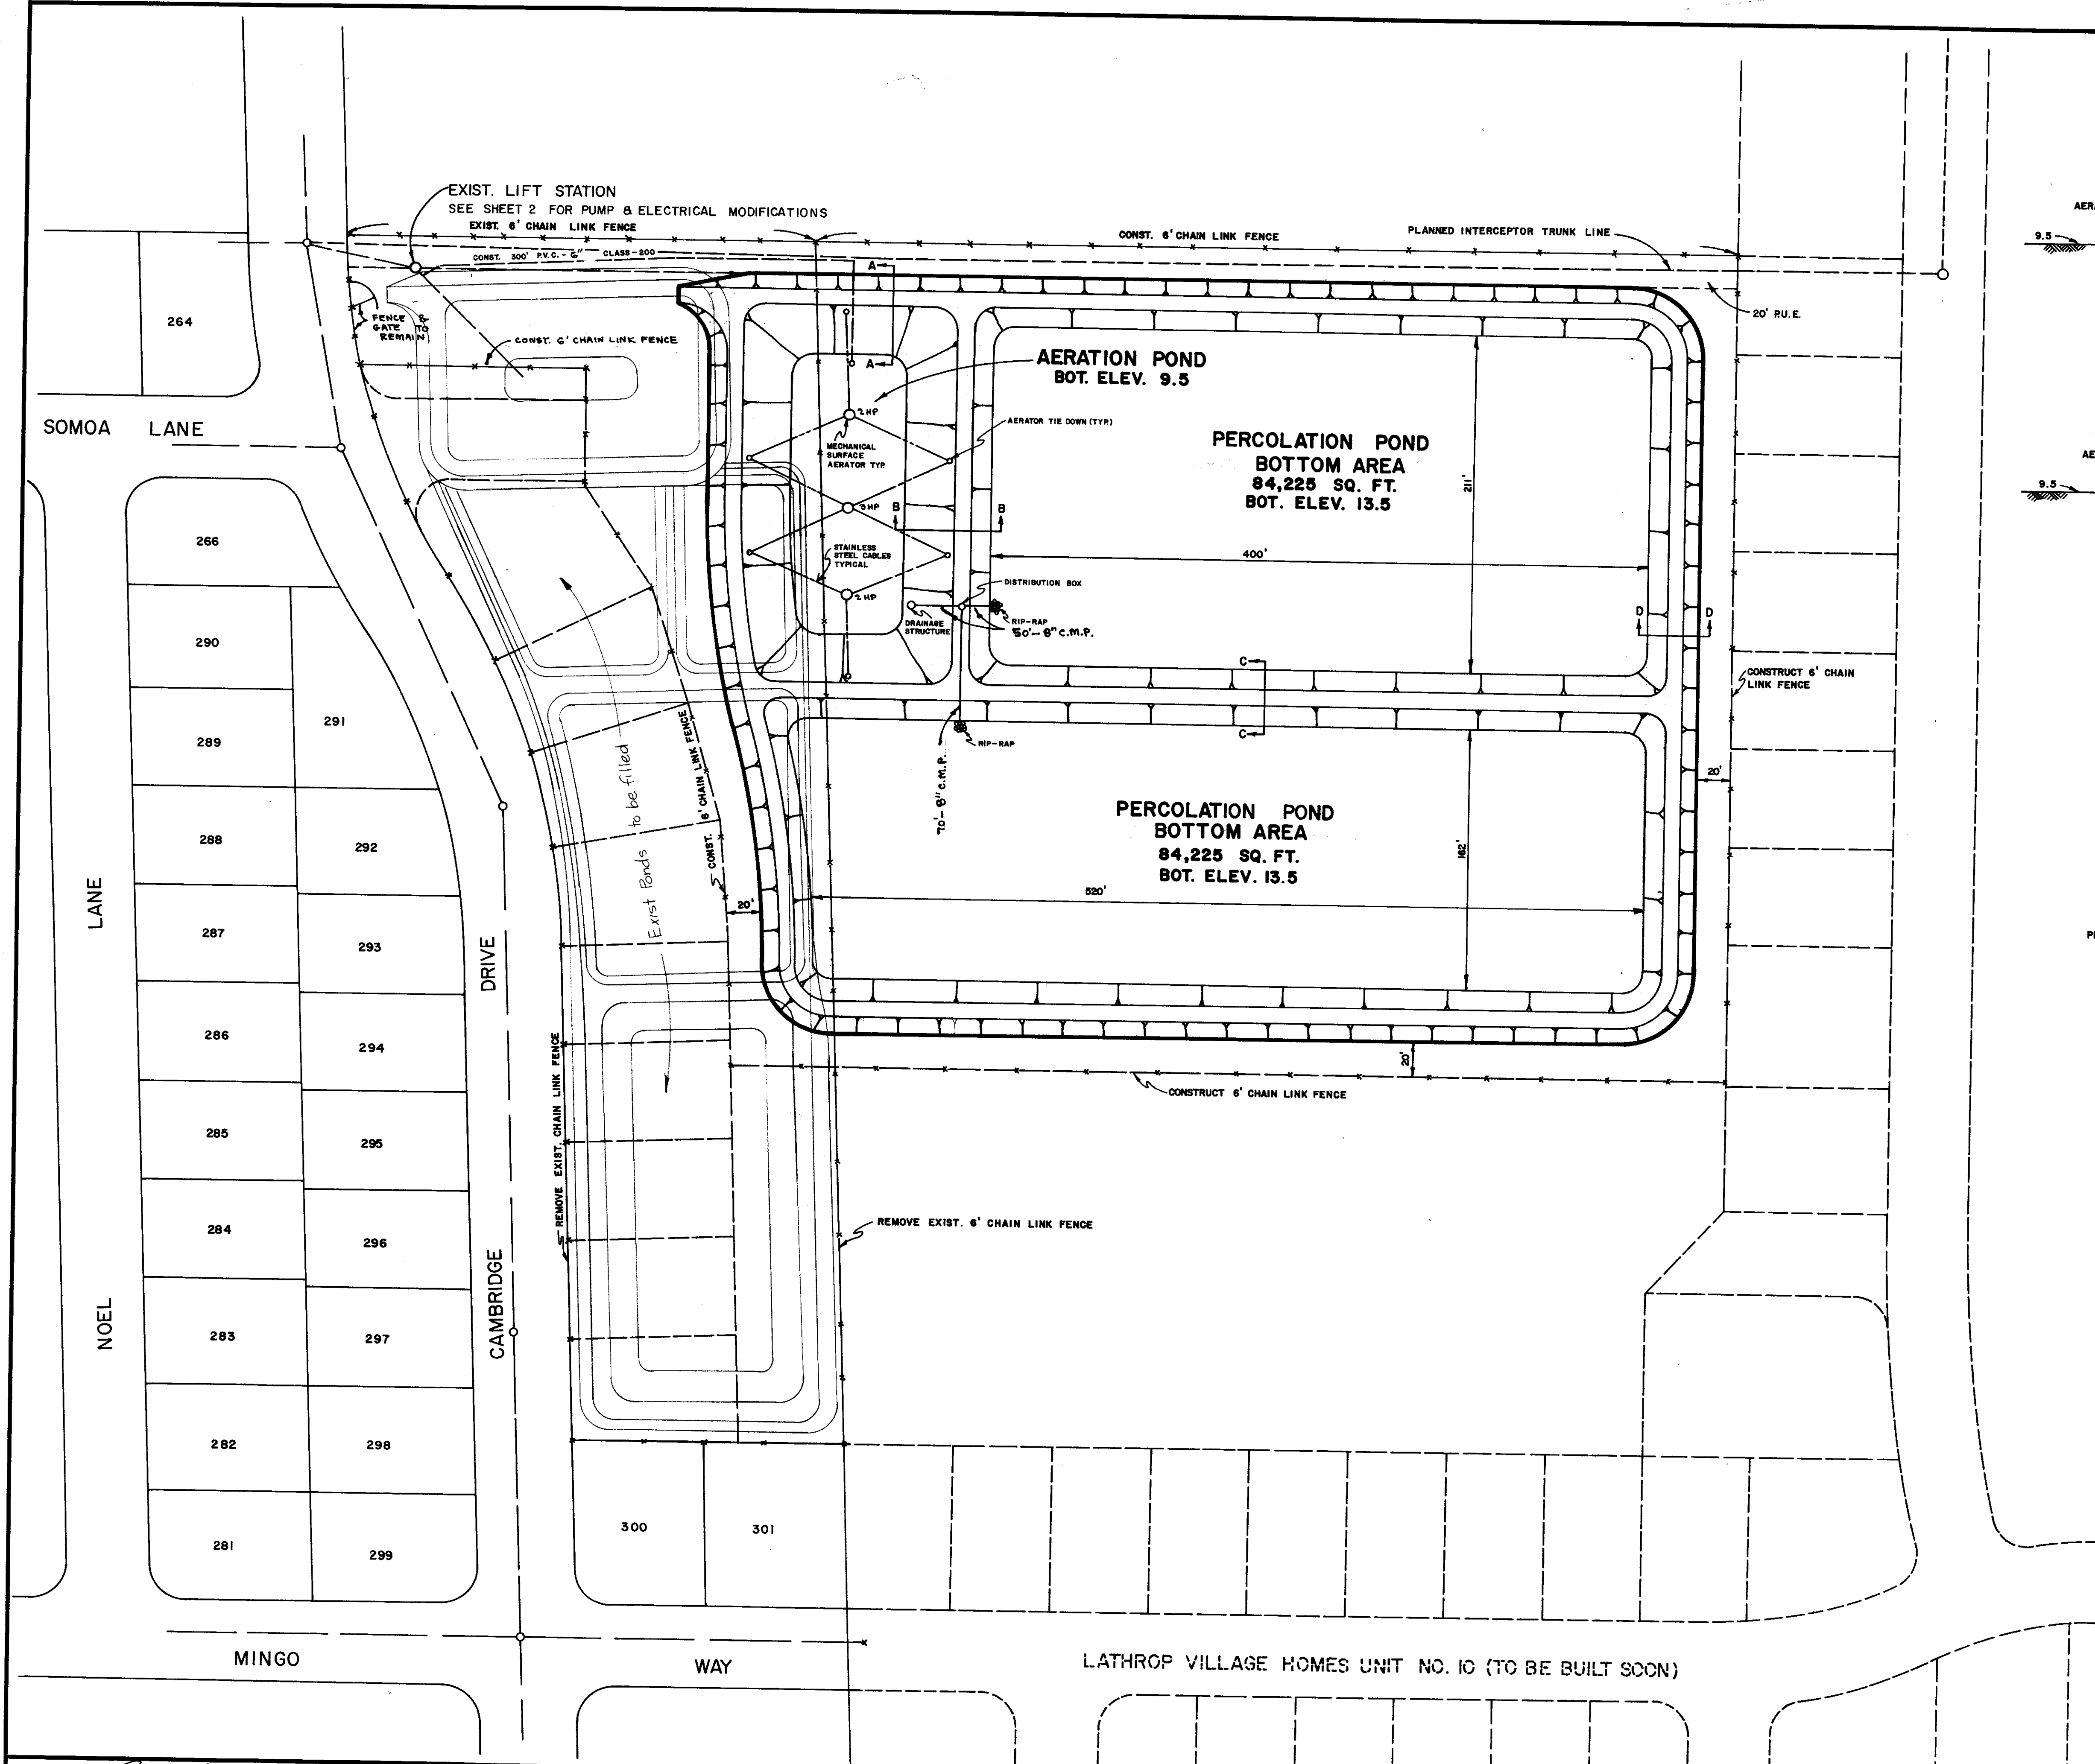

NOTES

1. ALL GRASS AND OTHER DELETERIOUS MATERIAL SHALL BE STRIPPED FROM THE DIKE EMBANKMENT AREAS PRIOR TO FILLING OPERATION.
2. ALL FILL MATERIAL AND THE TOP SIX INCHES OF EXISTING MATERIAL WITHIN DIKE AREAS SHALL BE COMPACTED TO A MINIMUM RELATIVE COMPACTION OF NINETY (90) PER CENT.
3. ANY TRENCH BACKFILL WITHIN DIKES SHALL BE COMPACTED TO A MINIMUM RELATIVE COMPACTION OF NINETY (90) PER CENT.
4. RIP-RAP SHALL BE COBBLES OR QUARRIED ROCK, MAXIMUM SIZE = 8", MINIMUM SIZE = 1 1/2", NOT MORE THAN 40% OF STONE SHALL BE LESS THAN 4" IN LEAST DIMENSION.
5. FENCE MATERIAL SHALL CONSIST OF CALIF. STD. TYPE CL-6, 6' HIGH CHAIN LINK FENCE. INTERMEDIATE FENCE POSTS SHALL BE 2" DIAMETER, END AND GATE POSTS SHALL BE 3" DIAMETER. ALL POSTS SHALL BE SET 3' DEEP IN 12" DIAMETER CONCRETE.

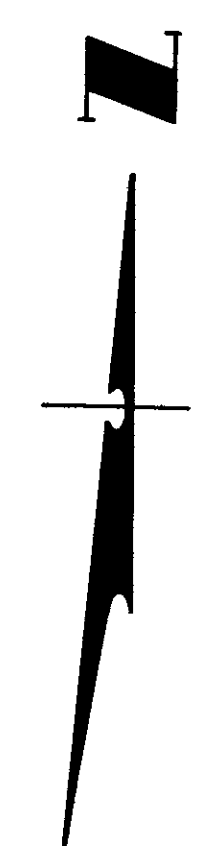

APPROVED August 23 1978 Lee Hall R.S.
 SAN JOAQUIN LOCAL HEALTH DISTRICT

APPROVED 9-14 1978 William J. Starn
 SAN JOAQUIN COUNTY PUBLIC WORKS DEPT.

revisions				
no.	description	date	by	

WONG ENGINEERS
 PLANNING • ENGINEERING • SURVEYING
 STOCKTON, CALIFORNIA
George Wong
 R.C.E. No. 14269

job no. 1443
 date AUG. 1978
 scale 1" = 50'
 drawn D.R.K.
 design C.C.W.
 check C.C.W.

**SEWAGE TREATMENT PLANT EXPANSION
 FOR LATHROP ACRES SEWER MAINTENANCE DIST.**

SHEET
J
 OF TWO
 FILE